



STANLEY
METRIC
45-530
GRADUATIONS
PAT. NO. 4200990

RAPA Testing and Certification Laboratory

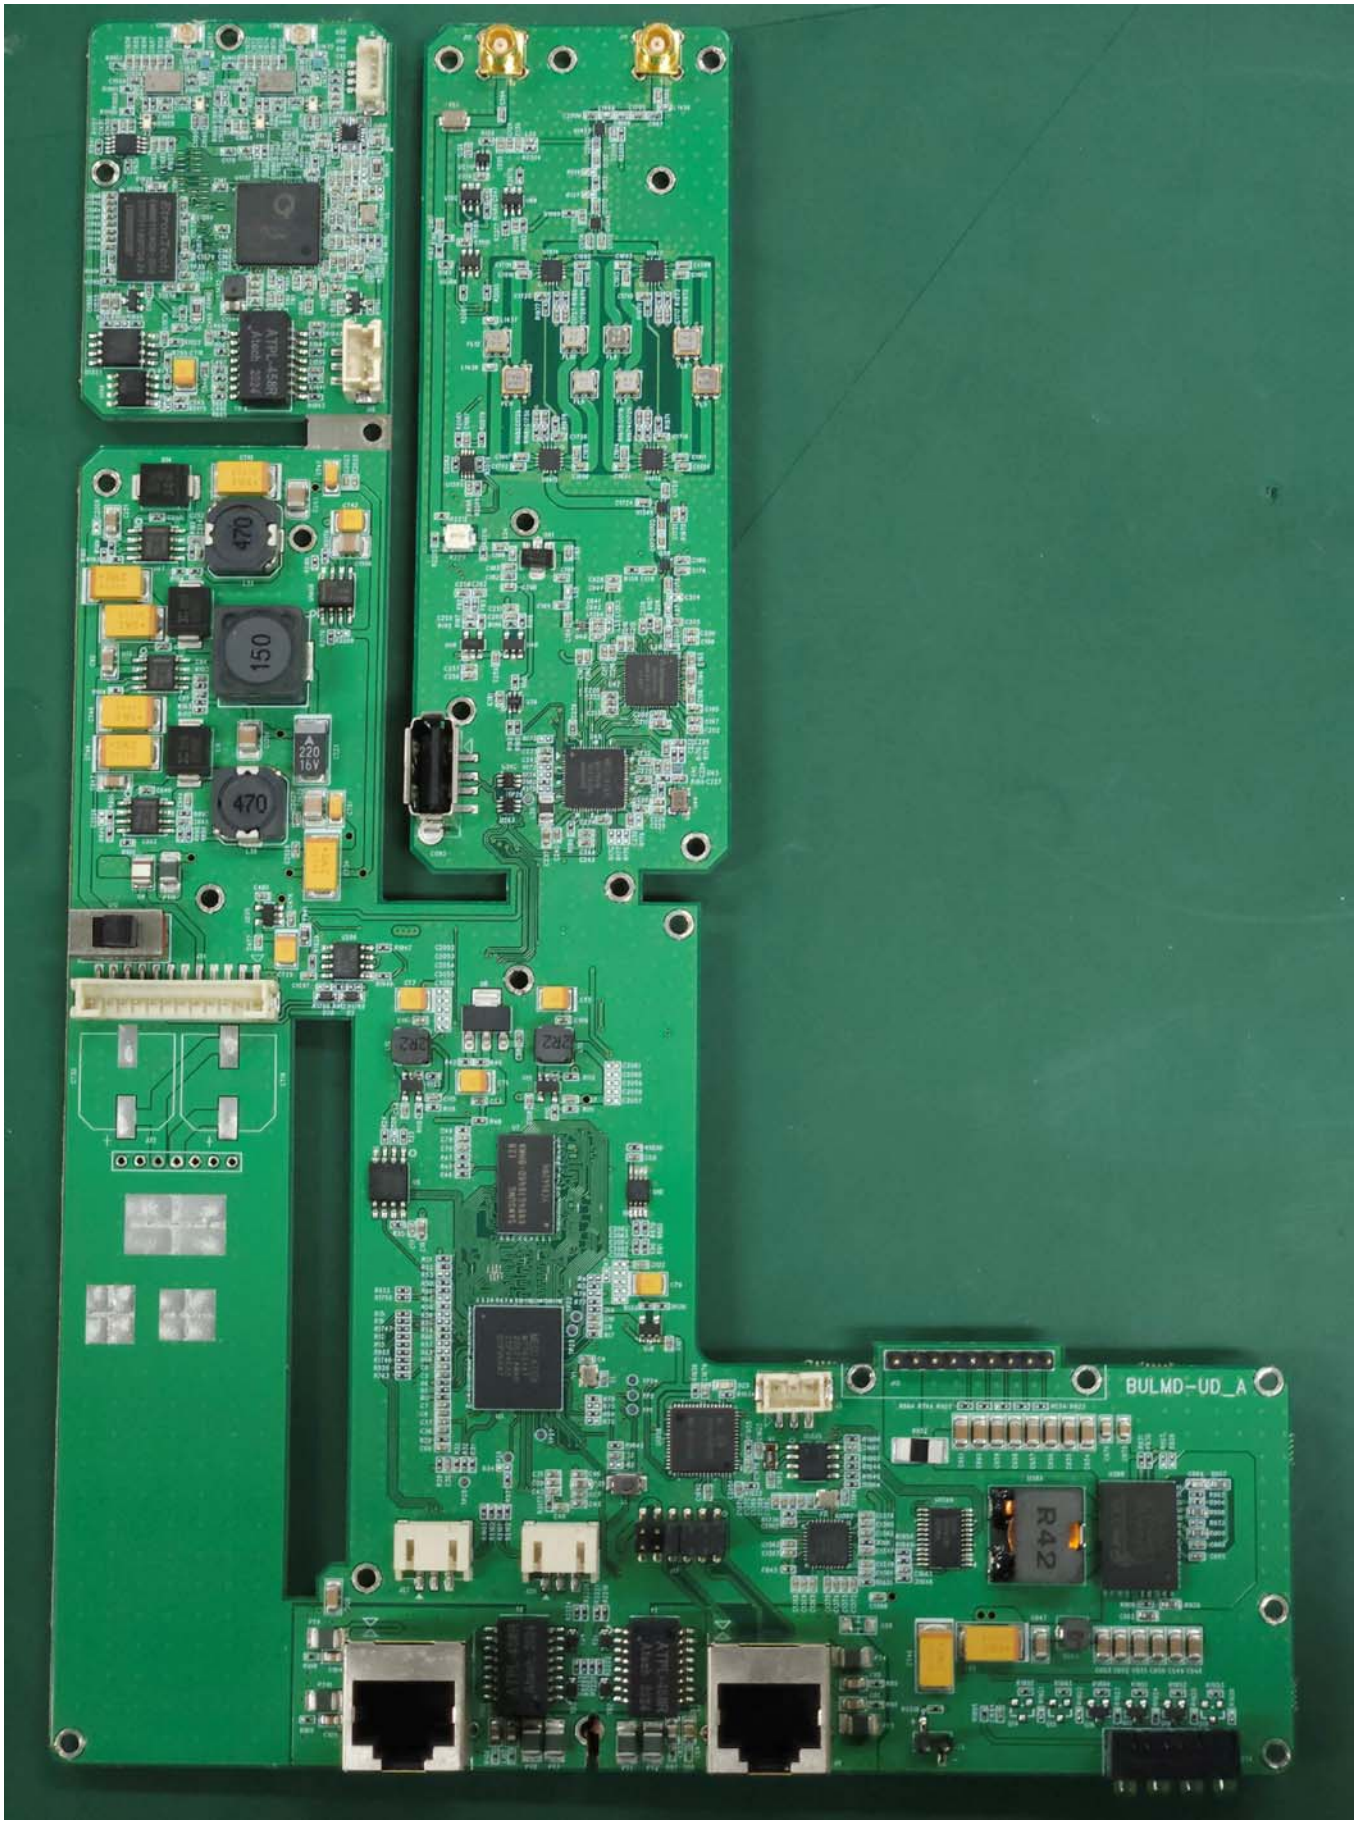


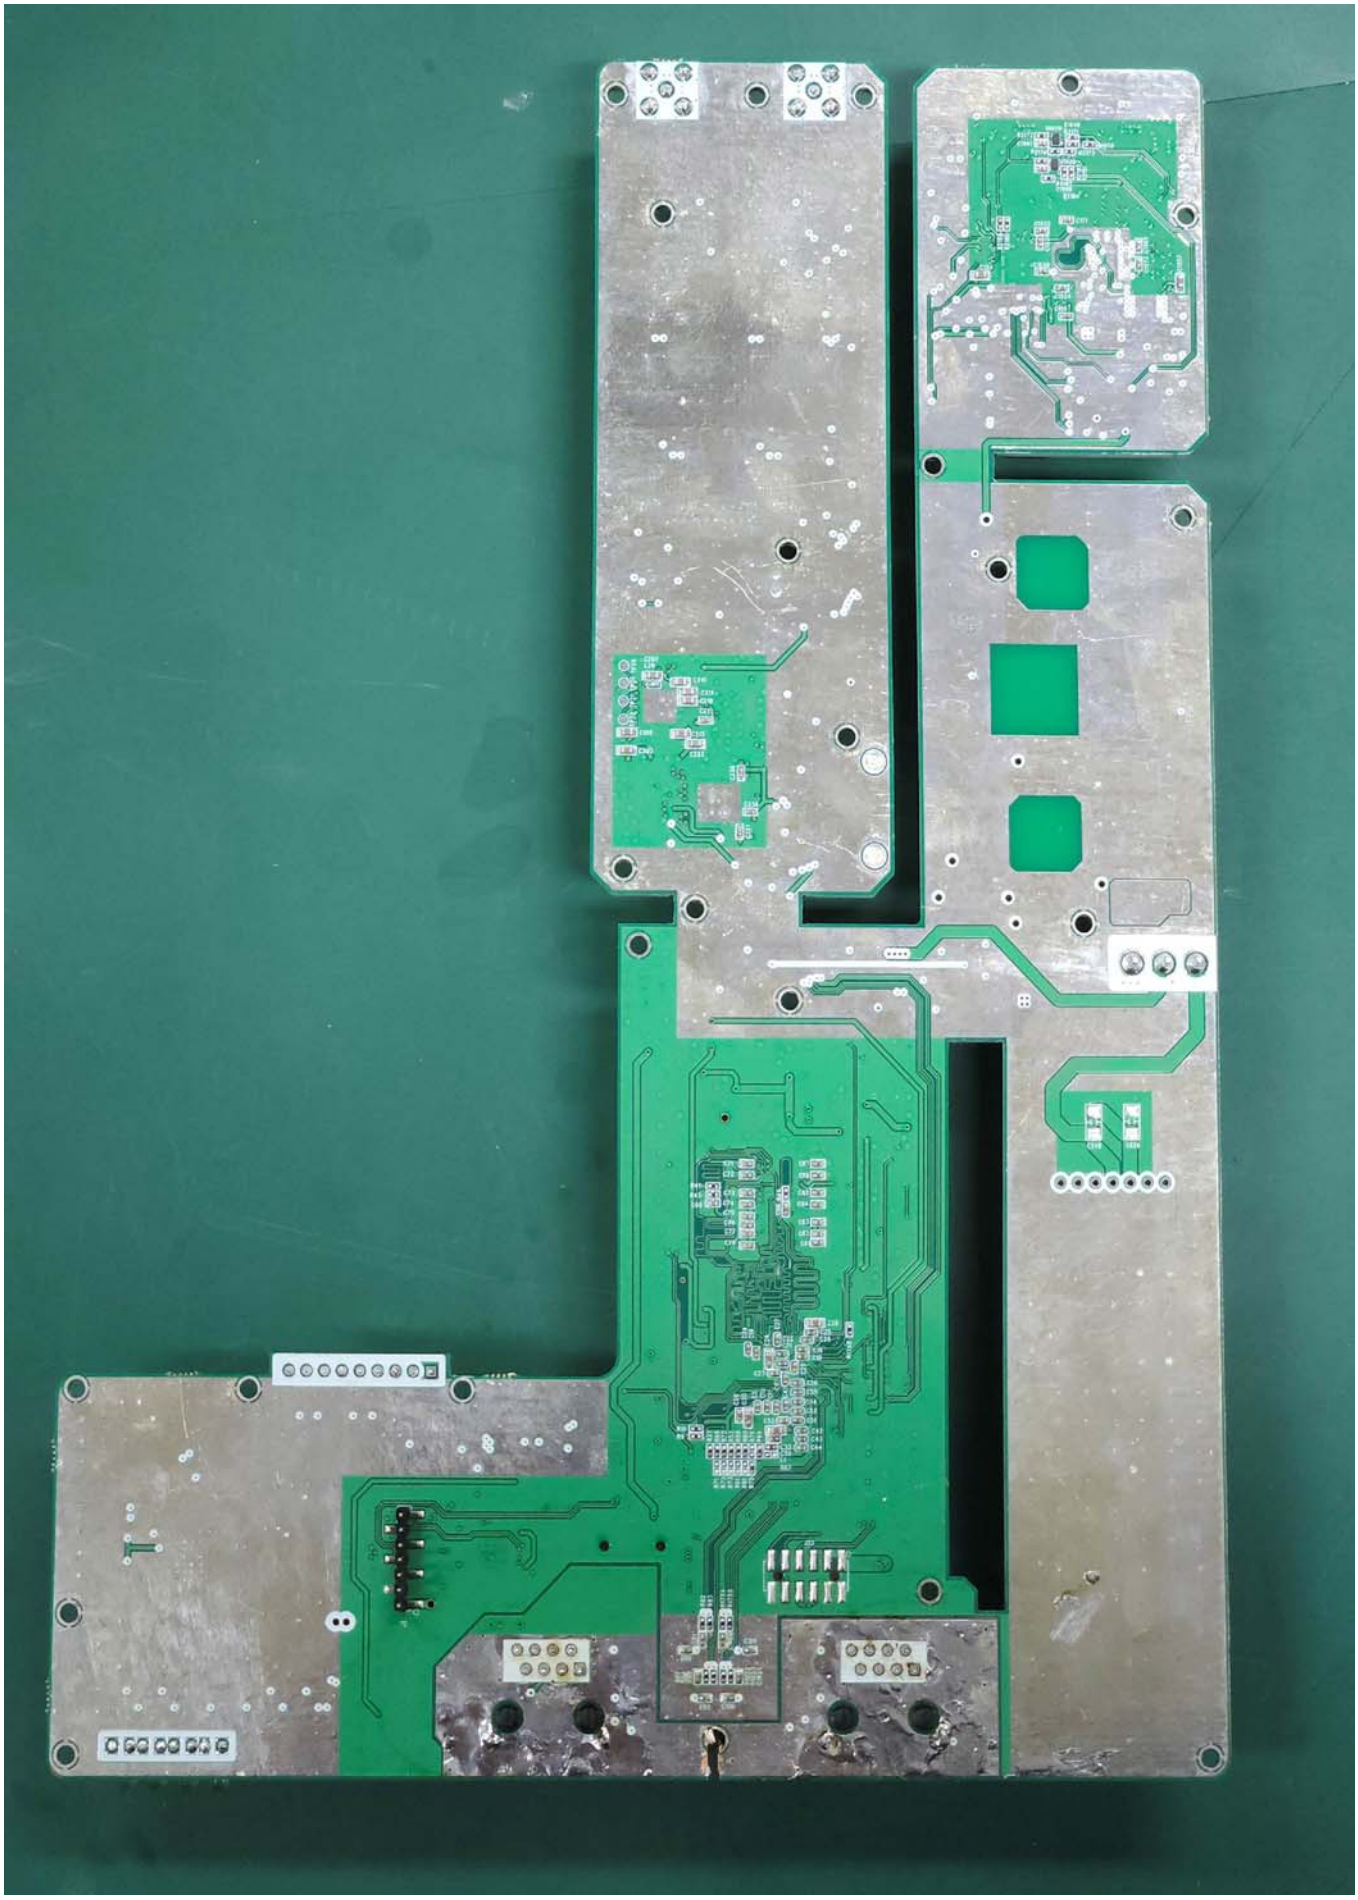


Testing and
Certification
Laboratory

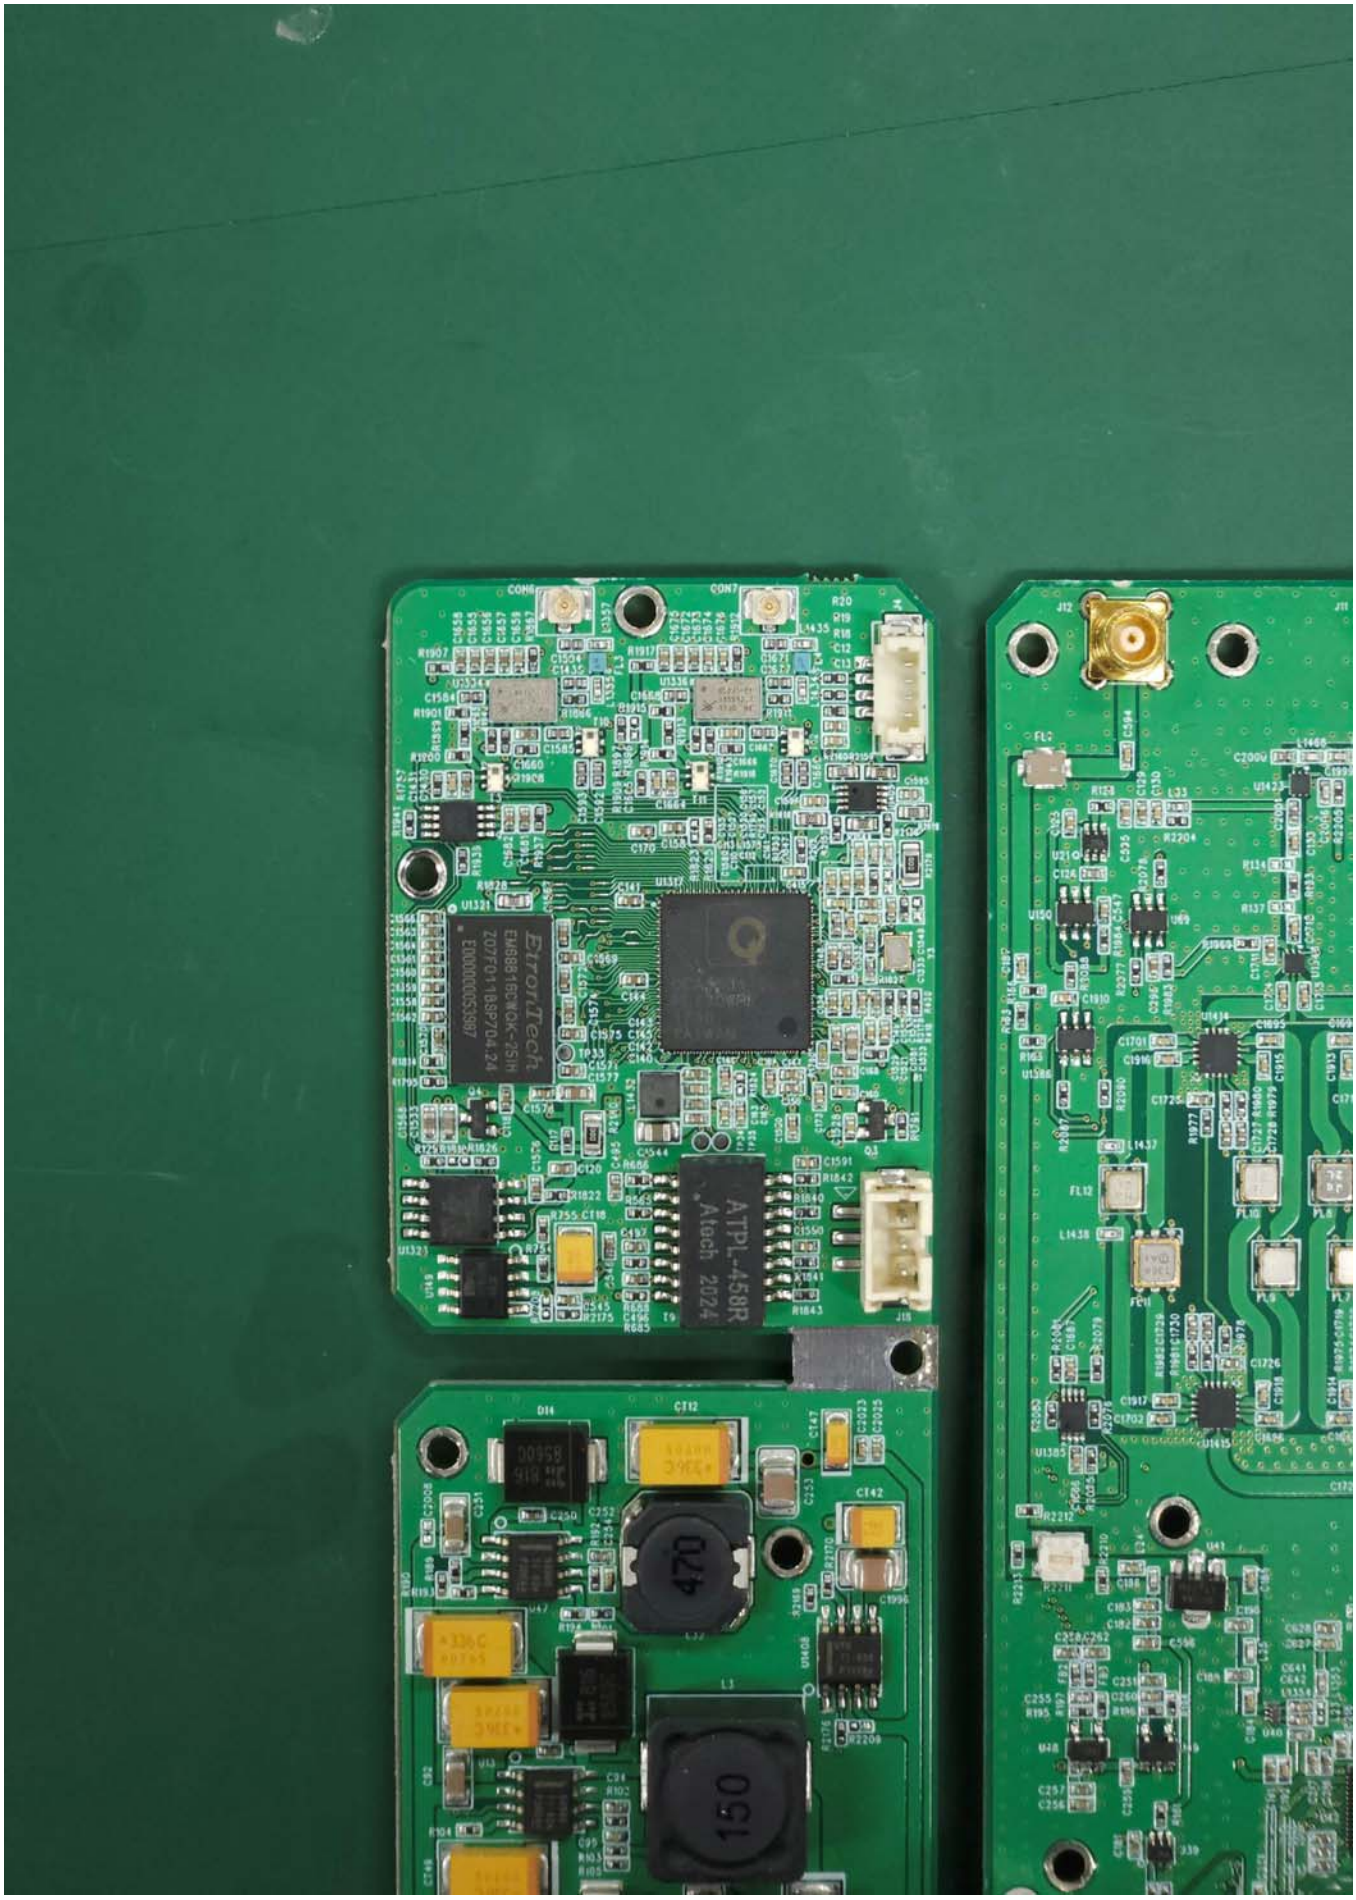


RAPA Testing and Certification Laboratory

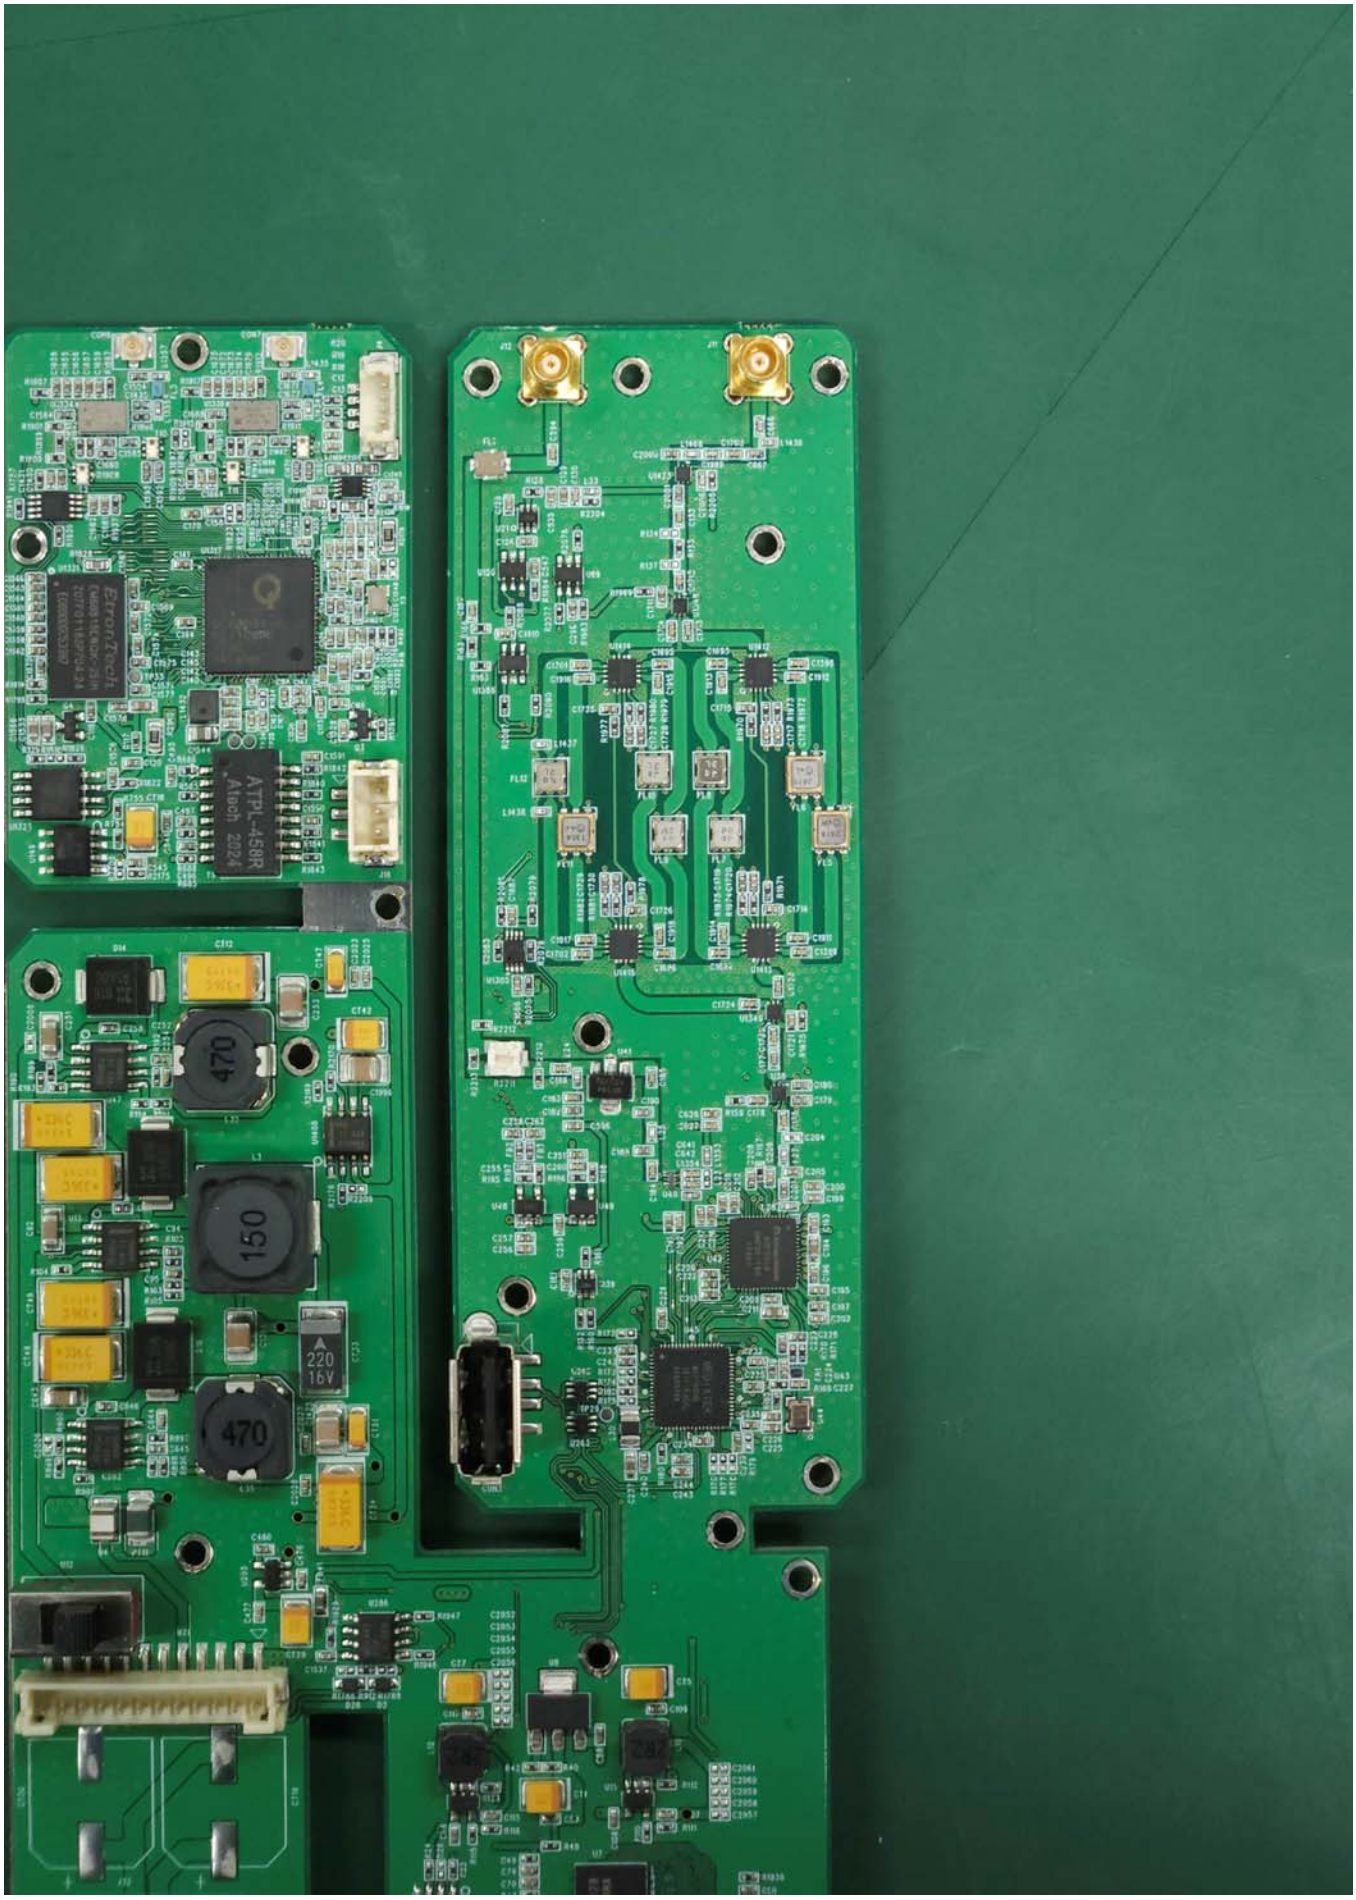



RAPA Testing and Certification Laboratory

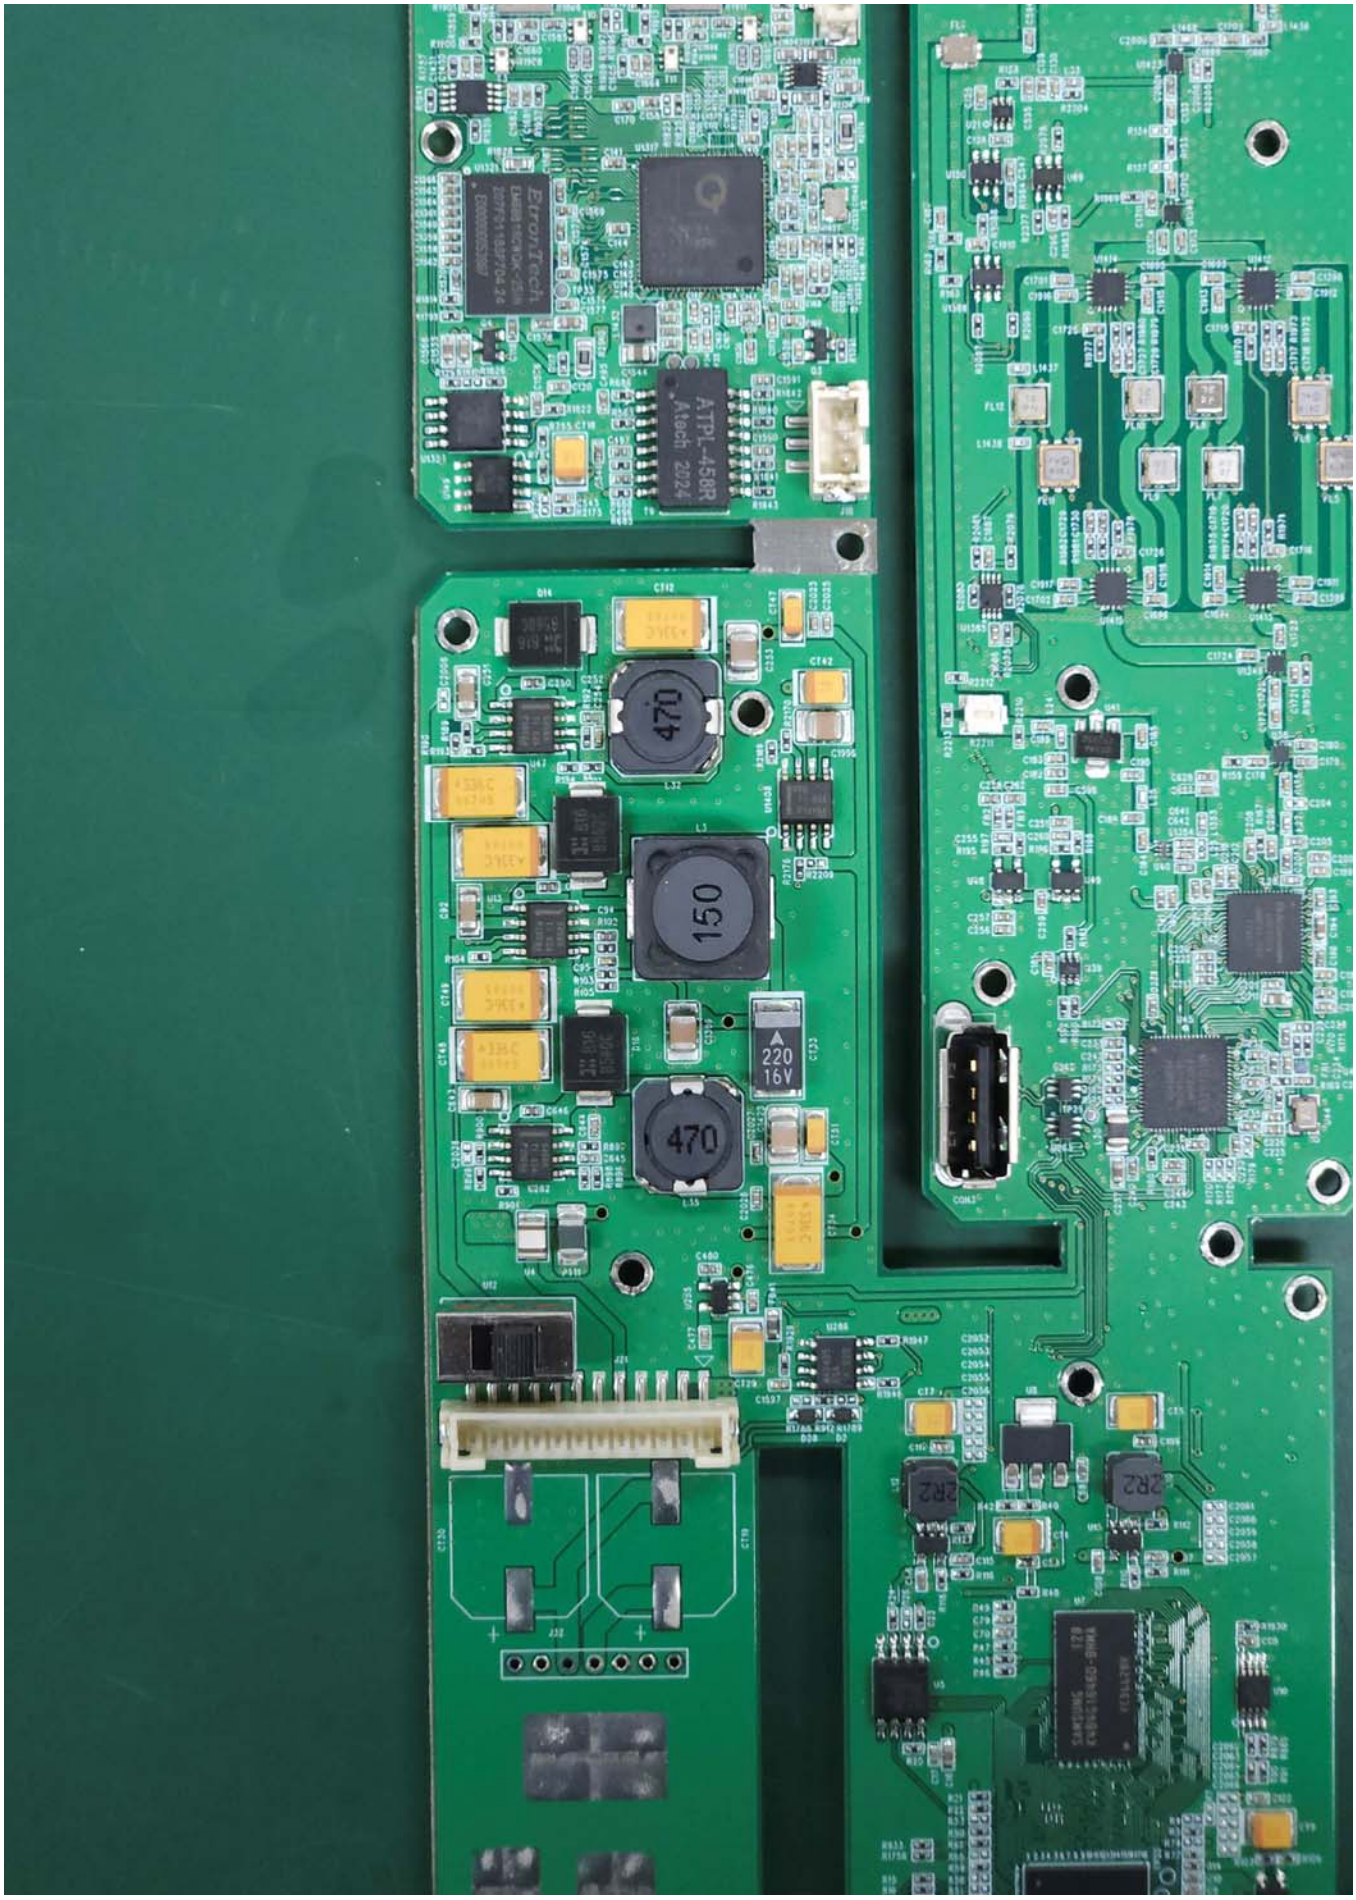


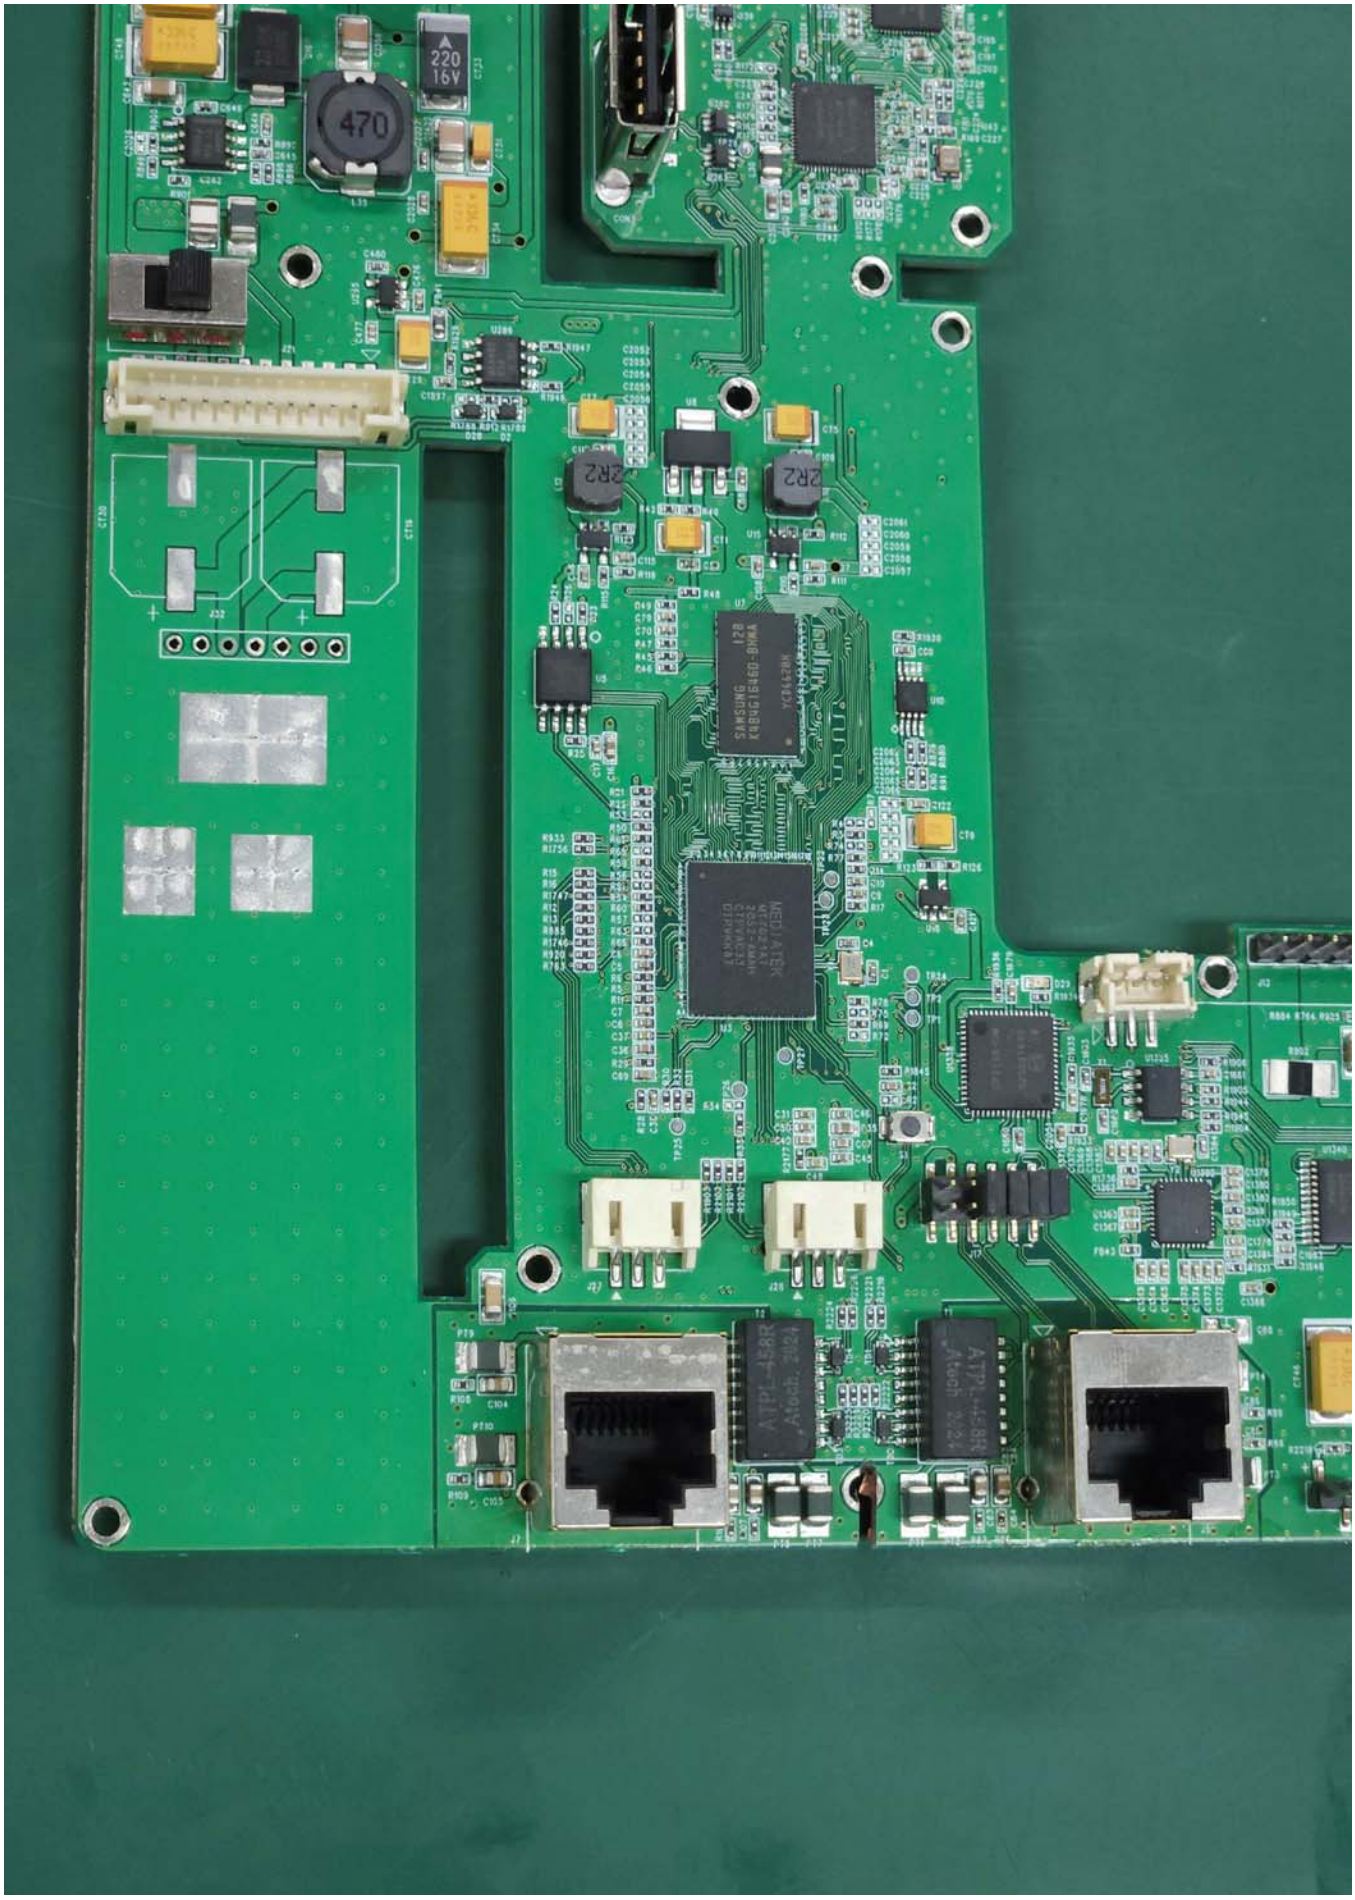

220
16V
470
SAMSUNG
K4B4G1646D-BHMA
MEDIATEK


RAPA Testing and Certification Laboratory

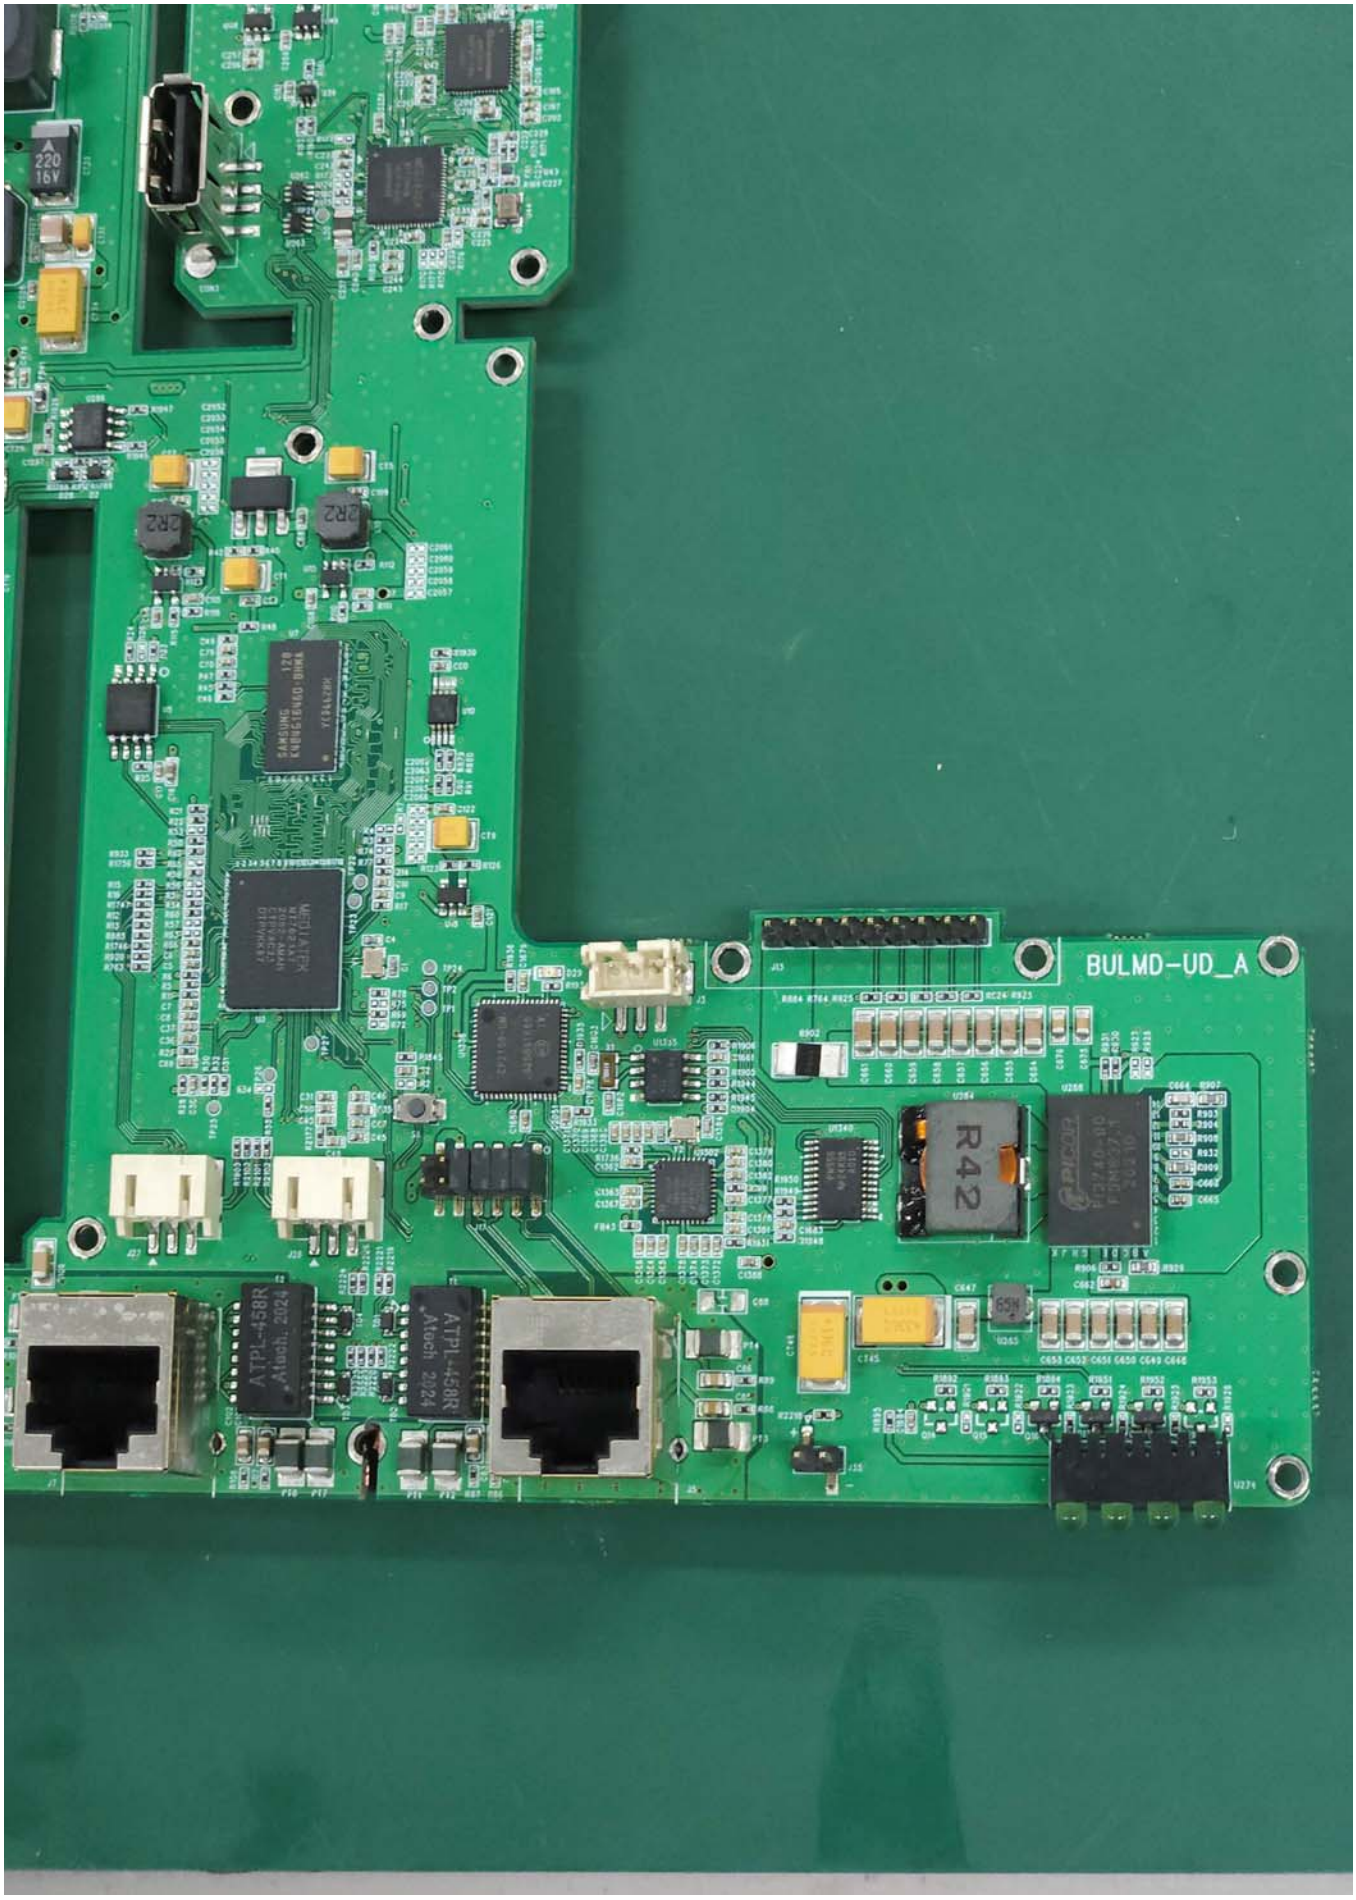

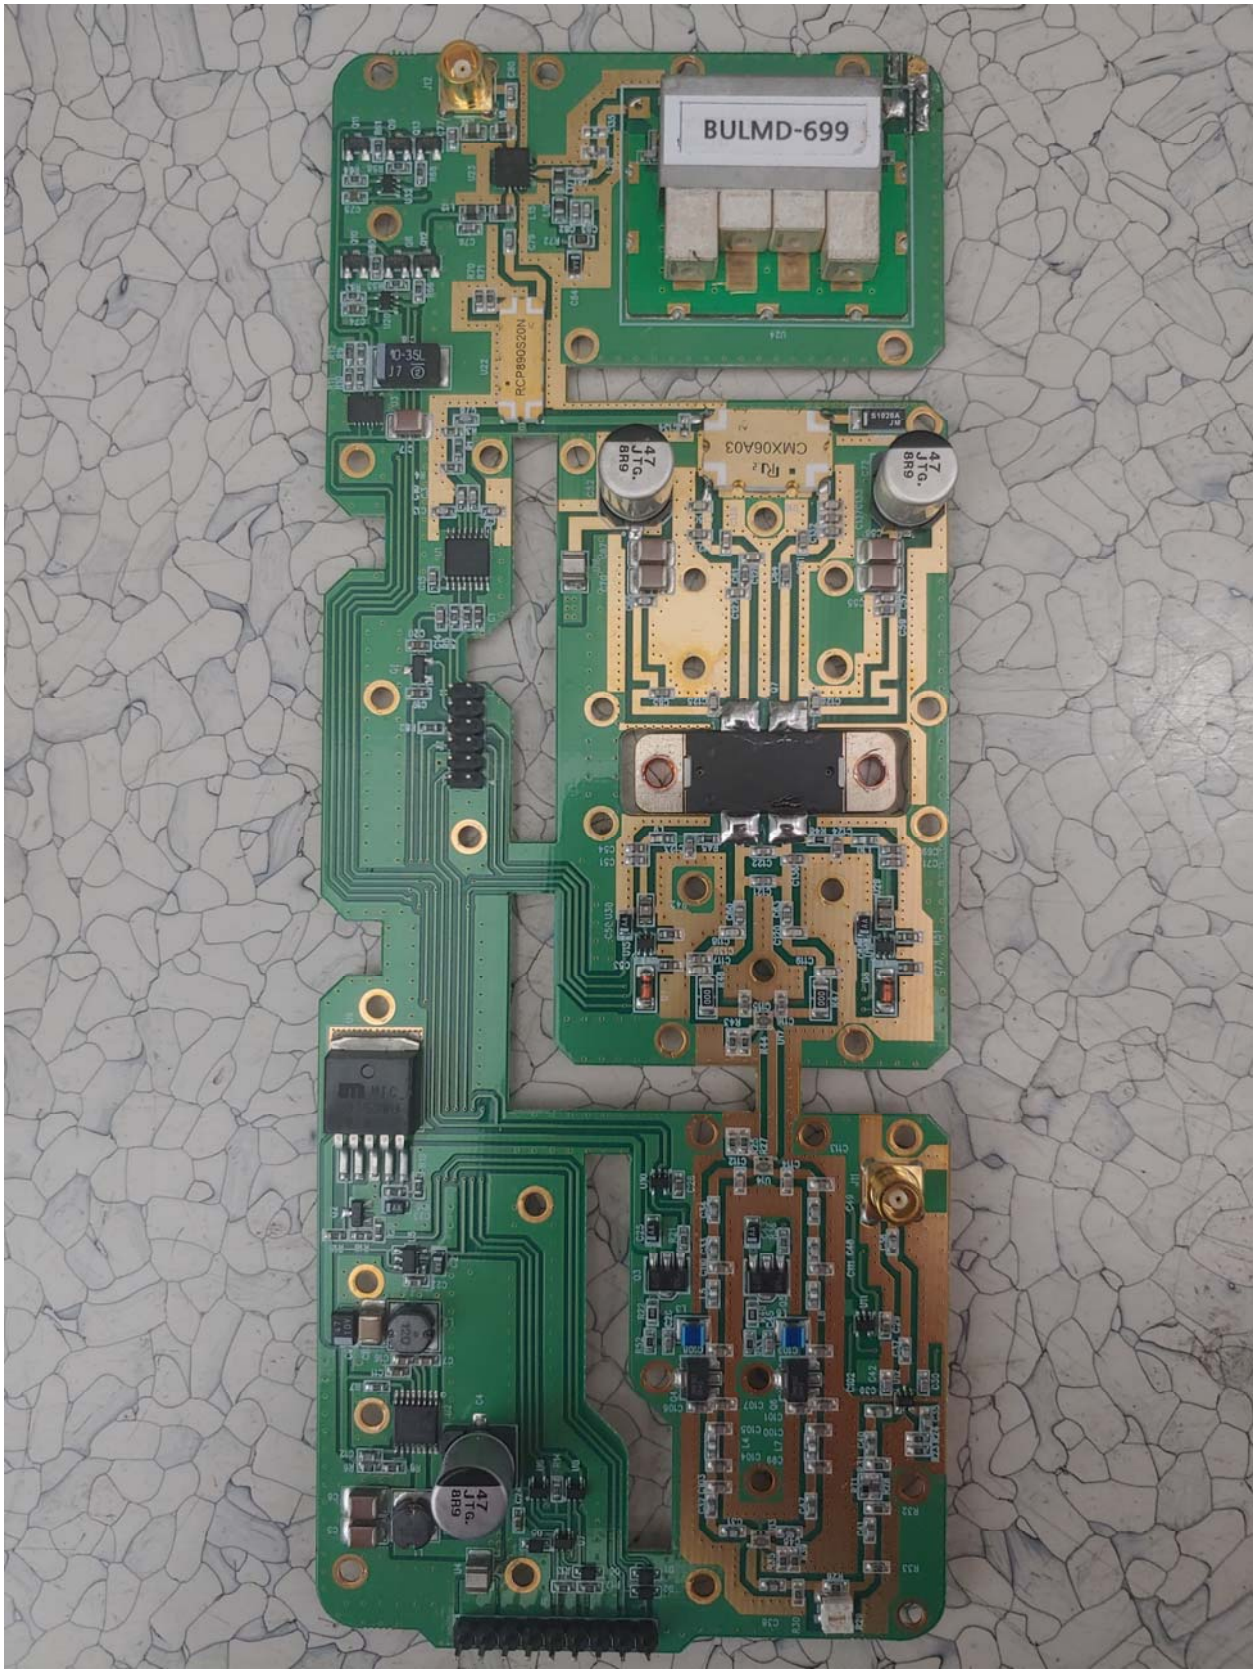
BULMD-699

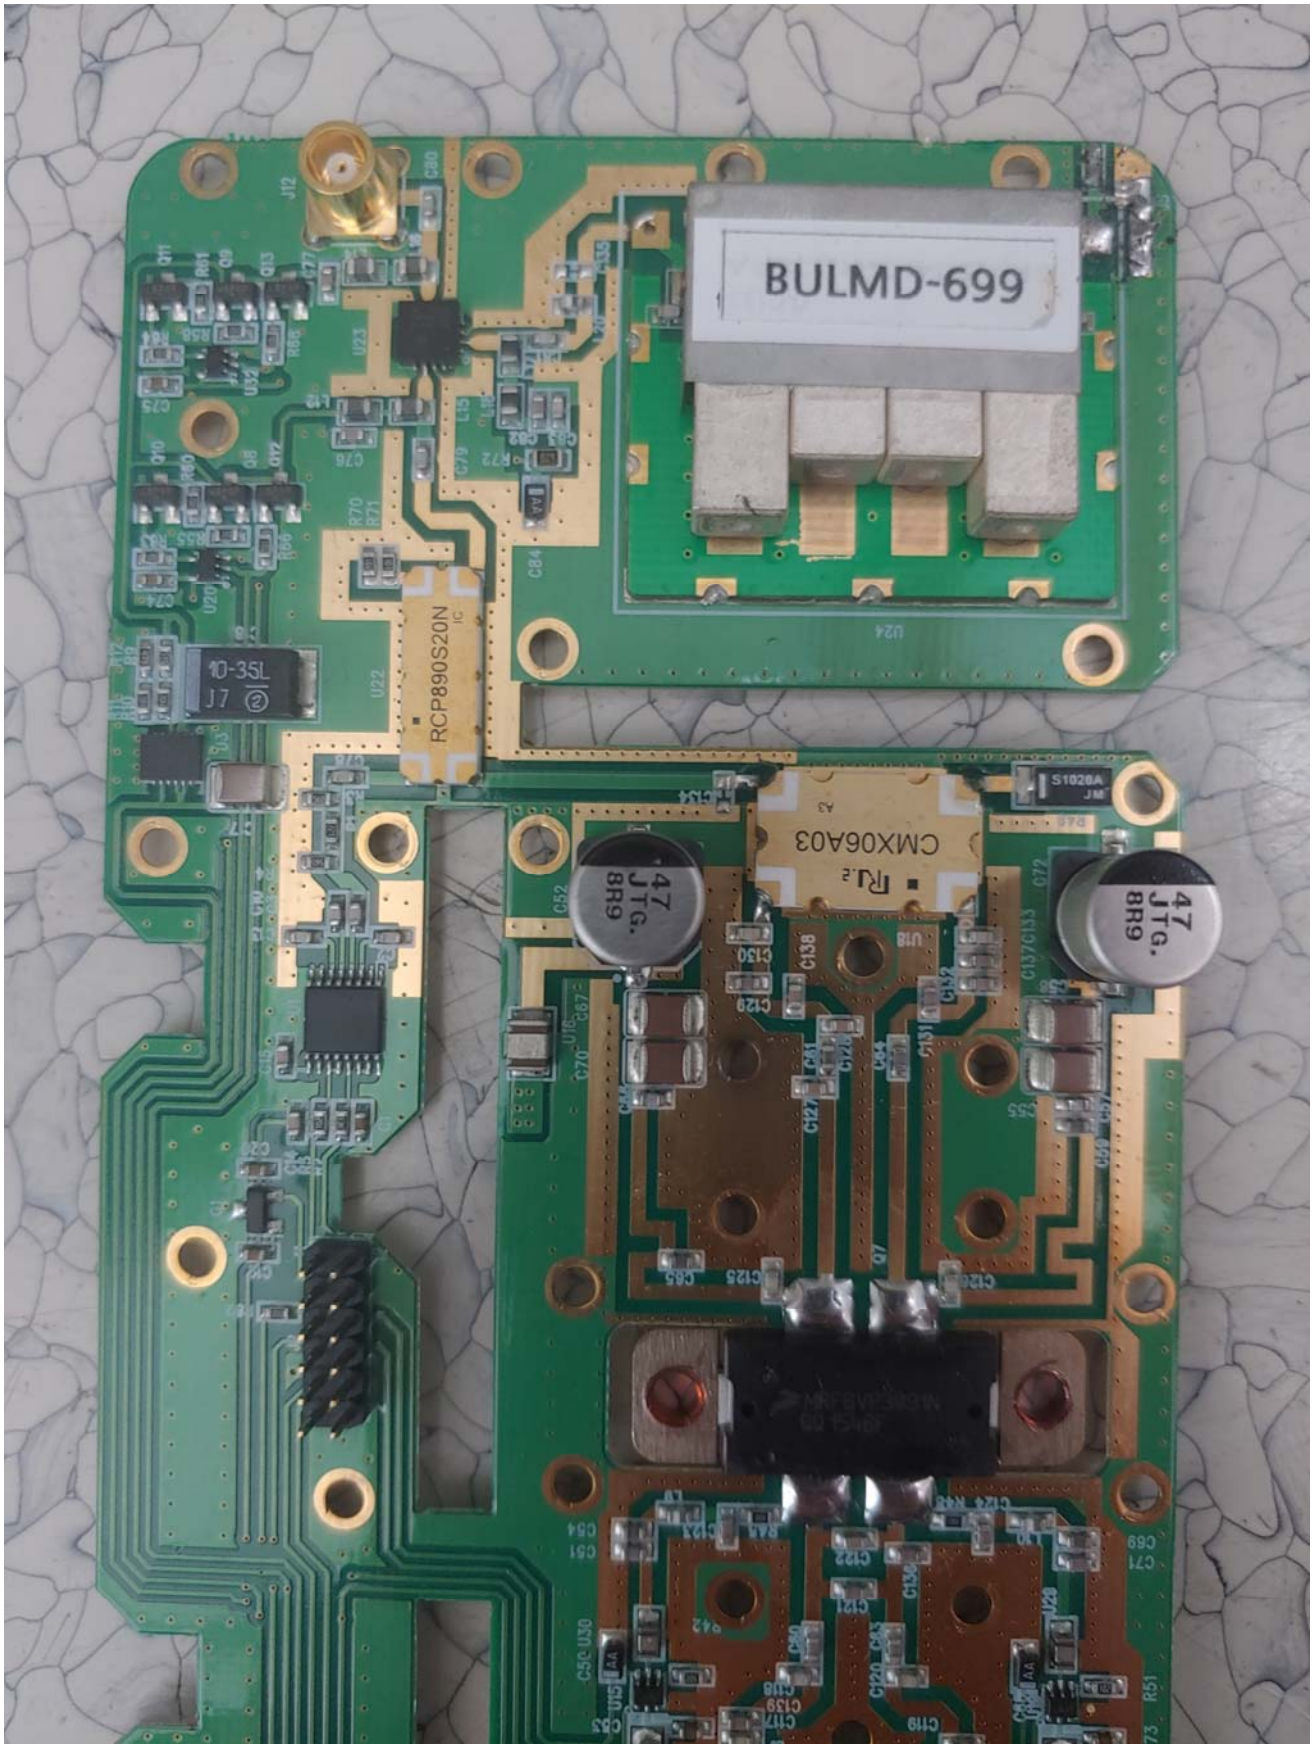
BULMD-699
RCP890S20N
CMX06A03
47
JTG.
8R9
47
JTG.
8R9

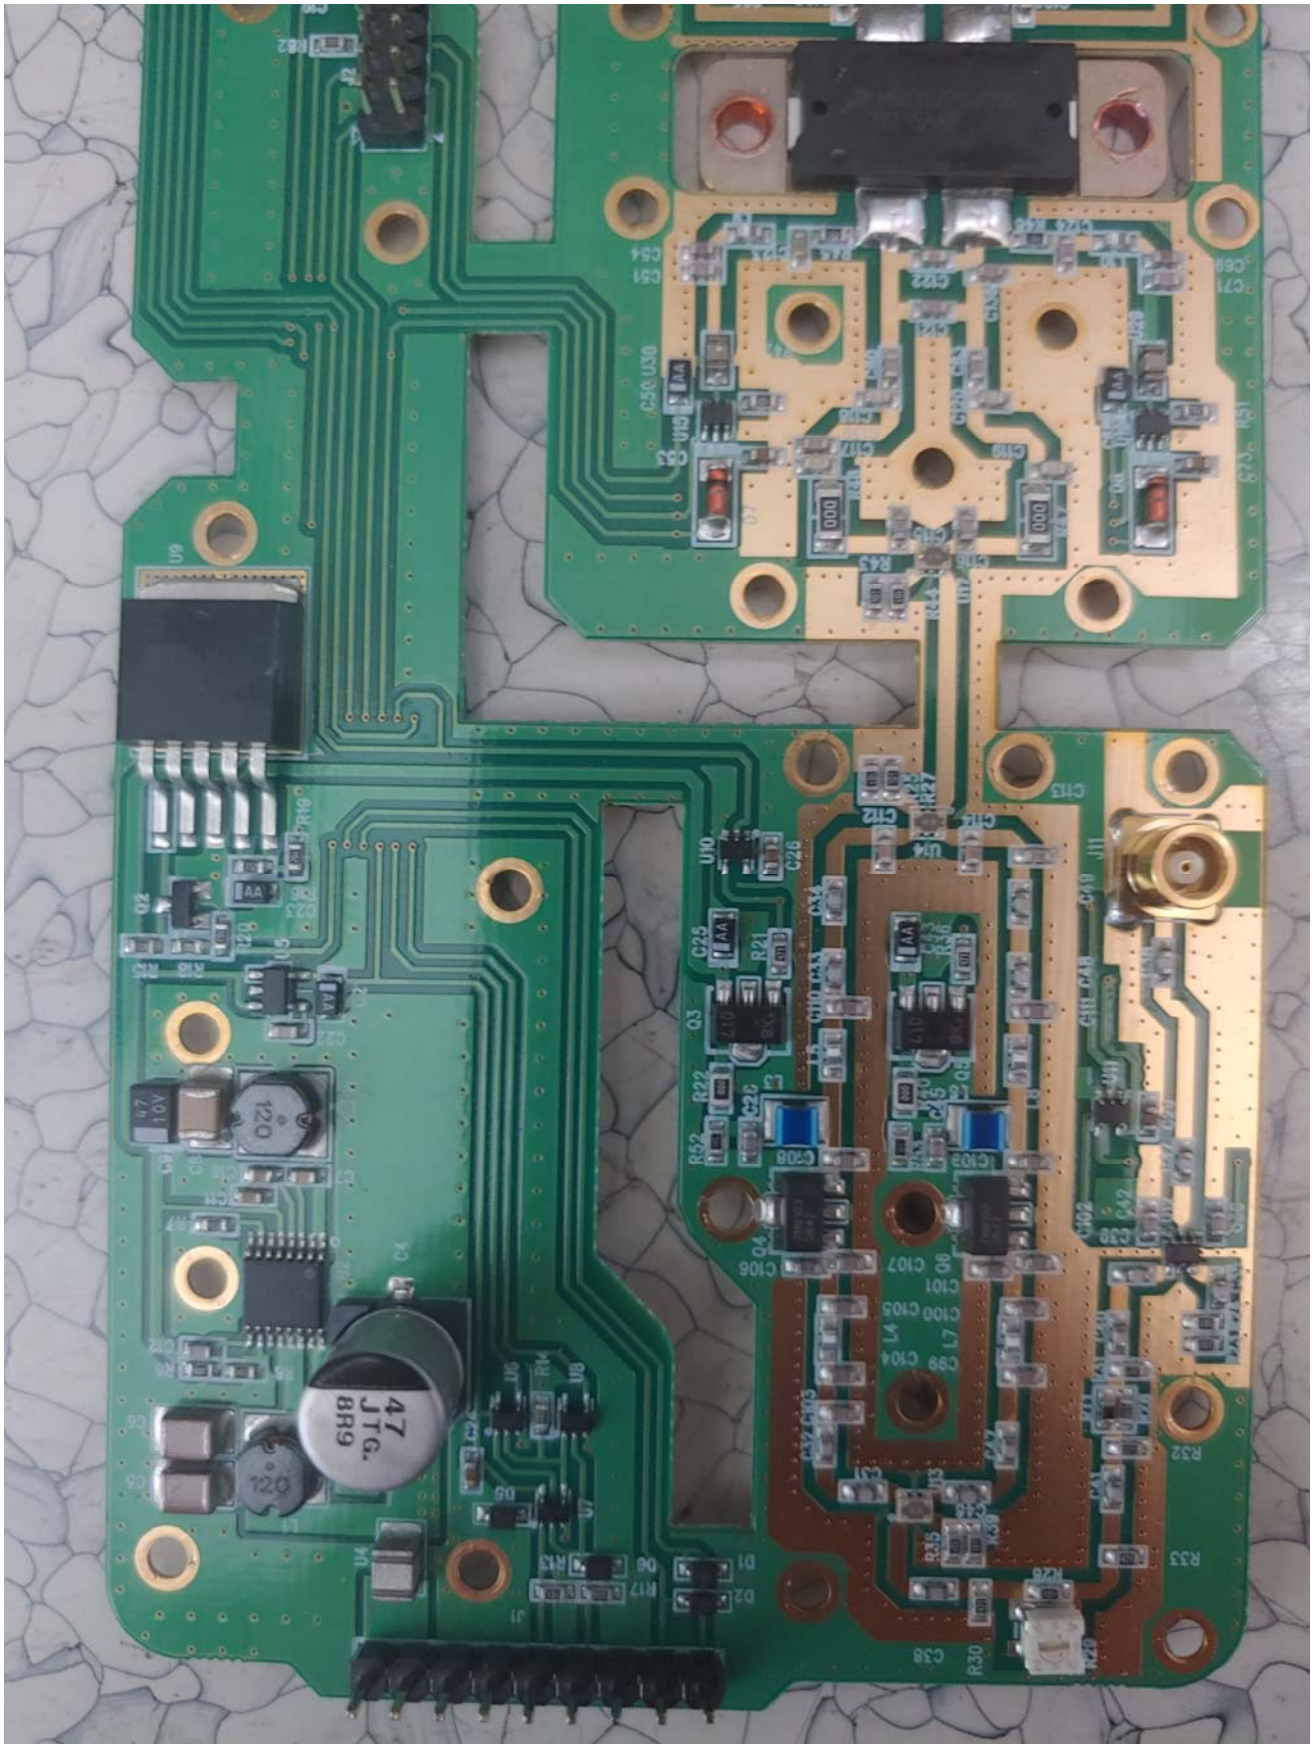
47
JTG.
8R9
120
10V

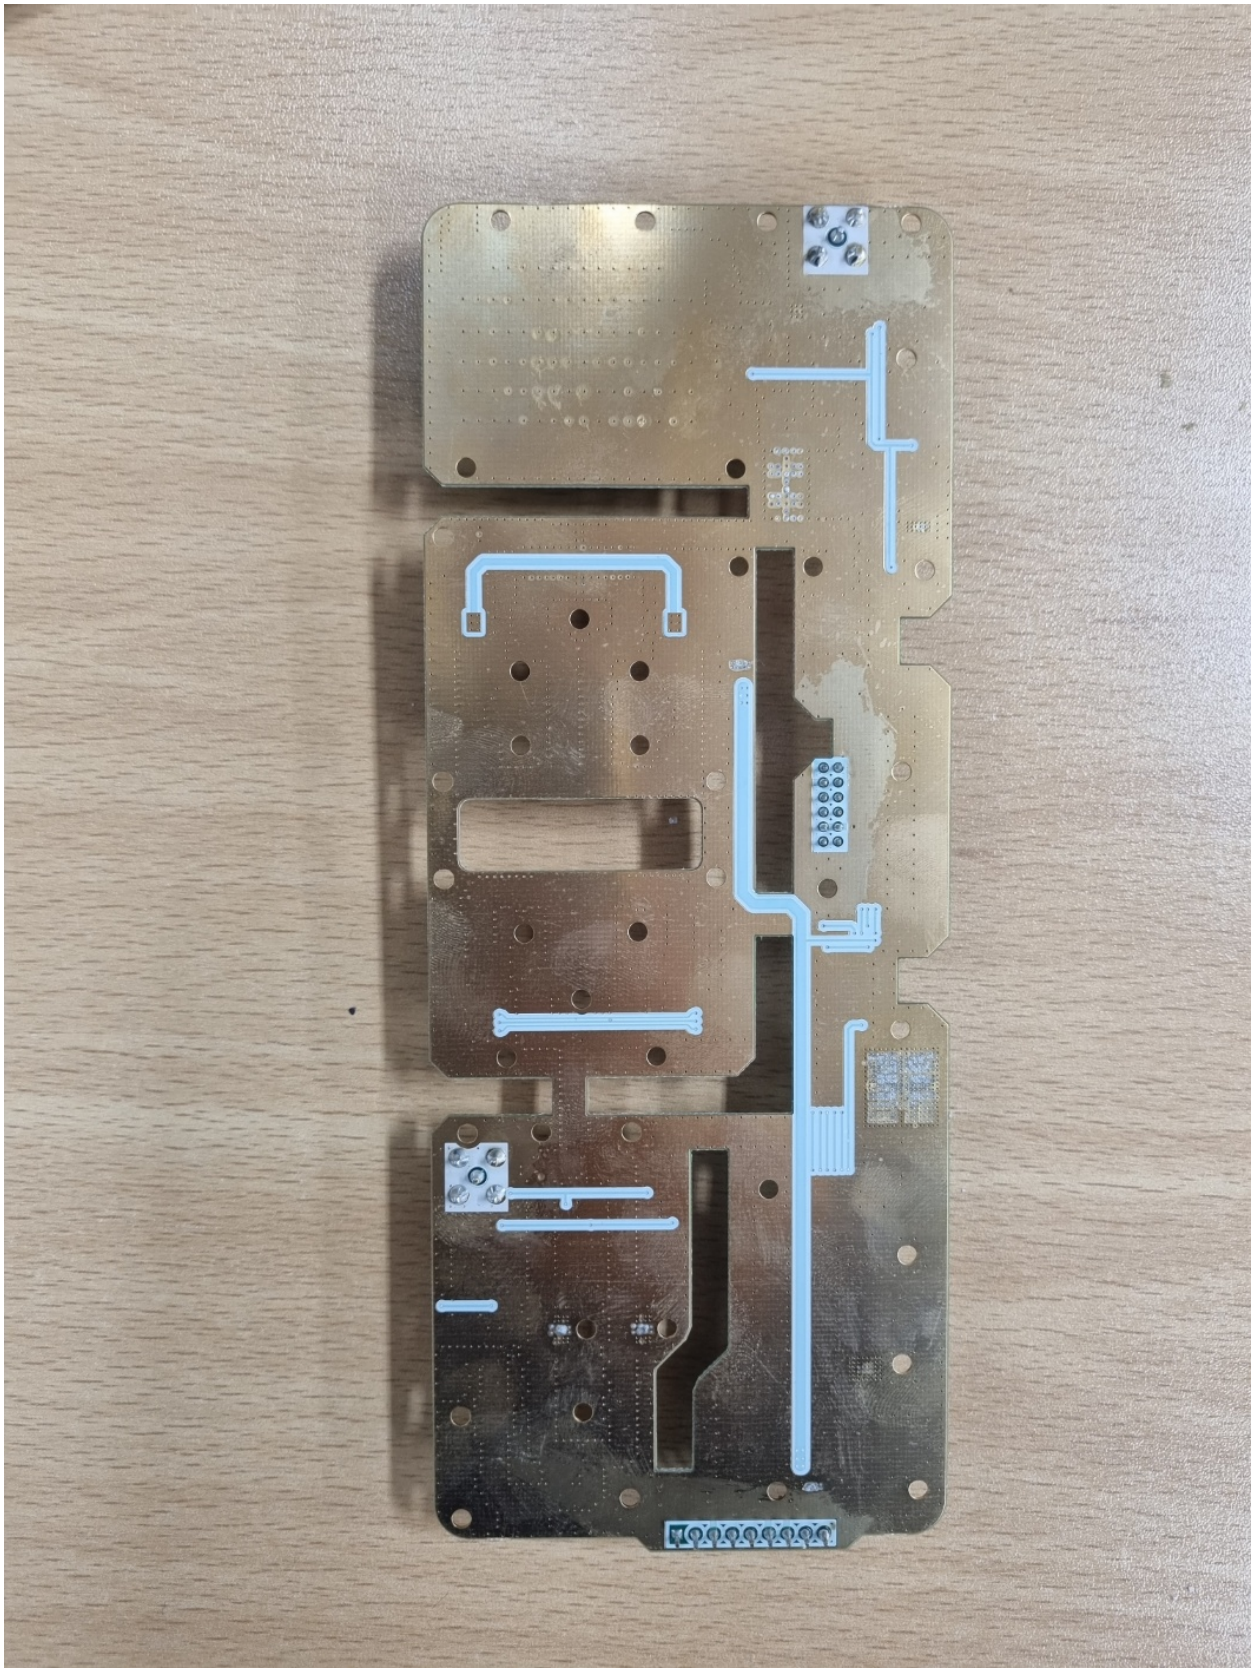




QC
PASS

