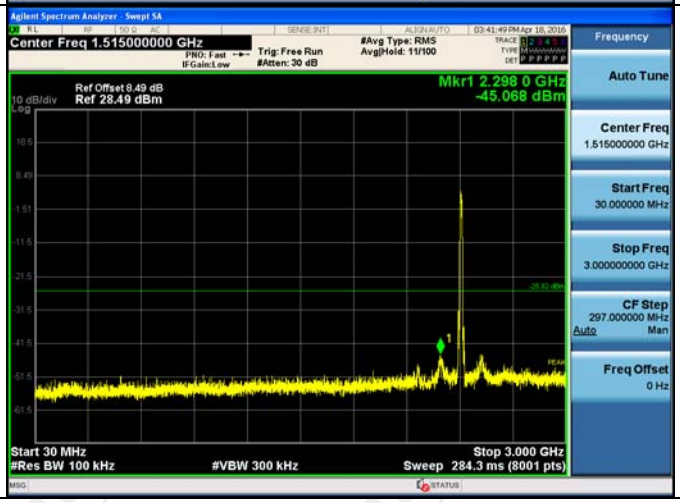
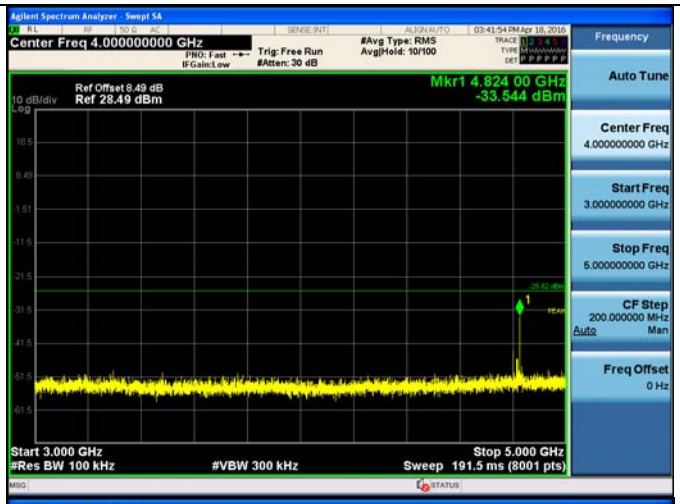
# RF Conducted Spurious Emissions

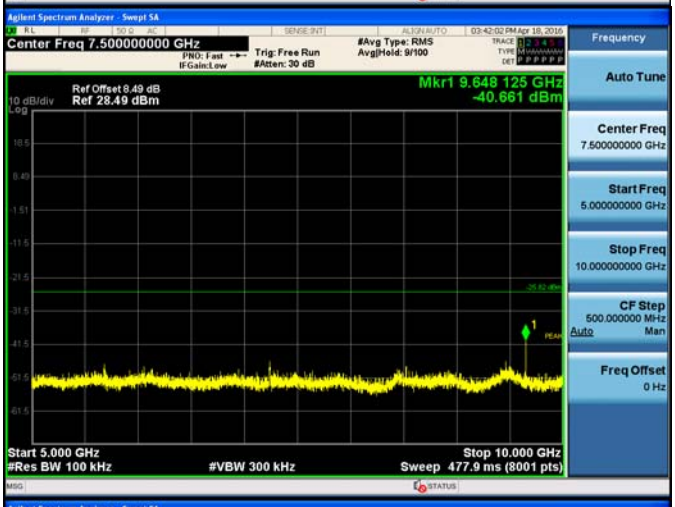
## Result Table

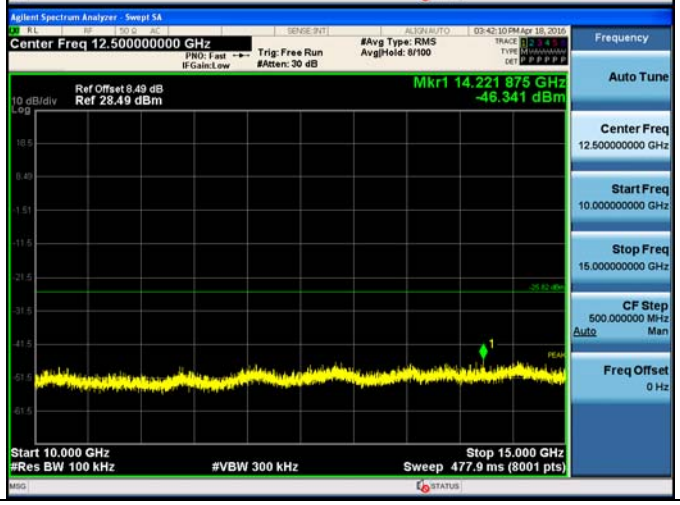
| Mode | Channel | Pref [dBm] | Puw[dBm] | Verdict |
|---|---|---|---|---|
| 11B | LCH | 4.182 | <Limit | PASS |
| 11B | MCH | 2.022 | <Limit | PASS |
| 11B | HCH | 3.537 | <Limit | PASS |
| 11G | LCH | 1.001 | <Limit | PASS |
| 11G | MCH | -0.632 | <Limit | PASS |
| 11G | HCH | -0.202 | <Limit | PASS |
| 11N20SISO | LCH | 0.254 | <Limit | PASS |
| 11N20SISO | MCH | -0.95 | <Limit | PASS |
| 11N20SISO | HCH | -0.169 | <Limit | PASS |

## Test Graph

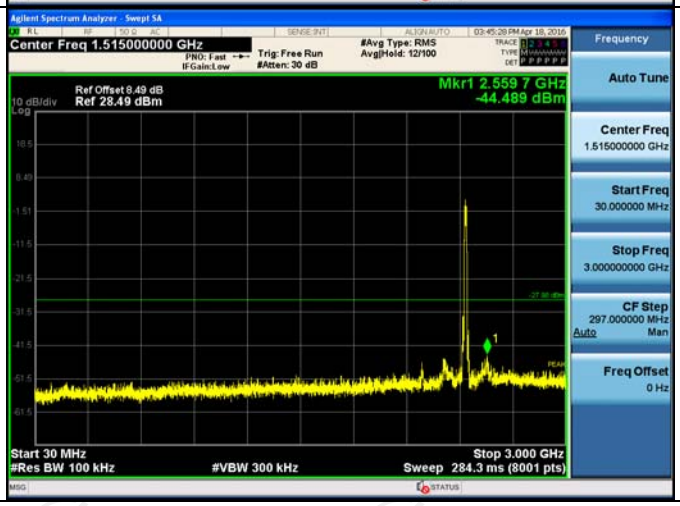
| 11B_LCH_Graphs | | |
|---|---|---|
| Pref/11B/LCH | |  |
| Puw/11B/LCH | |  |

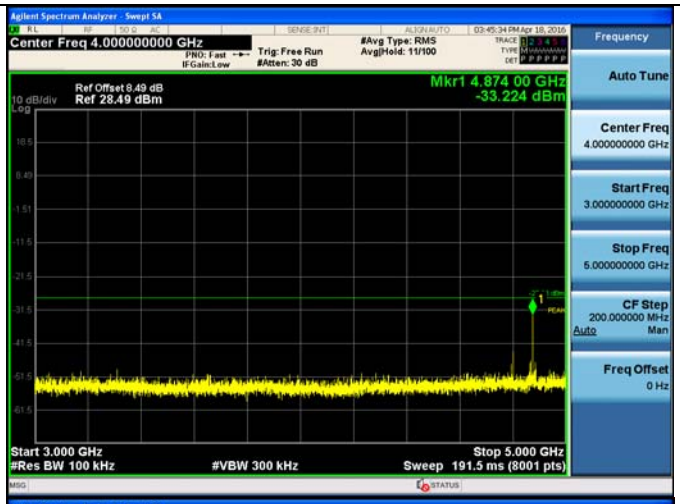

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 10/100
Mkr1 4.824 00 GHz
-33.544 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

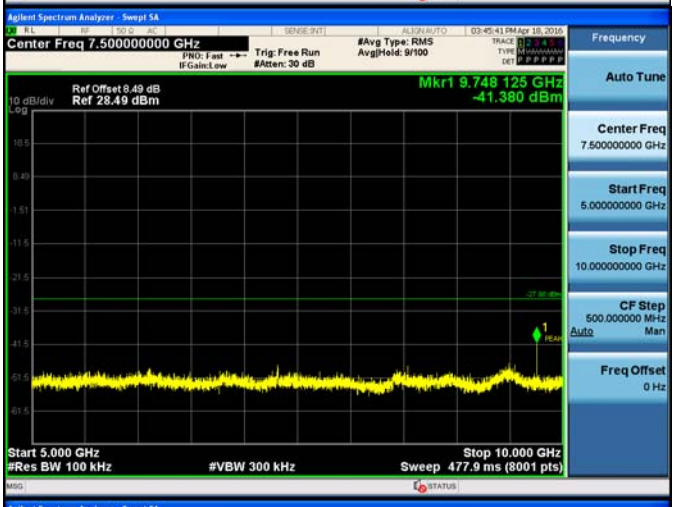

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Mkr1 9.648 125 GHz
-40.661 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

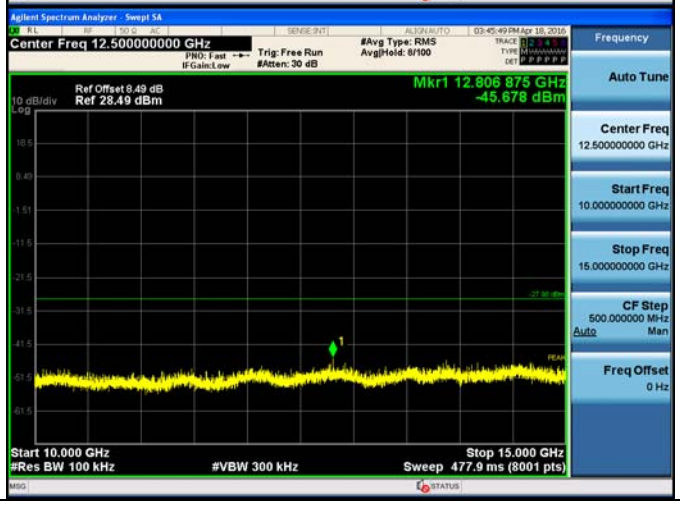

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Mkr1 14.221 875 GHz
-46.341 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | | |
|---|---|---|---|
| | |  | |

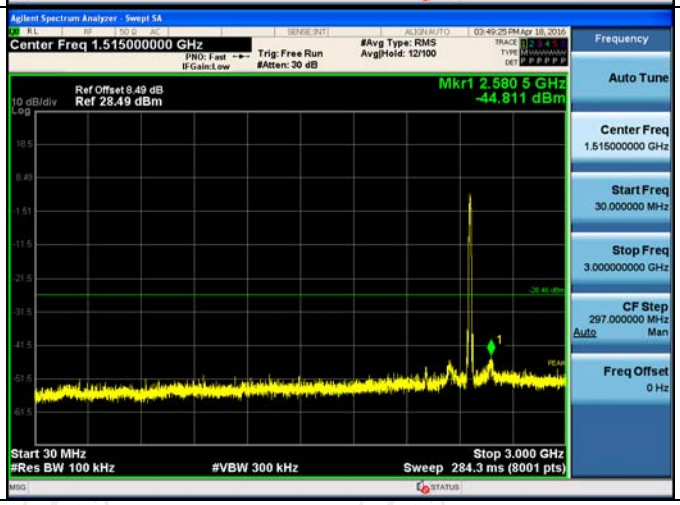
| 11B_MCH_Graphs | | | |
|---|---|---|---|
| Pref/11B/MCH | |  | |
| Puw/11B/MCH | |  | |

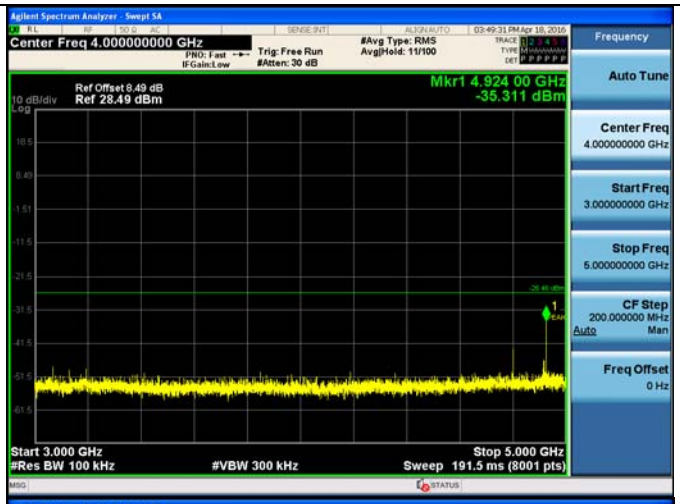

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.874 00 GHz
-33.224 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

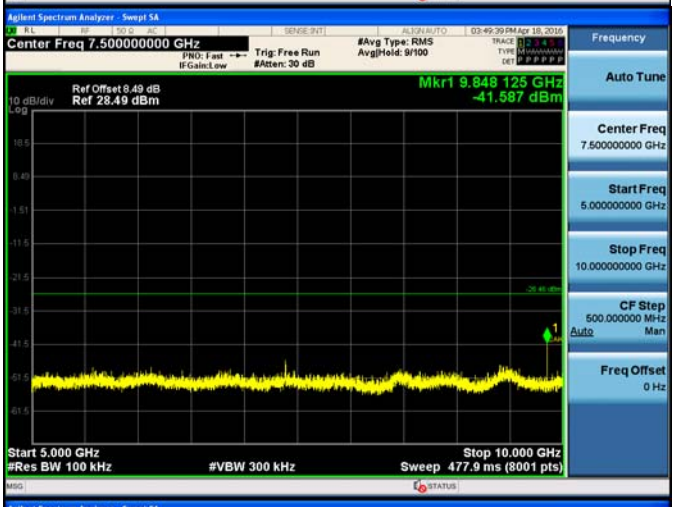

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.748 125 GHz
-41.380 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

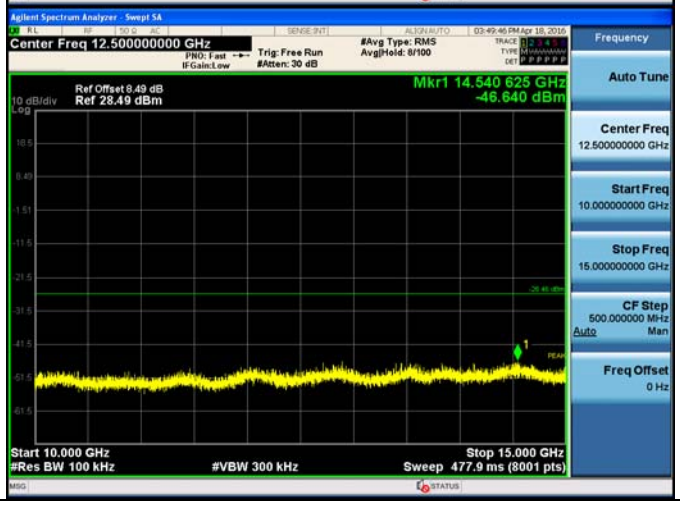

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 12.806 875 GHz
-45.678 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

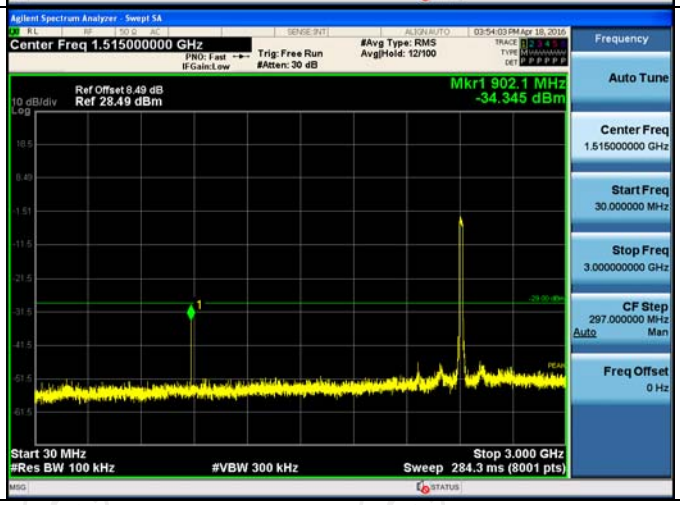
| 11B_HCH_Graphs | | |
|---|---|---|
| Pref/11B/HCH | |  |
| Puw/11B/HCH | |  |

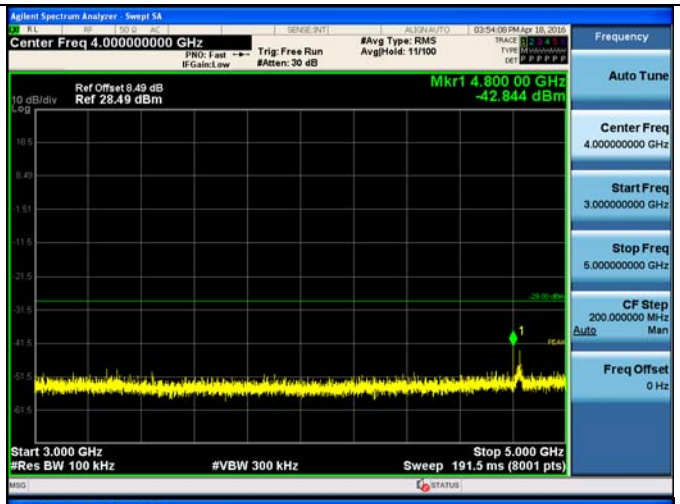

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.924 00 GHz
-35.311 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

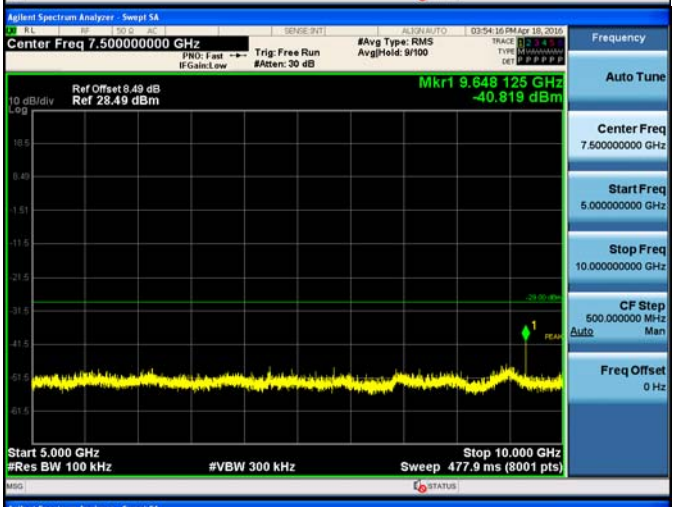

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.848 125 GHz
-41.587 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

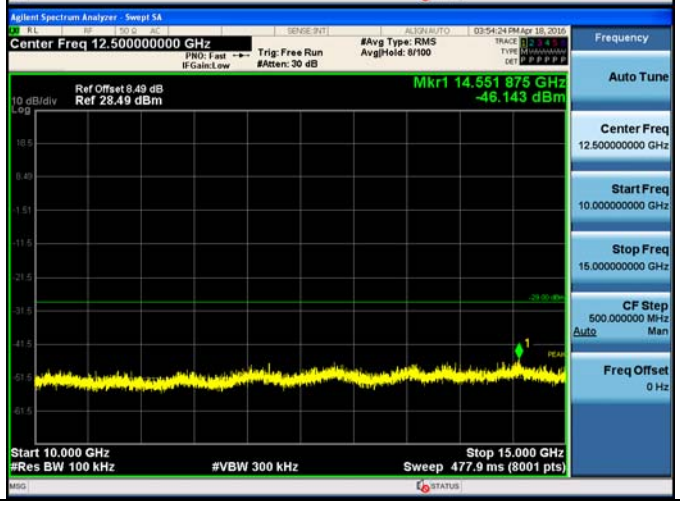

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 14.540 625 GHz
-46.640 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

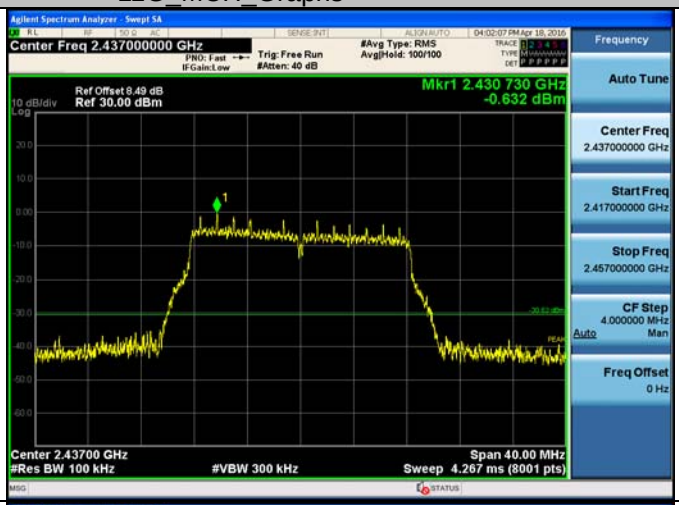
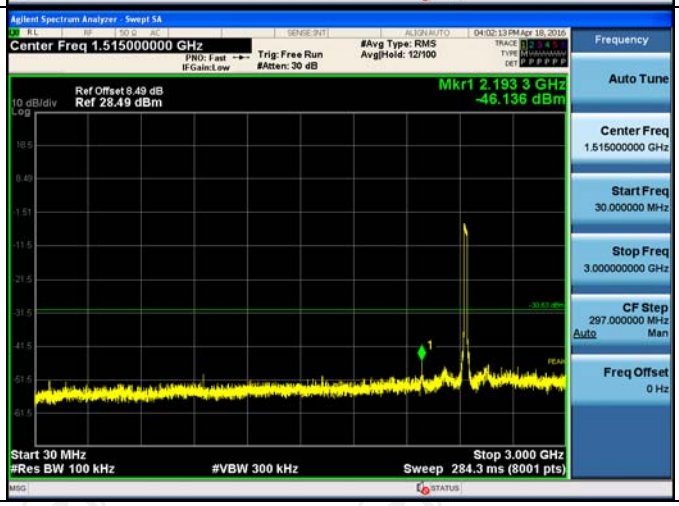
| 11G_LCH_Graphs | | |
|---|---|---|
| Pref/11G/LCH | |  |
| Puw/11G/LCH | |  |

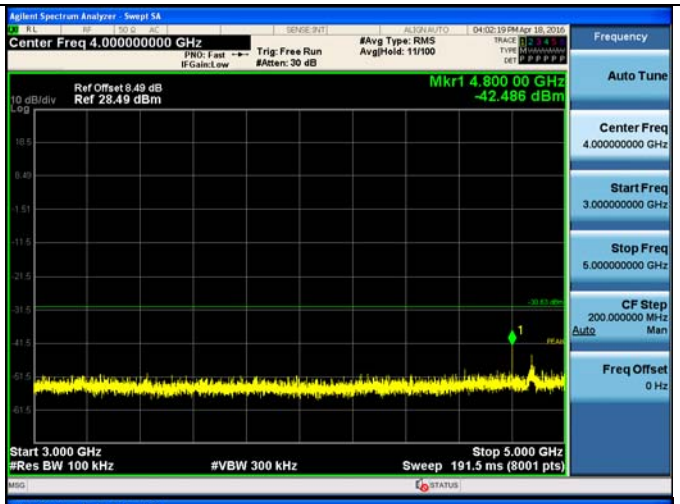

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.800 00 GHz
-42.844 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

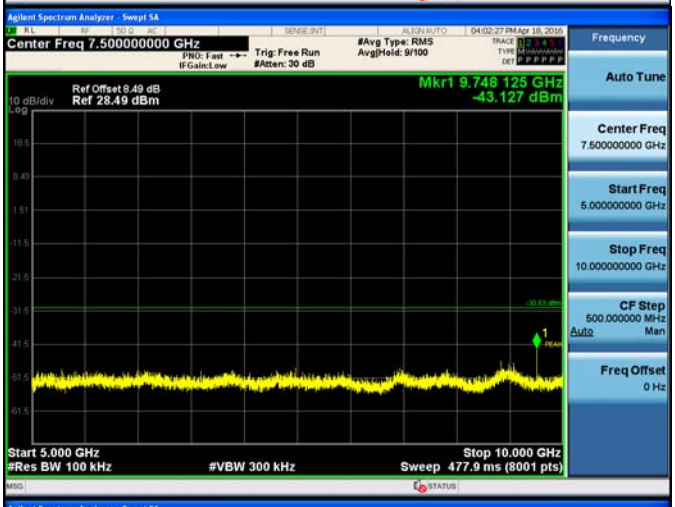

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.648 125 GHz
-40.819 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

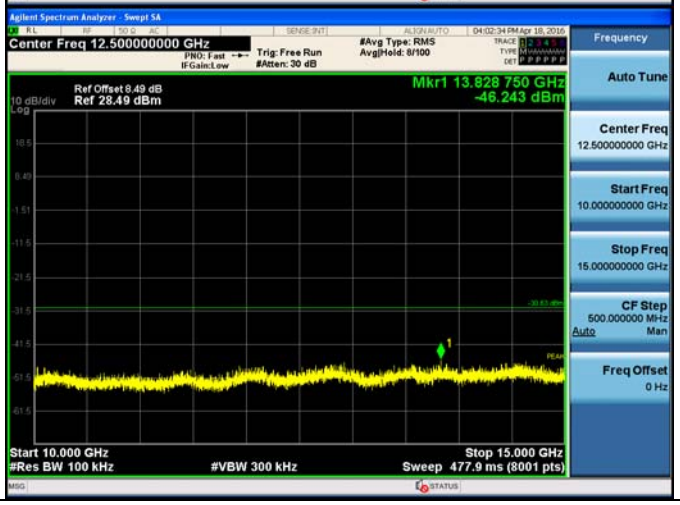

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 14.551 875 GHz
-46.143 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

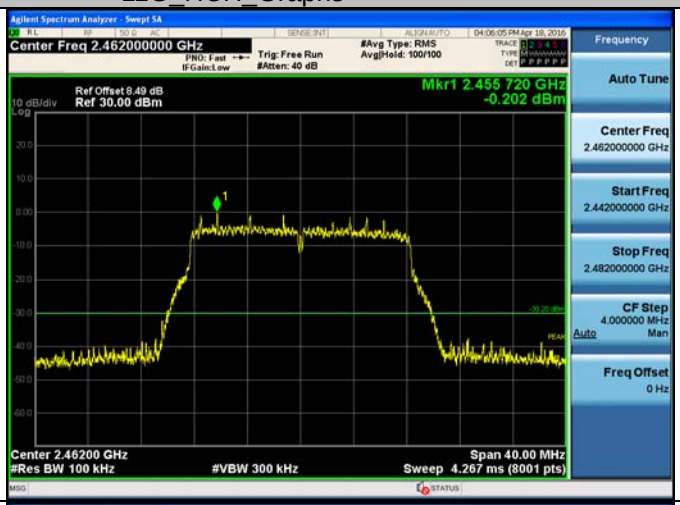
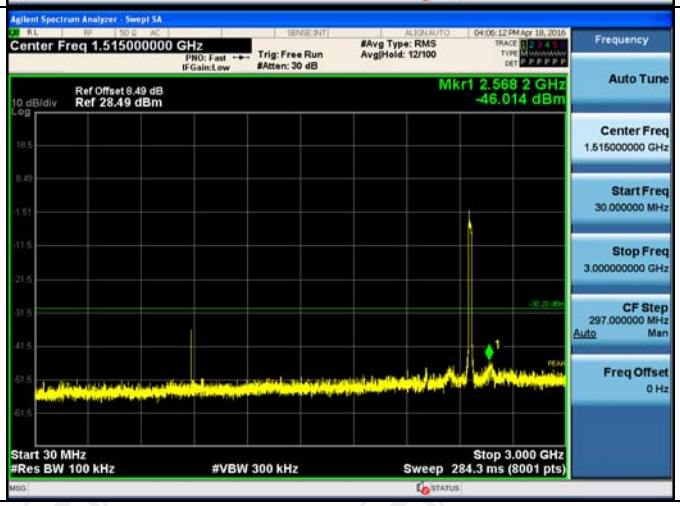
| 11G_MCH_Graphs | | |
|---|---|---|
| Pref/11G/MCH | |  |
| Puw/11G/MCH | |  |

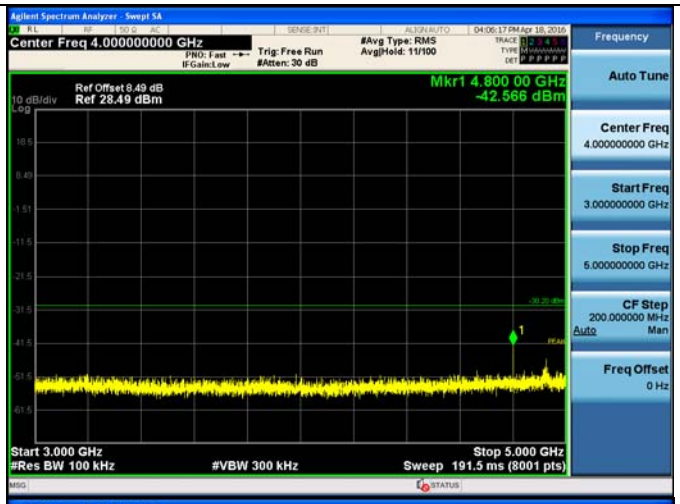

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Frequency
Auto Tune
Mkr1 4.800 00 GHz
-42.486 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)

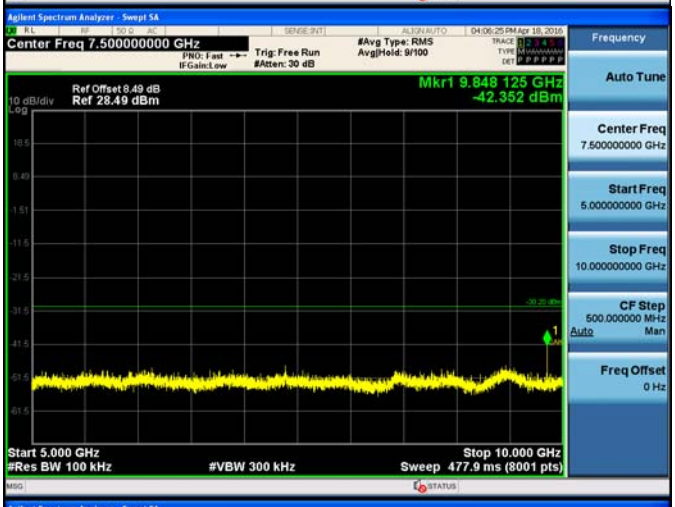

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Frequency
Auto Tune
Mkr1 9.748 125 GHz
-43.127 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)

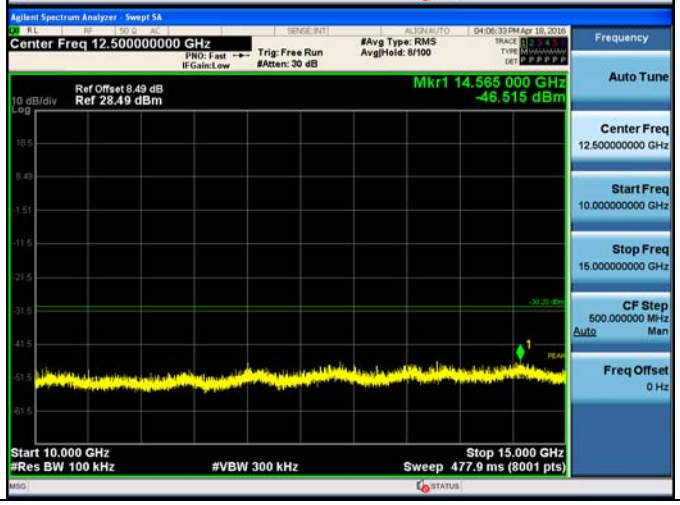

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Frequency
Auto Tune
Mkr1 13.828 750 GHz
-46.243 dBm
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)

| | | |
|---|---|---|
| | |  |

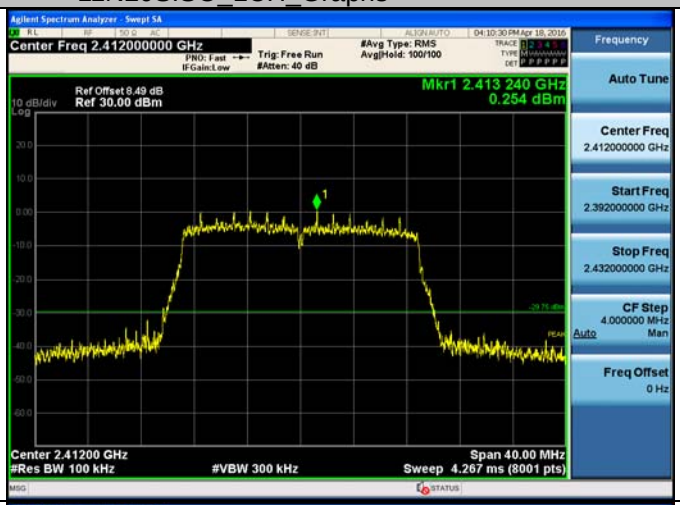
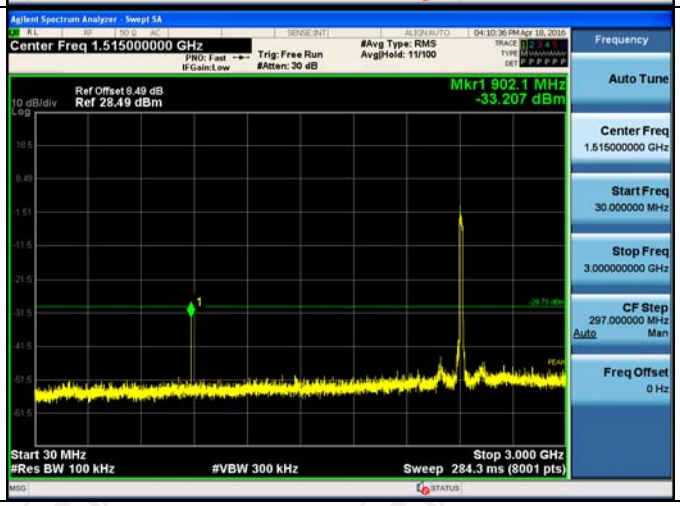
| 11G_HCH_Graphs | | |
|---|---|---|
| Pref/11G/HCH | |  |
| Puw/11G/HCH | |  |

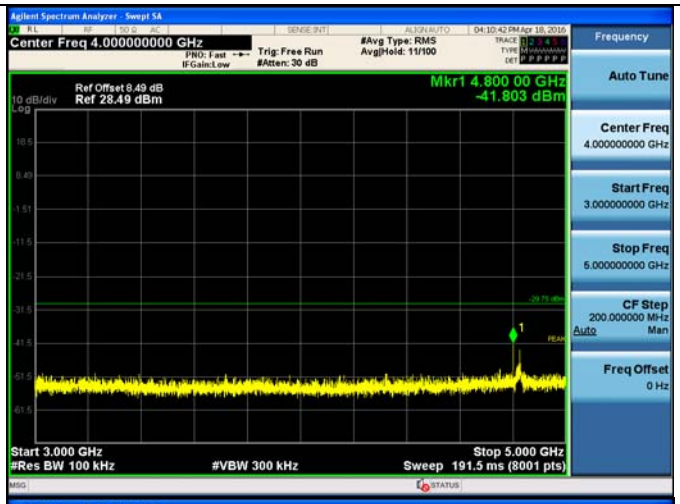

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.800 00 GHz
-42.566 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

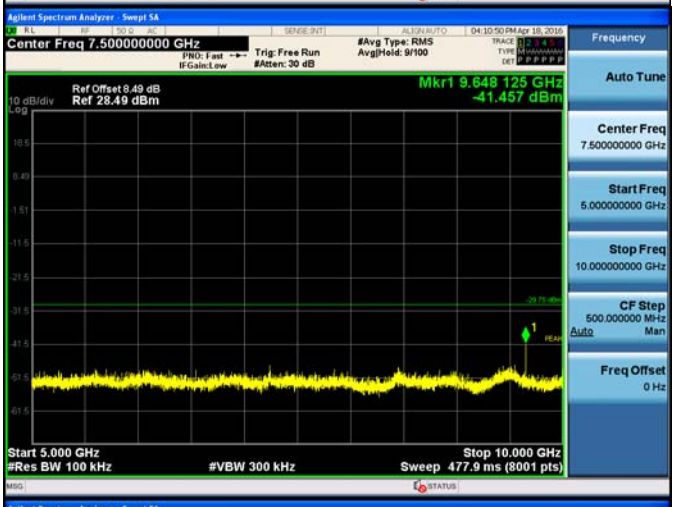

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.848 125 GHz
-42.352 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

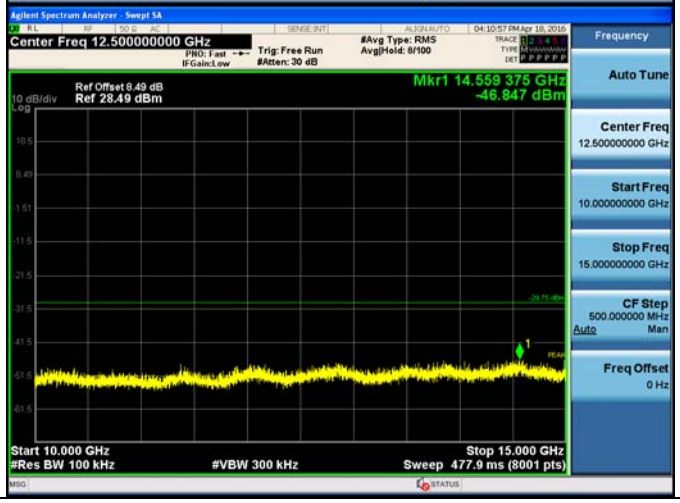

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 14.565 000 GHz
-46.515 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

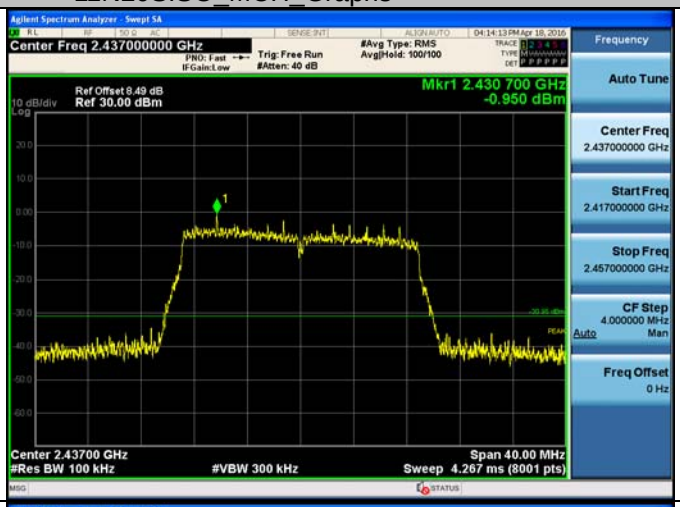
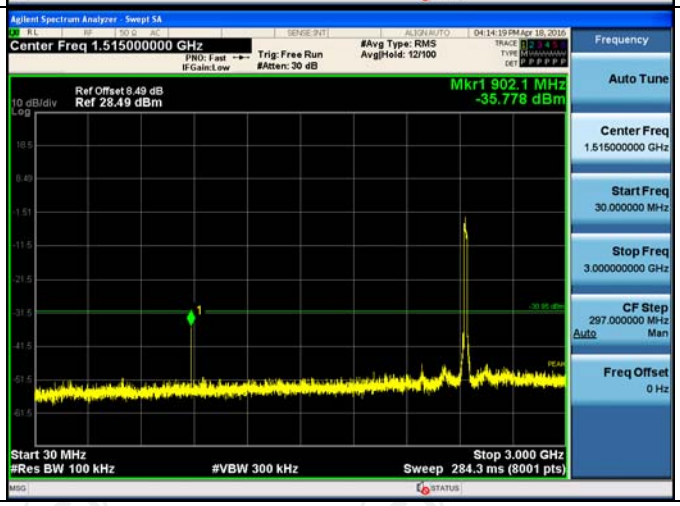
| 11N20SISO_LCH_Graphs | | |
|---|---|---|
| Pref/11N20SISO/LCH | |  |
| /11N20SISO/LCH | |  |

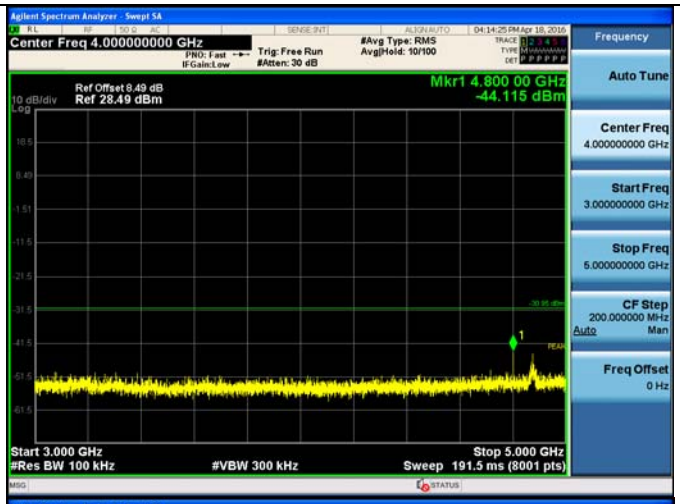

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 11/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.800 00 GHz
-41.803 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

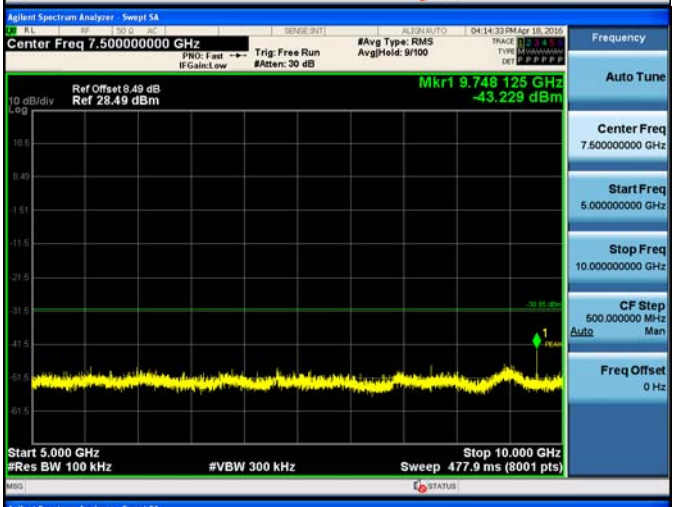

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.648 125 GHz
-41.457 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

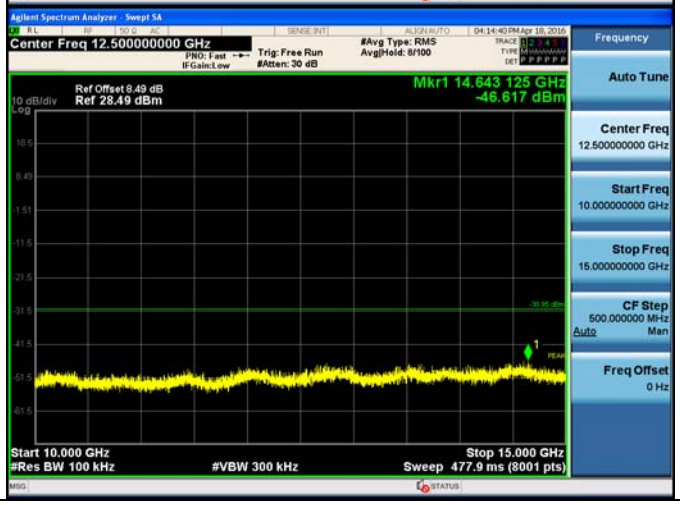

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 14.559 375 GHz
-46.847 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

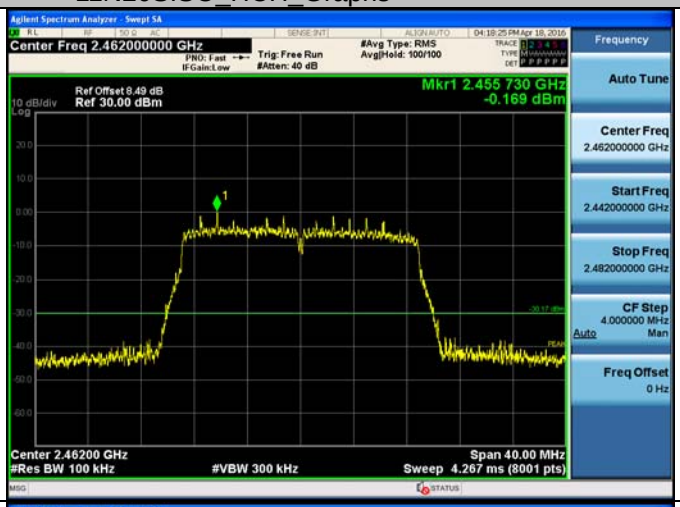
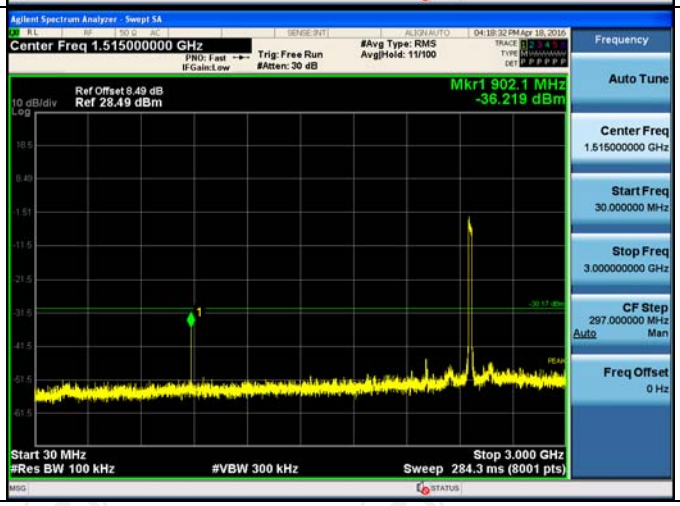
| 11N20SISO_MCH_Graphs | | |
|---|---|---|
| Pref/11N20SISO/MCH | |  |
| Puw/11N20SISO/MCH | |  |

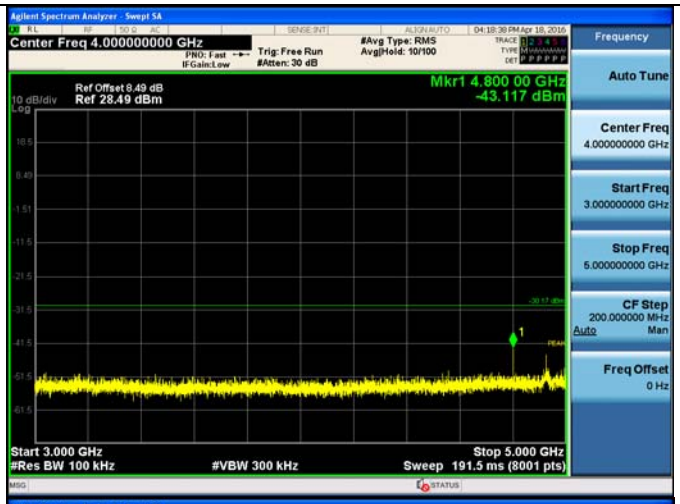

Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 10/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.800 00 GHz
-44.115 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz

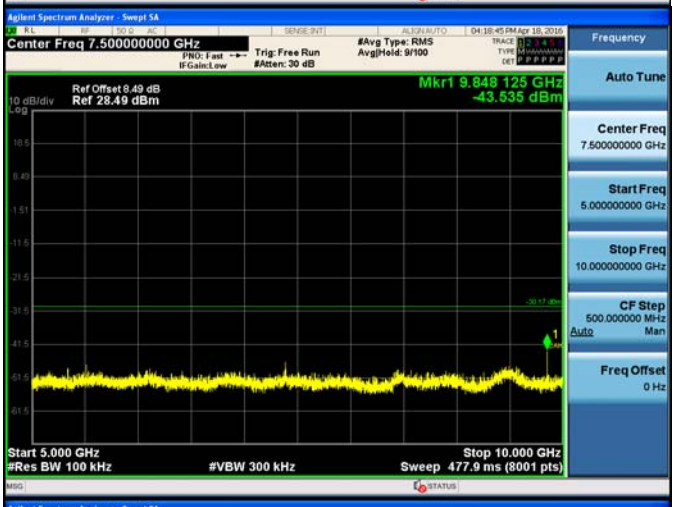

Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.748 125 GHz
-43.229 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

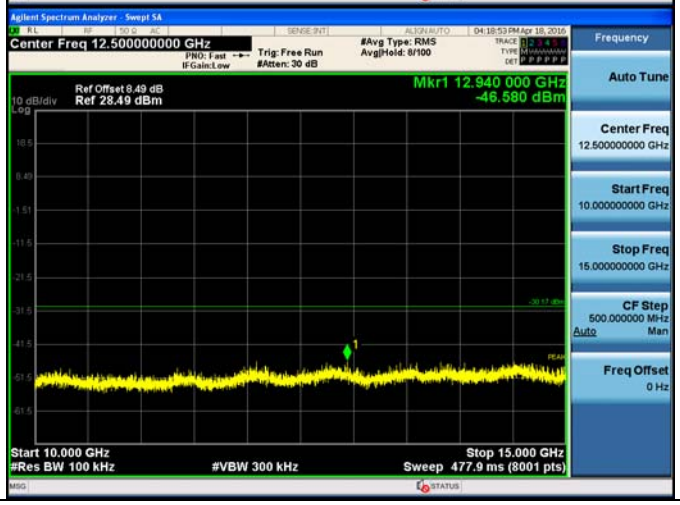

Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 14.643 125 GHz
-46.617 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | | |
|---|---|---|
| | |  |

| 11N20SISO_HCH_Graphs | | |
|---|---|---|
| Pref/11N20SISO/HCH | |  |
| Puw/11N20SISO/HCH | |  |


Agilent Spectrum Analyzer - Swept SA
Center Freq 4.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 10/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 4.800 00 GHz
-43.117 dBm
Start 3.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 5.000 GHz
Sweep 191.5 ms (8001 pts)
Frequency
Auto Tune
Center Freq
4.000000000 GHz
Start Freq
3.000000000 GHz
Stop Freq
5.000000000 GHz
CF Step
200.000000 MHz
Auto
Man
Freq Offset
0 Hz


Agilent Spectrum Analyzer - Swept SA
Center Freq 7.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 9/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 9.848 125 GHz
-43.535 dBm
Start 5.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 10.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
7.500000000 GHz
Start Freq
5.000000000 GHz
Stop Freq
10.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz


Agilent Spectrum Analyzer - Swept SA
Center Freq 12.500000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 30 dB
#Avg Type: RMS
Avg|Hold: 8/100
Ref Offset 8.49 dB
10 dB/div
Ref 28.49 dBm
Mkr1 12.940 000 GHz
-46.580 dBm
Start 10.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 15.000 GHz
Sweep 477.9 ms (8001 pts)
Frequency
Auto Tune
Center Freq
12.500000000 GHz
Start Freq
10.000000000 GHz
Stop Freq
15.000000000 GHz
CF Step
500.000000 MHz
Auto
Man
Freq Offset
0 Hz

| | |
|---|---|
| |  |

Agilent Spectrum Analyzer - Swept SA
Center Freq 20.000000000 GHz
PNO: Fast
IFGain:Low
Trig: Free Run
#Atten: 32 dB
#Avg Type: RMS
Avg|Hold: 4/100
Ref Offset 8.49 dB
10 dB/div
Ref 30.00 dBm
Mkr1 24.658 75 GHz
-37.333 dBm
Start 15.000 GHz
#Res BW 100 kHz
#VBW 300 kHz
Stop 25.000 GHz
Sweep 955.7 ms (8001 pts)
Frequency
Auto Tune
Center Freq
20.000000000 GHz
Start Freq
15.000000000 GHz
Stop Freq
25.000000000 GHz
CF Step
1.000000000 GHz
Auto
Man
Freq Offset
0 Hz

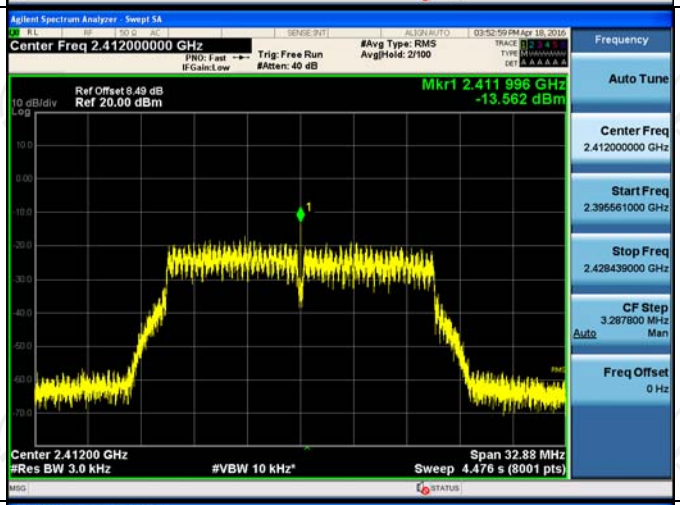
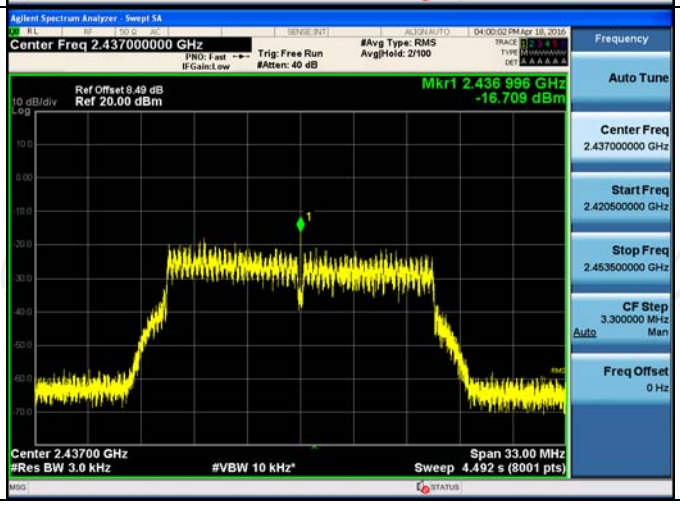
# Power Spectral Density

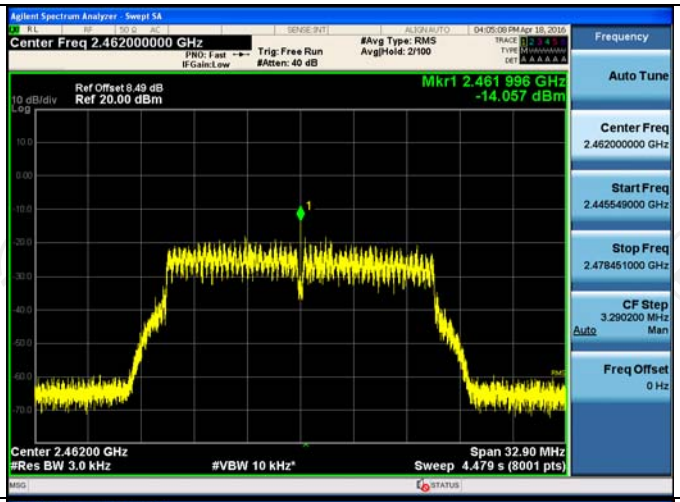
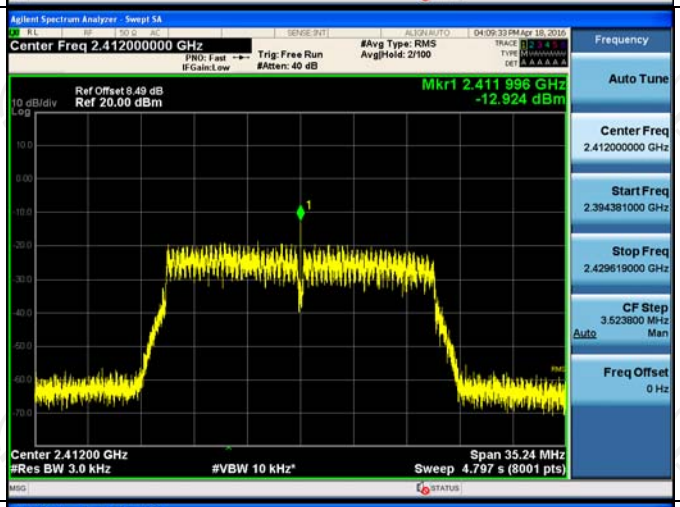
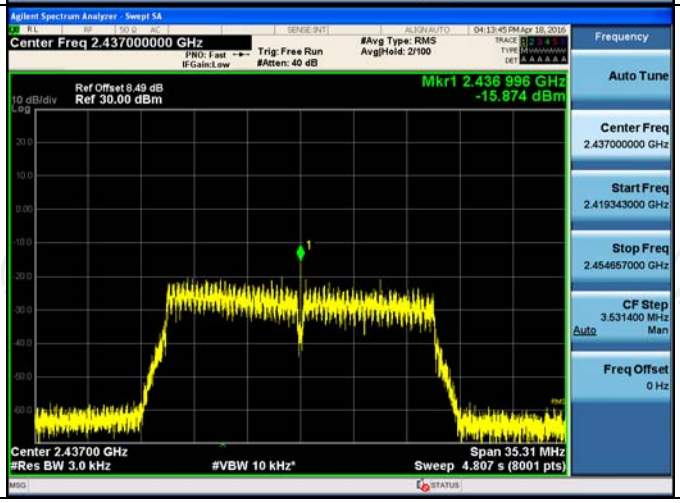
## Result Table

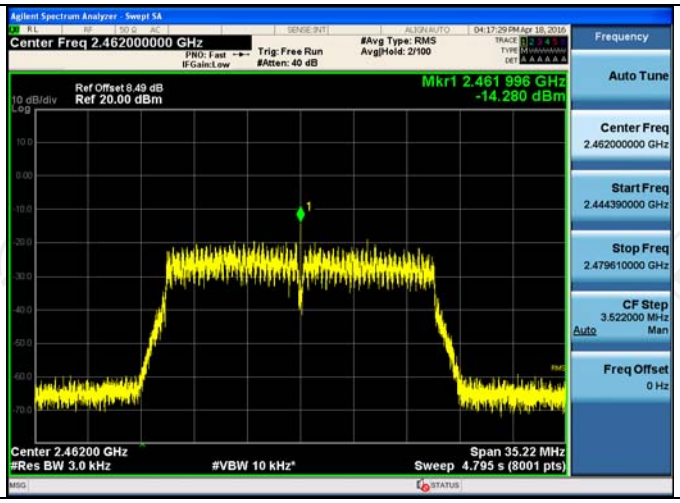
| Mode | Channel | Meas.Level [dBm] | Av.PSD [dBm] | Verdict |
|---|---|---|---|---|
| 11B | LCH | -13.187 | -13.187 | PASS |
| 11B | MCH | -14.701 | -14.701 | PASS |
| 11B | HCH | -14.142 | -14.142 | PASS |
| 11G | LCH | -13.562 | -13.562 | PASS |
| 11G | MCH | -16.709 | -16.709 | PASS |
| 11G | HCH | -14.057 | -14.057 | PASS |
| 11N20SISO | LCH | -12.924 | -12.924 | PASS |
| 11N20SISO | MCH | -15.874 | -15.874 | PASS |
| 11N20SISO | HCH | -14.280 | -14.280 | PASS |

## Test Graph

| Graphs | | | |
|---|---|---|---|
| 11B/LCH | |  | |
| 11B/MCH | |  | |

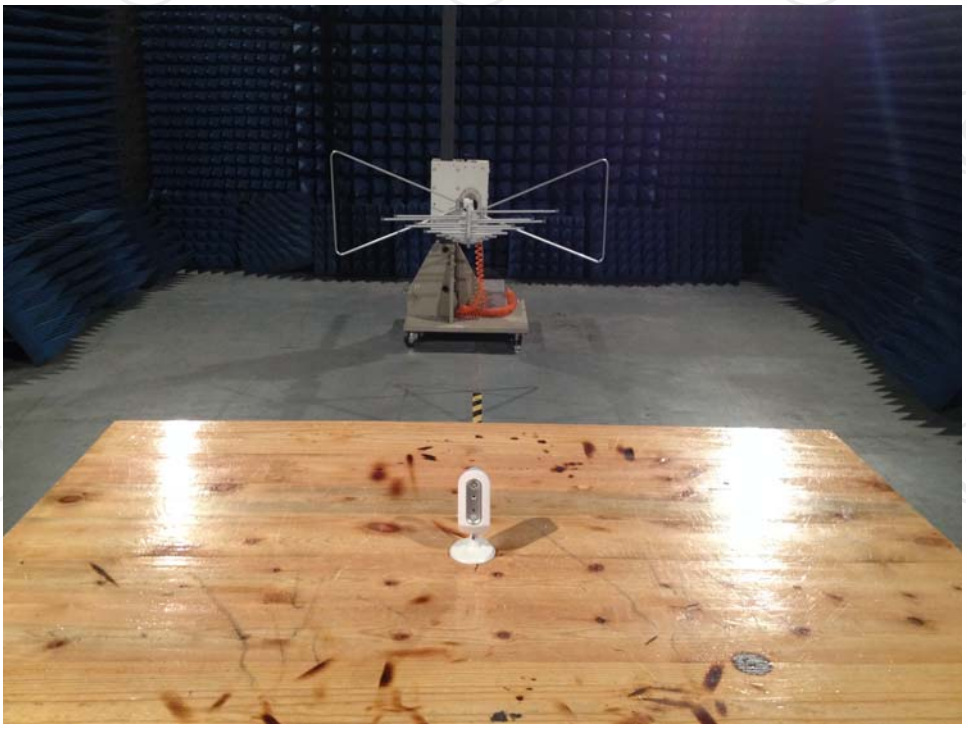
| | | | |
|---|---|---|---|
| 11B/HCH | |  | |
| 11G/LCH | |  | |
| 11G/MCH | |  | |

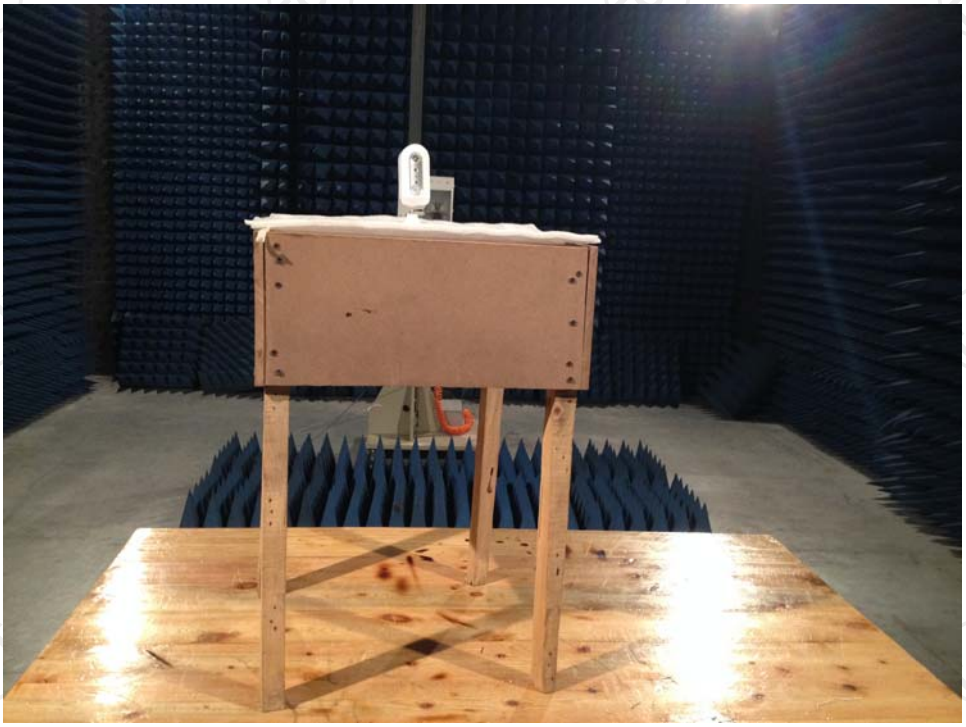
| | | | |
|---|---|---|---|
| 11G/HCH | |  | |
| 11N20SISO/LCH | |  | |
| 11N20SISO/MCH | |  | |

| | | | |
|---|---|---|---|
| 11N20SISO/HCH | |  | |

# Appendix B: Photographs of Test Setup

Radiated Emission







Hotline: 400-6611-140 Tel: 86-755-27673339 Fax: 86-755-27673332 http://www.tct-lab.com

CE



# Appendix C: Photographs of EUT
# Model: AWFB15
# External Photos







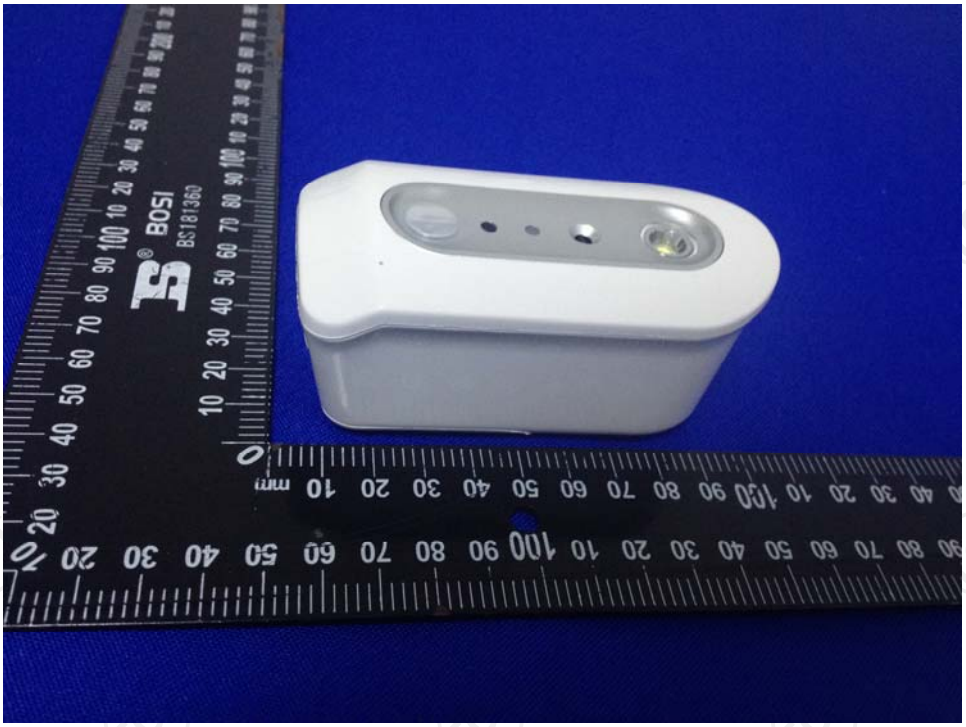
Hotline: 400-6611-140 Tel: 86-755-27673339 Fax: 86-755-27673332 http://www.tct-lab.com


BOSI
BS181360
I.T.E POWER
MADE IN CHINA


BOSI
BS181360
Ktec
AC ADAPTOR
MADE IN CHINA


BOSI
BS181360


BOSI
BS181360


BOSI
BS181360


BOSI
BS181360


BOSI
BS181360

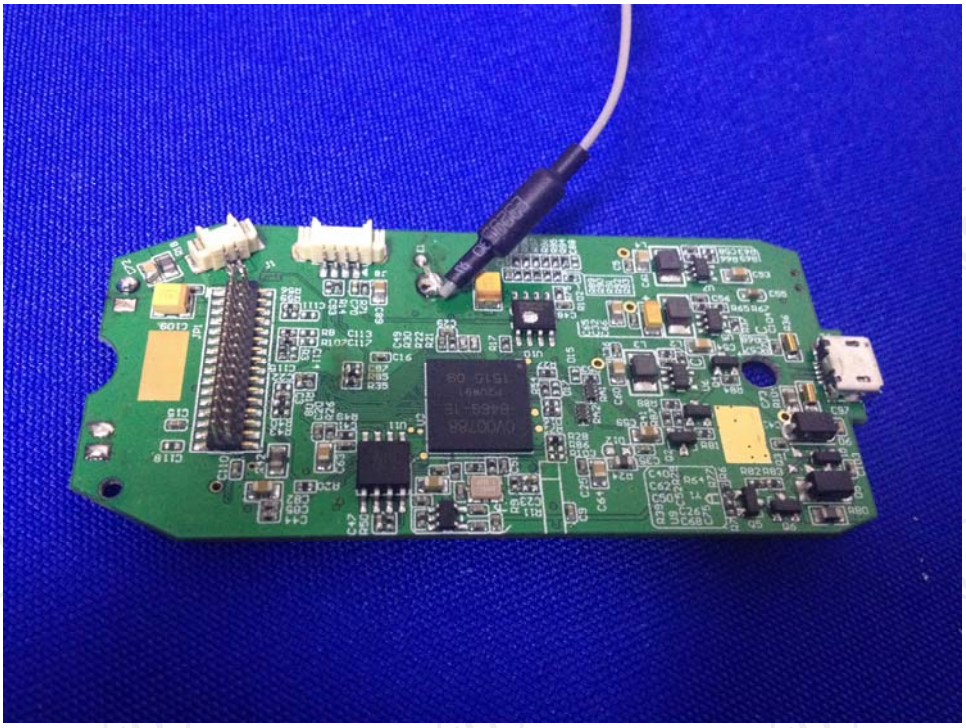
# Model: AWFB15
# Internal Photos

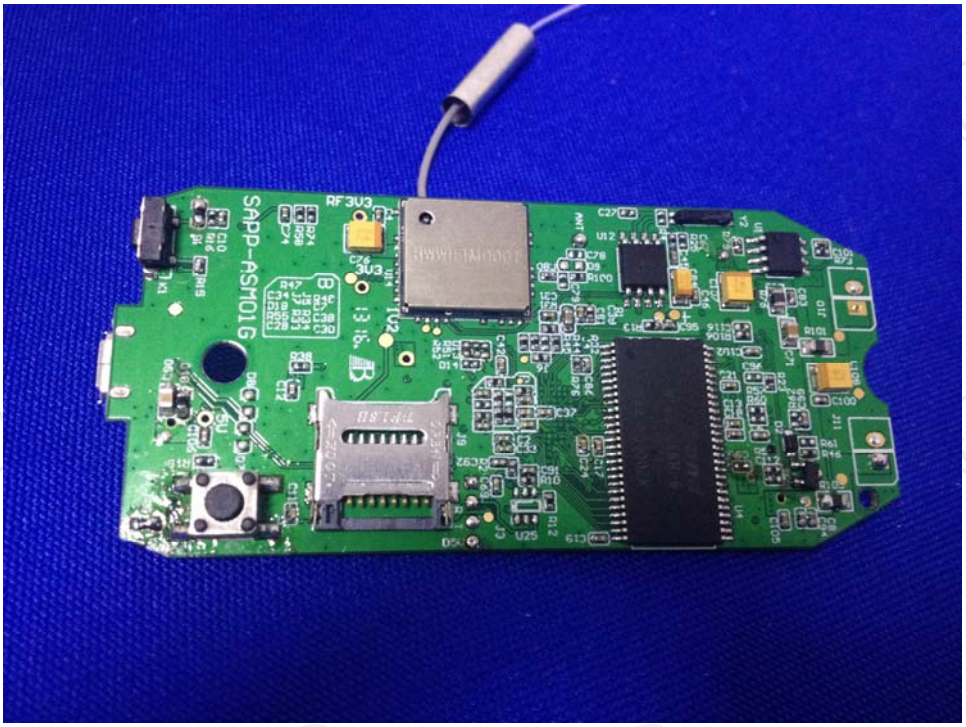






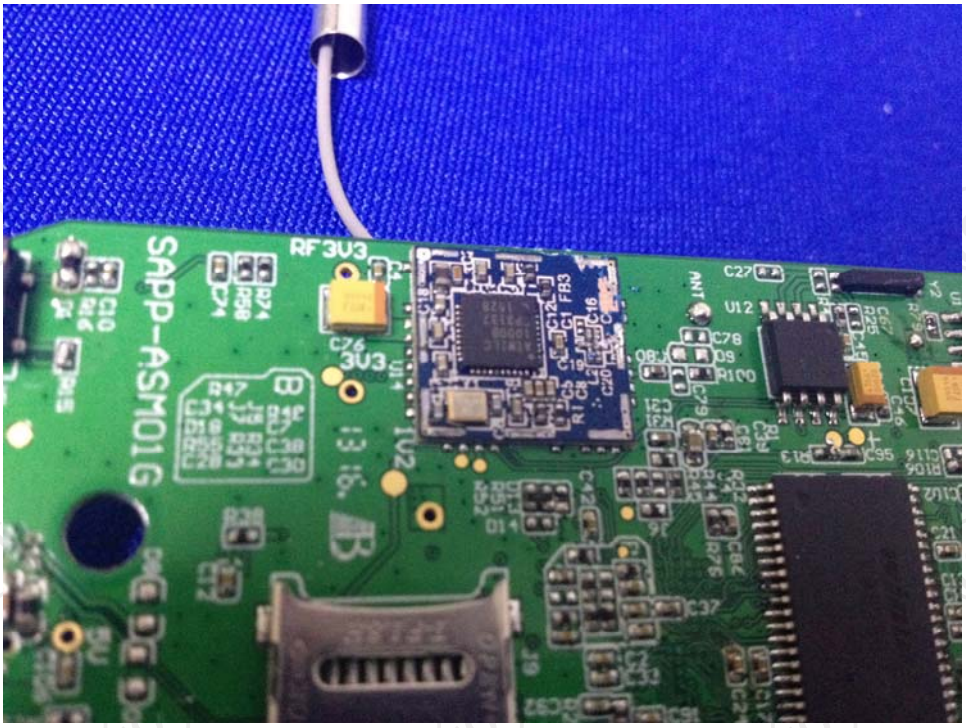
Hotline: 400-6611-140 Tel: 86-755-27673339 Fax: 86-755-27673332 http://www.tct-lab.com

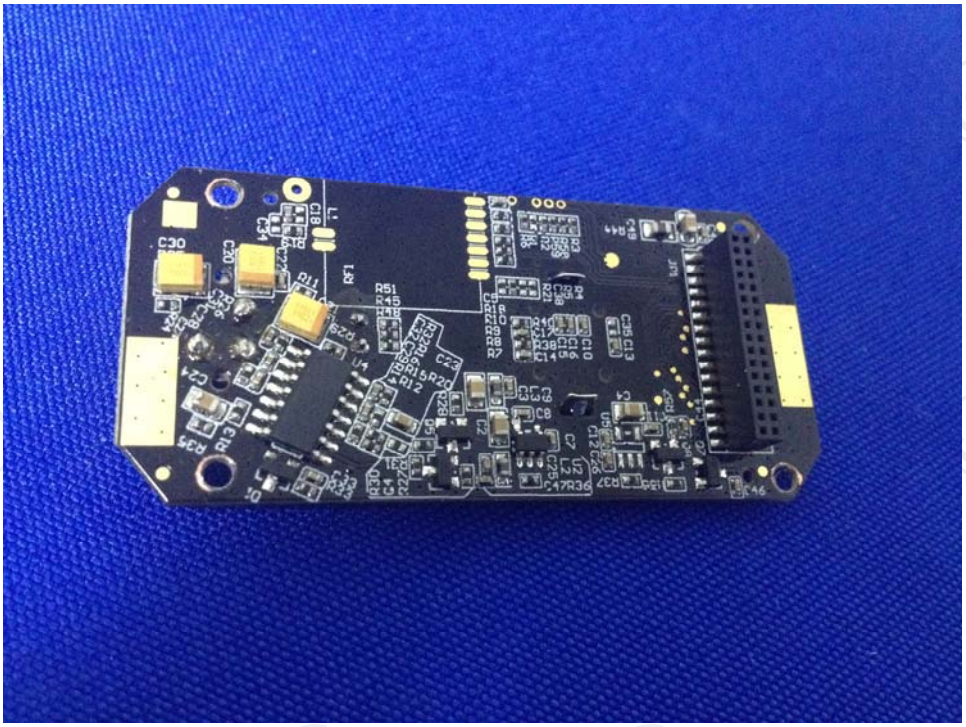


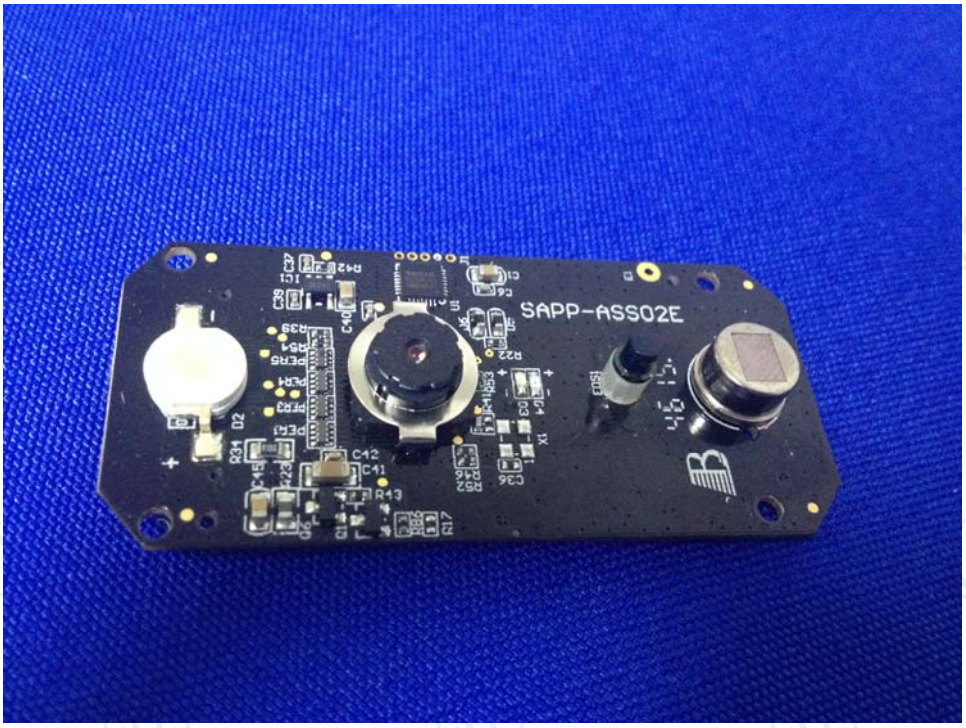





Hotline: 400-6611-140 Tel: 86-755-27673339 Fax: 86-755-27673332 http://www.tct-lab.com


SAPP-ASM01G
RF3V3
3V3







Hotline: 400-6611-140 Tel: 86-755-27673339 Fax: 86-755-27673332 http://www.tct-lab.com