




© 2018 Philips Lighting Holding B.V. All rights reserved.
Philips reserves the right to make changes in specifications and/or to discontinue any product at any time without notice or obligation and will not be liable for any consequences resulting from the use of this publication.
philips.com/easysense

Philips Lighting North America Corporation
10275 W. Higgins Road, Rosemont IL 60018
Tel: 800-322-2086 Fax: 888-423-1882
Customer/Technical Service: 800-372-3331
OEM Support: 866-915-5886

Philips Lighting Canada Ltd.
281 Hillmount Rd, Markham, ON, Canada L6C 2S3
Tel: 800-668-9008

PLt-17265QG_EasySense SNH200 QIG 04/18

Document #: 4422-107-07551 sh460 2018-04-12

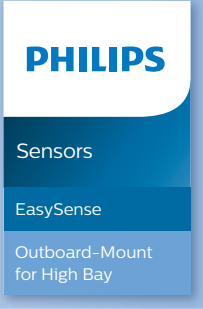

Philips EasySense Outboard-Mount for High Bay Quick Installation Guide

PLt-17265QG_EasySense SNH200 QIG 04/18

Document #: 4422-107-07551 sh460 2018-04-12


A connection between the sensor and the driver should be made according to local practices. The SR input wires of the EasySense for High Bay are not polarized for fixtures using one driver and one sensor, and therefore can be connected, without taking care of polarity, to the SR output of the driver – SR+ and SR- terminals. It is recommended to keep wire distance from sensor to driver less than 50 feet. Polarity must be maintained when connecting multiple drivers to one sensor. The wire strip length in case of sensor to driver connection is ~8mm.

Wire to driver connection


The wire strip length in case of a wire to wire connection is connector dependent.

SNH200 includes 18AWG wires, 60cm in length with 8mm strip length. A wire to wire connection can be made with connectors or wirenuts suitable for 18AWG solid wire.

Wire to wire connection

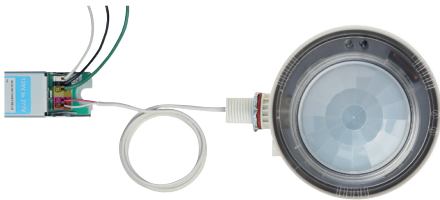

Note: Above depicts connecting wires from sensor to Titanium SR drivers that include connectors. For connection to Titanium SR drivers that include leads, use wirenuts suitable for 18AWG solid wire.

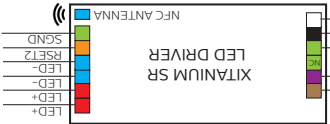

Wiring requirements

Compatible LED drivers


Commercial Product Name	Order Code
EasySense Outboard-Mount for High Bay	SNH200

Sensor part number

Driver Model Number	Description
XI040C110V054VPT1	Xtitanium 40W 0.1-1.1A 27-54V 120-277V SR
XI075C200V054VPT1	Xtitanium 75W 0.1-2.0A 27-54V 120-277V SR
XI075C070V118VSY1	Xtitanium 75W 0.07-0.70A 43-118V 120-277V SR with AUX
XI075C105V079VSY1	Xtitanium 75W 0.105-1.05A 32-79V 120-277V SR with AUX
XI095C275V054VPT1	Xtitanium 95W 0.03-2.75A 27-54V 120-277V SR
XI095C275V054VST1	Xtitanium 95W 0.03-2.75A 27-54V 120-277V SR with AUX
XI150C070V235VST1	Xtitanium 150W 0.07-0.70A 78-235V 120-277V SR with AUX
XI150C105V157VST1	Xtitanium 150W 0.105-1.05A 44-157V 120-277V SR with AUX

Specifications available at www.philips.com/xitaniumsr/na.

Sensor Dimensions, mm [in]

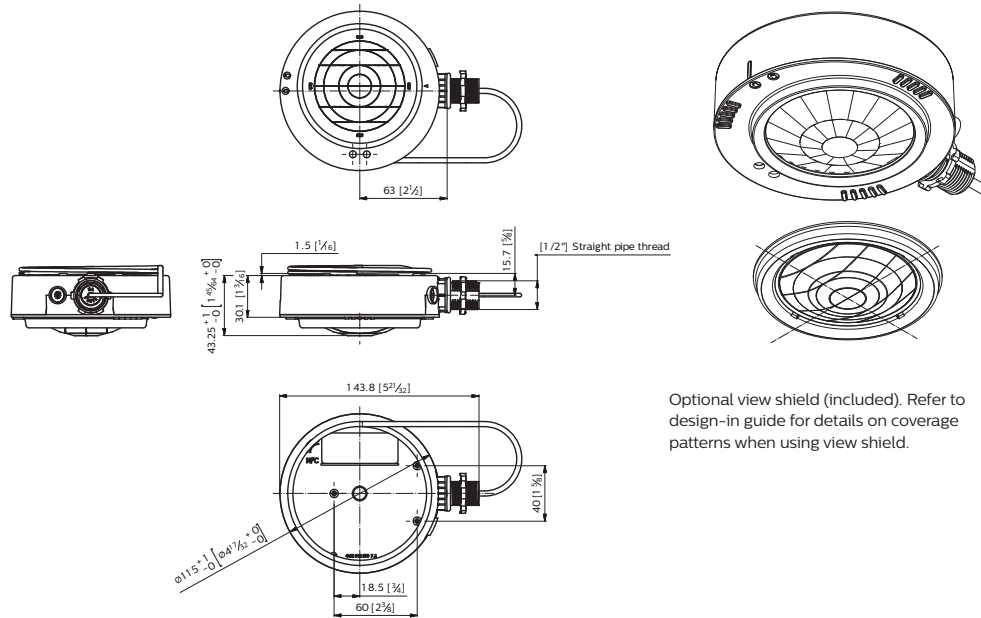


Mounting in a Luminaire

EasySense for High Bay is intended to be mounted to a standard 1/2" knockout available on the luminaire itself or a junction box. A washer and locknut are included with the sensor for this purpose. An OEM can develop custom brackets to attach to the top surface of the sensor in case the sensor needs to be mounted to a curved/non-flat surface. Mounting screws are provided with the sensor for this purpose. These screws are matched to the thickness of the plastic sensor housing. In case other screws are used, ensure that they do not protrude through the sensor plastics. Also make sure that the view of the sensor is not blocked anywhere by the luminaire or the bracket to avoid loss of functionality.

Occupancy Sensing Coverage Pattern

Based on 16m mounting height

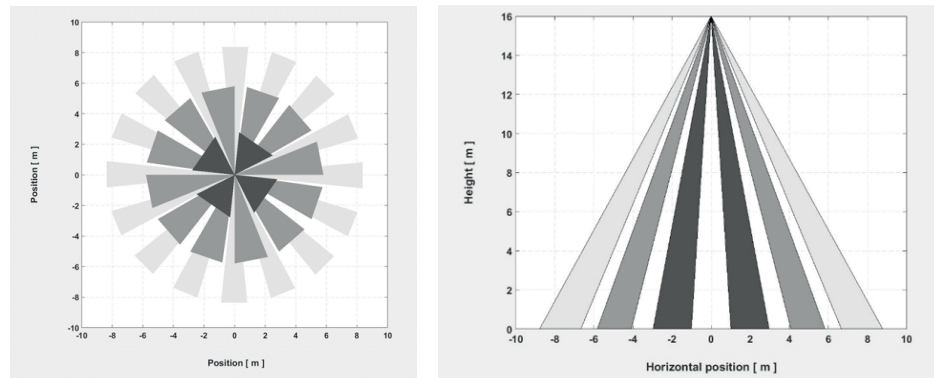



Daylight Sensor

The light sensor measures the total amount of light in a circular field of ≈80% of the PIR detection area. The following aspects should be observed during installation:

- Minimum distance from the window $\geq 2.0/0.6\text{m}$.
- Prevent light reflections from outside entering the sensor (for example sunlight reflection on a car bonnet) as this will lead to incorrect light regulation.

As a guideline the formula $0.72 \times H$ can be used to calculate the minimum distance between the window and sensor whereby H is the height from the bottom of the window to the ceiling.

Photosensor spatial response

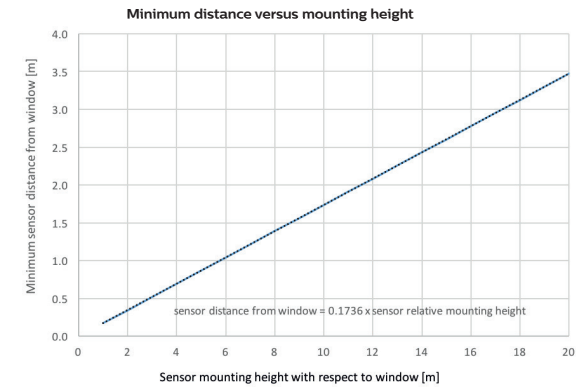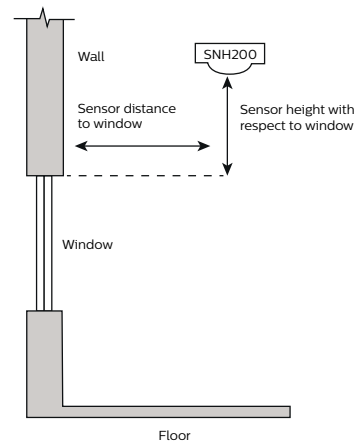

Note: Restrictions only for daylight regulation. No restrictions for skylights.

Configuration via Mobile App

Note: Use of IR requires a specific IR dongle from Philips to configure and group from floor level. Consult your Philips representative.

EasySense parameters can be configured via Philips field apps available for Android phones. Two options are available:

- EasySense NFC – This app allows configuring EasySense parameters only when you can physically access the sensor with a smartphone.
- EasySense Industry IR – This app allows configuring EasySense parameters plus enables grouping to a wireless switch, which can be done with an Android phone and a specific IR dongle from Philips.

You must first register for Philips field apps to receive a username and password, then download Philips field apps from the Google Play Store. Refer to www.philips.com/easysense for details, including applicable Android phones and user manuals.

FCC and IC Statement This device complies with part 15 of the FCC rules for the United States and Industry Canada (IC) license-exempt RSS standard(s). Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation. Any changes or modifications not expressly approved by Philips could void the user's authority to operate this equipment. This product is intended for commercial use only.

This equipment should be installed and operated with a minimum distance of 20cm between the radiator and your body.

Déclaration De Conformité À La Fcc/Ic Ce dispositif est conforme à la partie 15 des règles de la Federal Communications Commission (FCC) des États-Unis et d'Industrie Canada (IC) exempts de licence RSS norme(s). Son fonctionnement est assujéti aux deux conditions suivantes : (1) Ce dispositif ne doit pas provoquer de brouillage préjudiciable, et (2) il doit accepter tout brouillage reçu, y compris le brouillage pouvant entraîner un mauvais fonctionnement. Tous les changements ou modifications non expressément approuvés par Philips, sont susceptibles d'annuler le droit de l'utilisateur à se servir de cet équipement. Ce produit est exclusivement destiné à un usage commercial.

Cet équipement doit être installé et utilisé avec une distance minimale de 20 cm entre le radiateur et votre corps.