

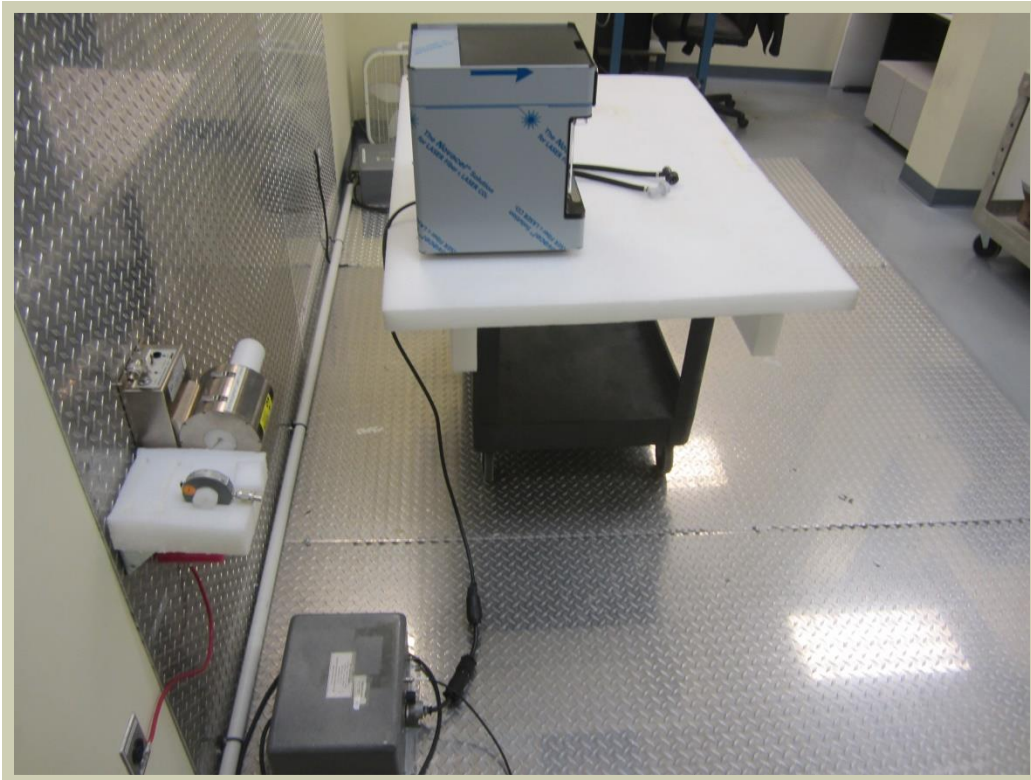




AC - POWERLINE CONDUCTED EMISSIONS

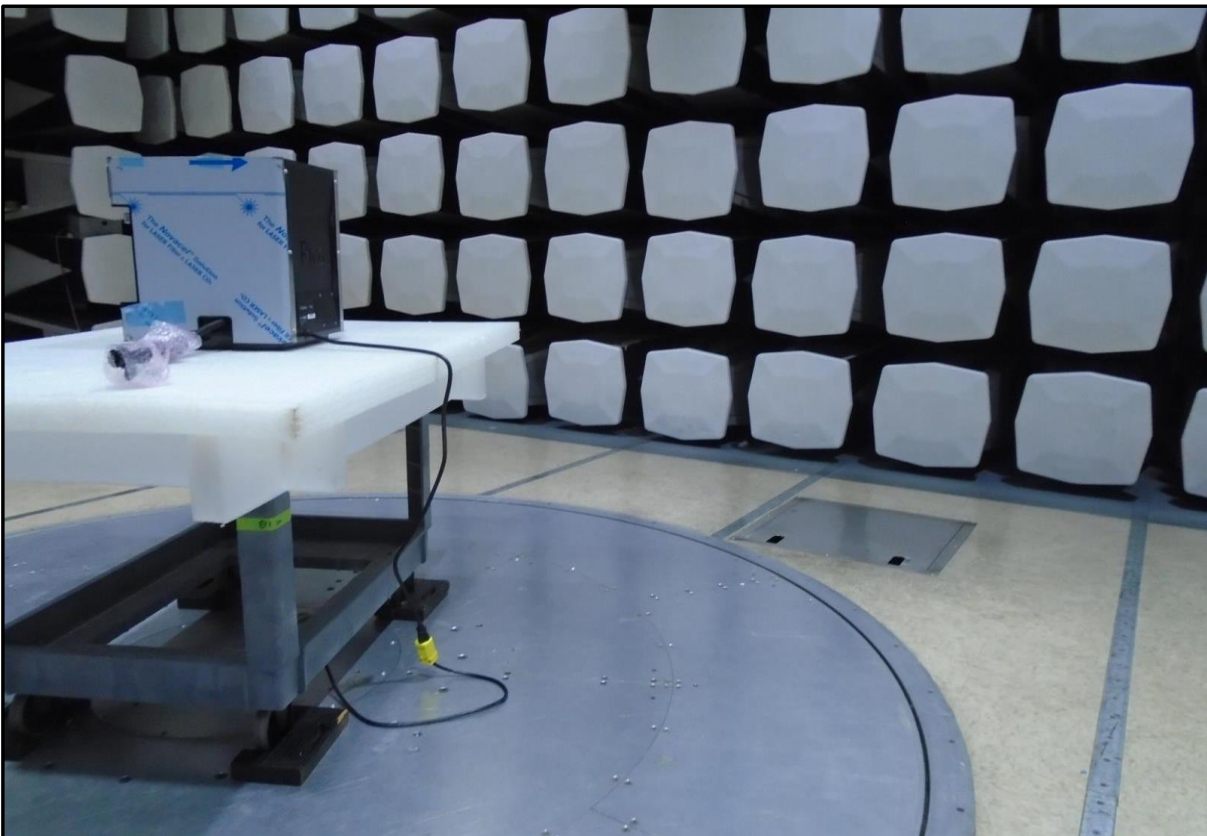

FIELD STRENGTH OF FUNDAMENTAL


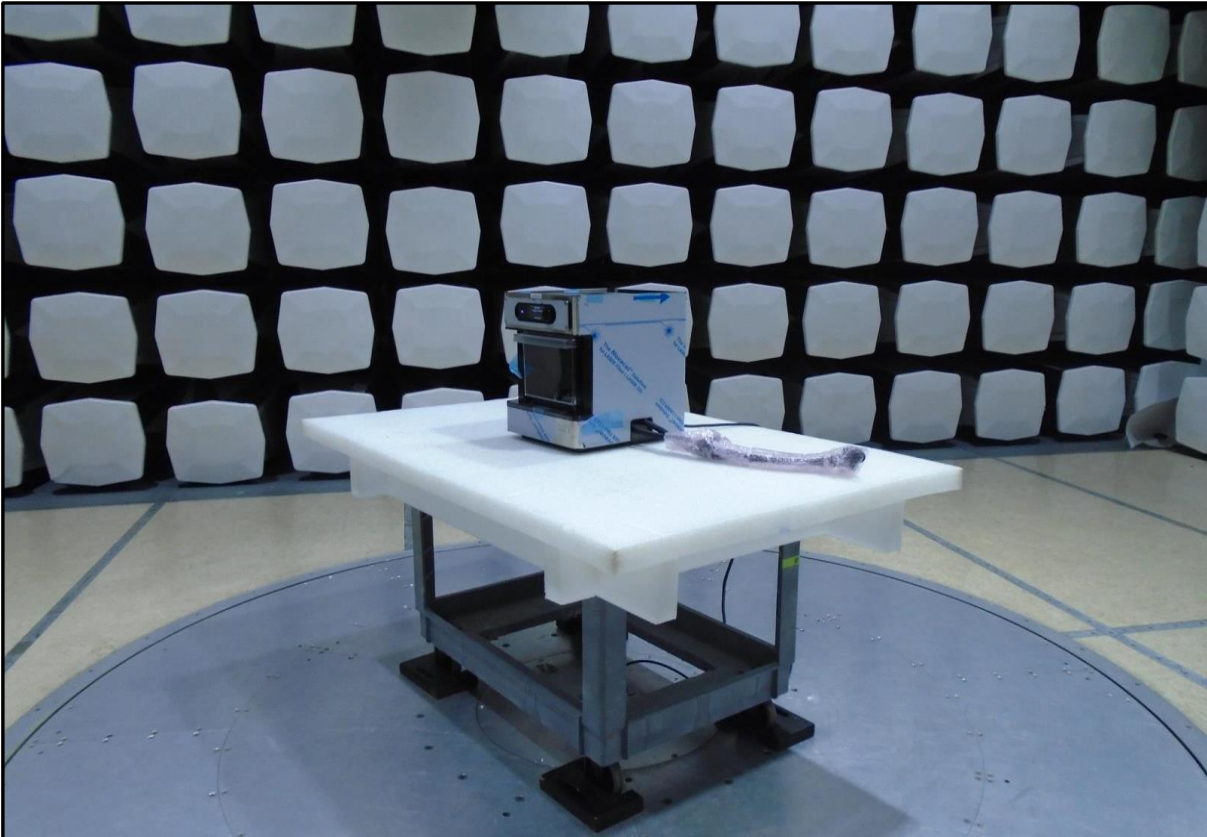


FIELD STRENGTH OF FUNDAMENTAL

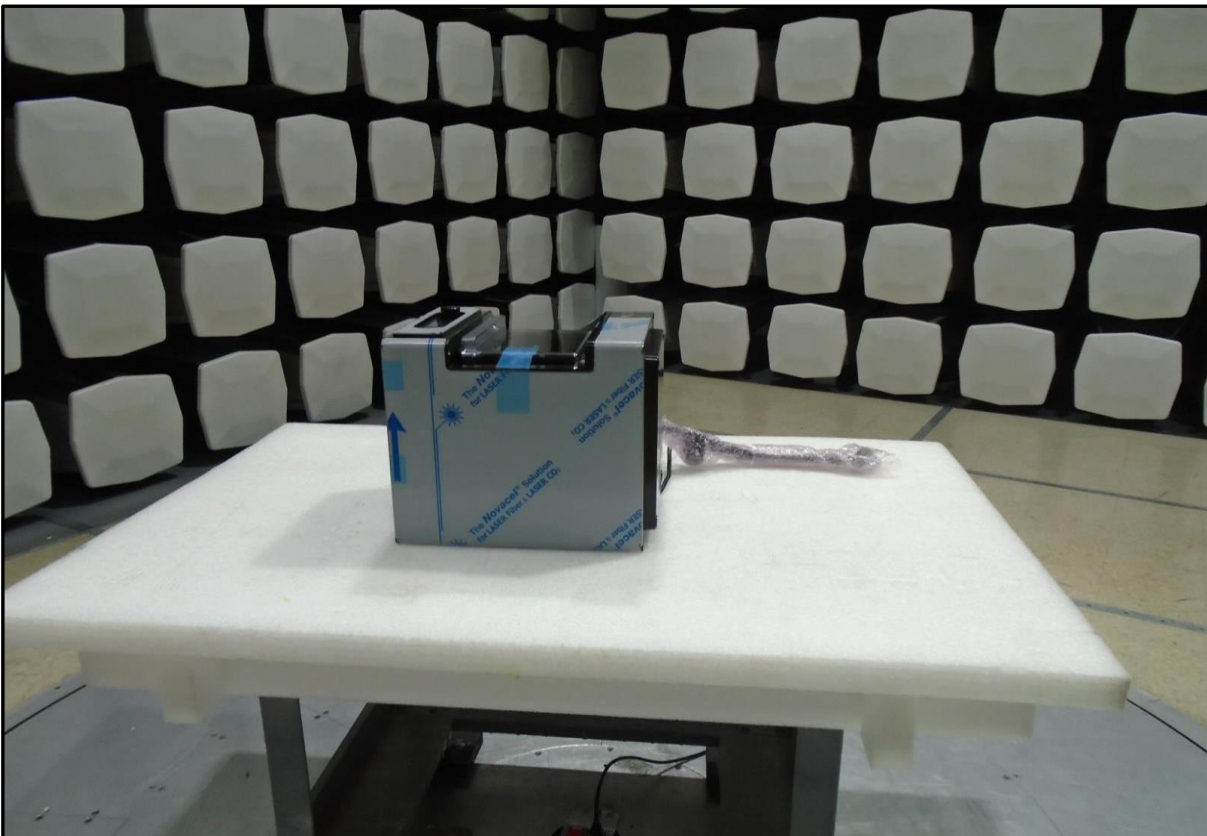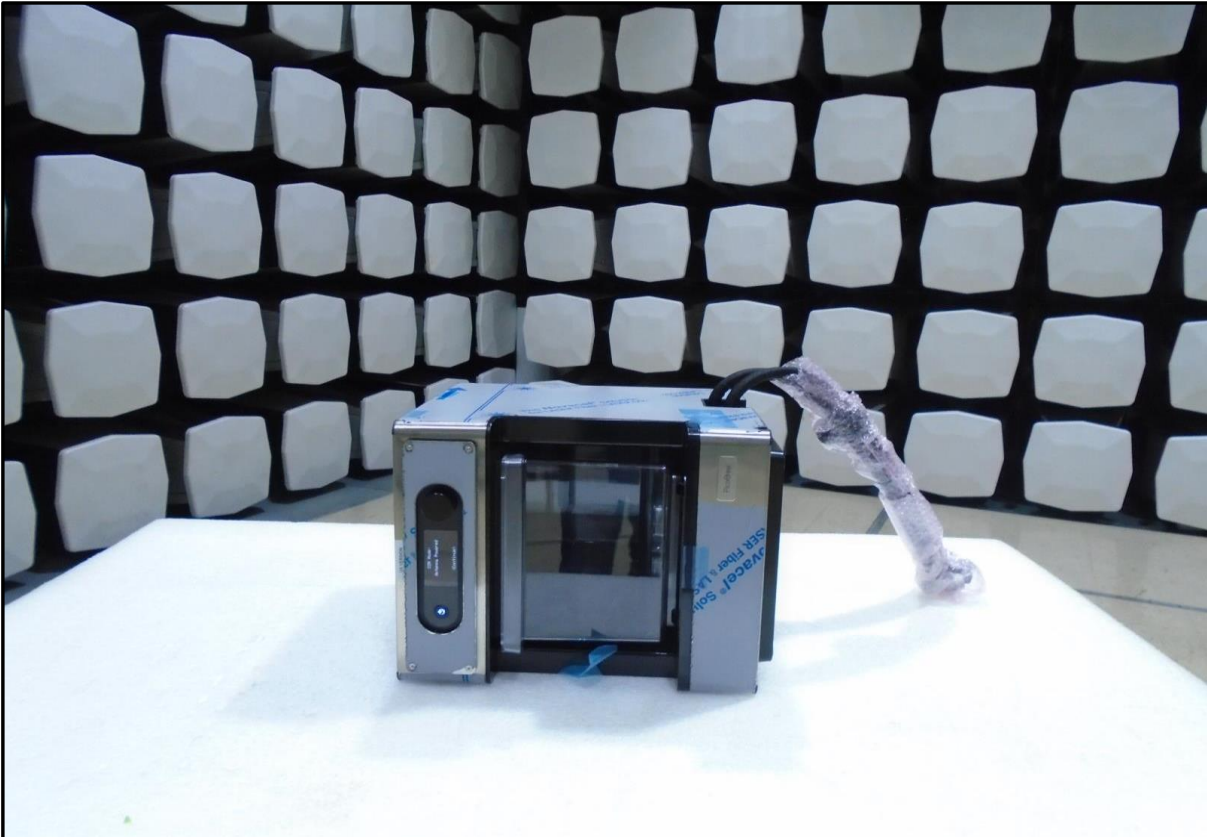


FIELD STRENGTH OF SPURIOUS EMISSIONS GREATER THAN 30MHz

**NORTHWEST
EMC**
PSA-ESCI 2016.07.22

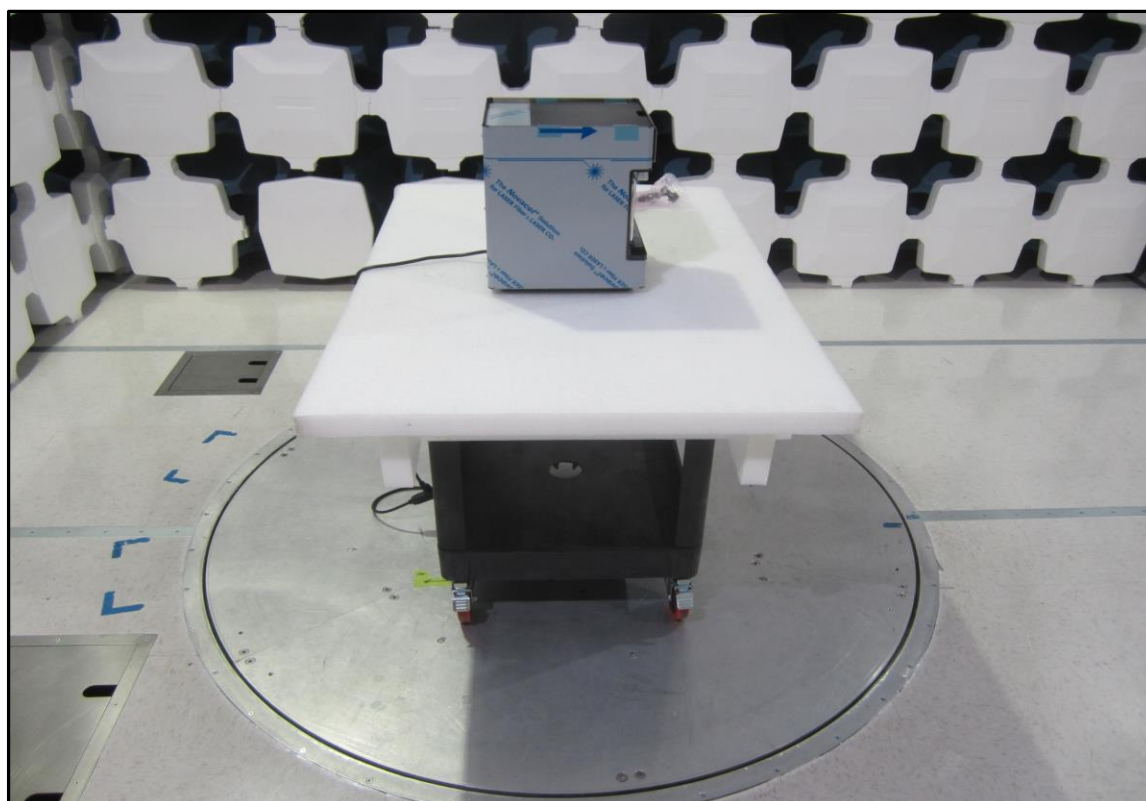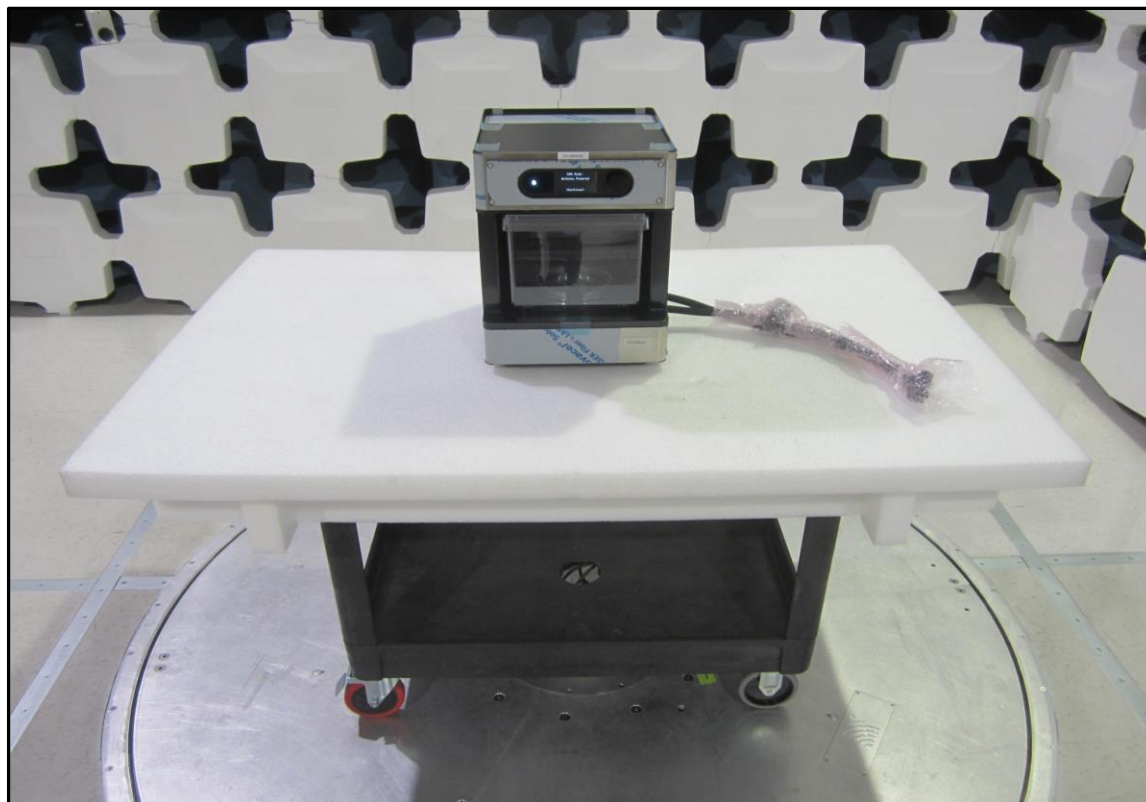

FIELD STRENGTH OF SPURIOUS EMISSIONS GREATER THAN 30MHz

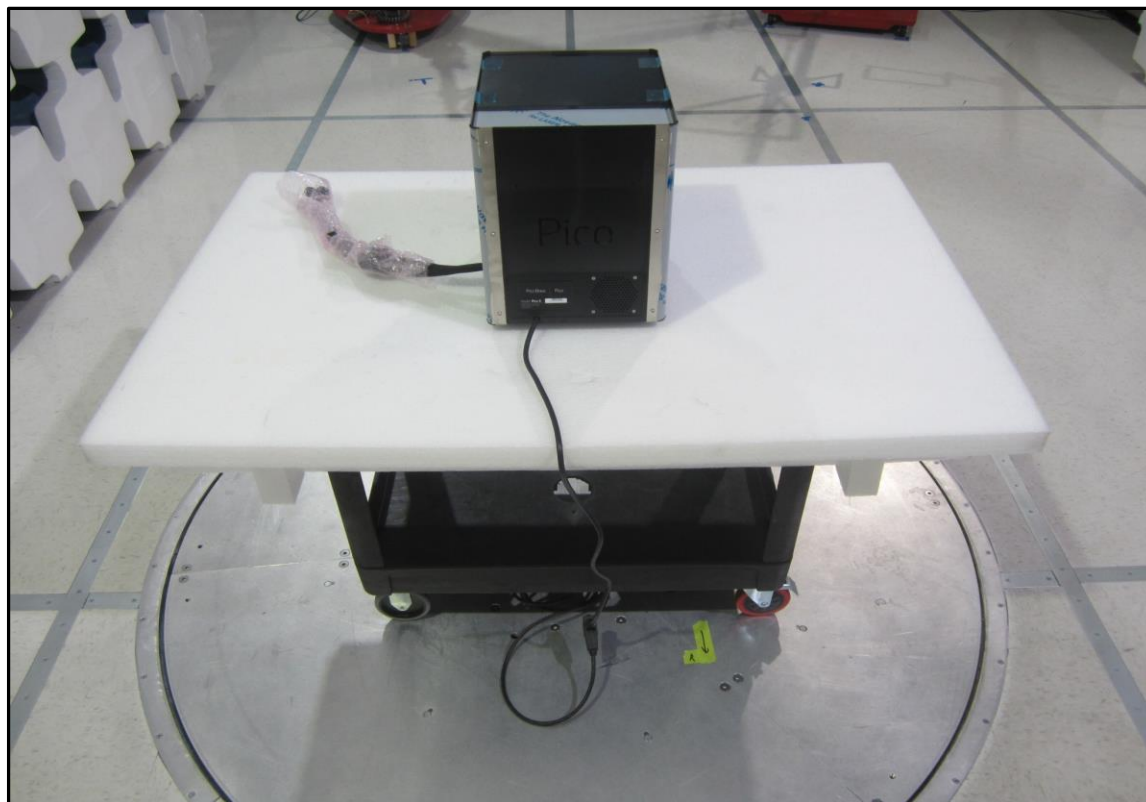

FREQUENCY STABILITY

NORTHWEST
EMC

XMit 2016.05.06

