

Conext™ Gateway

Conext Gateway Owner's Guide

975-0806-01-01

January 2019



Copyright © 2019 Schneider Electric. All Rights Reserved.

Trademarks are owned by Schneider Electric Industries SAS or its affiliated companies. All other trademarks are owned by their respective companies.

Exclusion for Documentation

UNLESS SPECIFICALLY AGREED TO IN WRITING, SELLER

(A) MAKES NO WARRANTY AS TO THE ACCURACY, SUFFICIENCY OR SUITABILITY OF ANY TECHNICAL OR OTHER INFORMATION PROVIDED IN ITS MANUALS OR OTHER DOCUMENTATION;

(B) ASSUMES NO RESPONSIBILITY OR LIABILITY FOR LOSSES, DAMAGES, COSTS OR EXPENSES, WHETHER SPECIAL, DIRECT, INDIRECT, CONSEQUENTIAL OR INCIDENTAL, WHICH MIGHT ARISE OUT OF THE USE OF SUCH INFORMATION. THE USE OF ANY SUCH INFORMATION WILL BE ENTIRELY AT THE USER'S RISK; AND

(C) REMINDS YOU THAT IF THIS MANUAL IS IN ANY LANGUAGE OTHER THAN ENGLISH, ALTHOUGH STEPS HAVE BEEN TAKEN TO MAINTAIN THE ACCURACY OF THE TRANSLATION, THE ACCURACY CANNOT BE GUARANTEED. APPROVED CONTENT IS CONTAINED WITH THE ENGLISH LANGUAGE VERSION WHICH IS POSTED AT <http://solar.schneider-electric.com/>.

Document Number: 975-0806-01-01

Date: January 2019

Part Number: 865-0329

Contact Information

For country-specific details, please contact your local Schneider Electric Sales Representative or visit the Schneider Electric Solar Business website at: <http://solar.schneider-electric.com/>

Information About Your System

As soon as you open your product, record the following information and be sure to keep your proof of purchase.

Serial Number	_____
Product Number	_____
Purchased From	_____
Purchase Date	_____

Safety Information

Important Information

Read these instructions carefully and look at the equipment to become familiar with the device before trying to install, operate, service or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of either symbol to a “Danger” or “Warning” safety label indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

DANGER

DANGER indicates a hazardous situation which, if not avoided, **will result in** death or serious injury.

WARNING

WARNING indicates a hazardous situation which, if not avoided, **could result in** death or serious injury.

CAUTION

CAUTION indicates a hazardous situation which, if not avoided, **could result in** minor or moderate injury.

NOTICE

NOTICE is used to address practices not related to physical injury.

Please Note

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction, installation, and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved. For more information, see *Audience*.

Product Safety Information

DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, ARC FLASH, AND FIRE

- Read all instructions, cautionary markings, and all other appropriate sections of this guide before installing, operating, troubleshooting or performing maintenance on the Conext Gateway.
- Exercise extreme caution at all times to prevent accidents.
- These instructions are for use by qualified installers only.

Failure to follow these instructions will result in death or serious injury.

DANGER

HAZARD OF ELECTRIC SHOCK AND FIRE

- Connect only to Safety Extra Low Voltage (SELV) circuits and power sources.
- All wiring must be done by qualified personnel to ensure compliance with all applicable installation codes and regulations.
- For Indoor Use Only.
- Do not disassemble. No user serviceable parts inside.

Failure to follow these instructions will result in death or serious injury.

WARNING

HAZARD OF PHYSICAL INJURY AND UNEXPECTED OPERATION

Refer to the Owner's Guide for more detailed information when making any changes to settings or sending commands. Commands sent to this device may affect other components in the system. Ensure that anyone working with the system is aware of the result of your changes before sending a command.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTICE

EQUIPMENT DAMAGE

- All cables connected to the Conext Gateway must run indoors and not be susceptible to lightning strikes.
- Turn OFF all devices before connecting cables. The Conext Gateway does not have an ON/OFF switch.
- Do not connect an Ethernet cable from the Conext Gateway to the WAN/MODEM port on the network router.
- Do not connect an Ethernet cable plug into a Xanbus port on the Conext Gateway.
- Do not connect a Xanbus RJ-45 cable plug into the 10/100 Ethernet port of the Conext Gateway.
- Do not connect any port on the Conext Gateway to an outside line or to a public telecommunication network.
- Ensure that the device connected on the Xanbus network is in standby mode before changing settings. Do not change any settings unless you are familiar with the device.
- Changes to any TCP/IP-related settings should only be performed by a qualified IT professional.

Failure to follow these instructions can result in equipment damage or affect network performance.

NOTICE

EQUIPMENT DAMAGE

- Do not disassemble the Conext Gateway.
- See Warranty for instructions on obtaining service.
- The Conext Gateway contains no user serviceable parts. Attempting to service the Conext Gateway yourself will void your warranty.

Failure to follow these instructions can result in equipment damage.

NOTE: This device can be configured to connect to the Internet using port-forwarding in your network router's settings. There is a security risk in port-forwarding unencrypted network traffic over a public network (Internet). Use of a VPN or a secure tunnel to route Conext Gateway communication via the Internet is recommended.

Audience

This guide is intended for use by anyone who plans to install and operate the Conext Gateway communications device as part of their power plant system.

Installation instructions are meant for installers only. The installers have training, knowledge, and experience in:

- Installing electrical equipment.
- Applying all applicable installation codes.
- Analyzing and reducing the hazards involved in performing electrical work.
- Selecting and using Personal Protective Equipment (PPE).
- Changing any TCP/IP-related settings.

Configuration, servicing, and maintenance must be performed by authorized service personnel only. Authorized service personnel meet the requirements for an installer, plus they have received specific training from the manufacturer on servicing the Conext Gateway.

About

Purpose

The purpose of this Owner's Guide is to provide explanations and procedures for installing, operating, configuring, maintaining, and troubleshooting the Conext Gateway.

Scope

The Owner's Guide provides safety guidelines, planning, and setup information, procedures for installing the product, as well as information about troubleshooting the product. It does include information on how to install, configure and use other Schneider Electric products.

Firmware Revision

Some Conext Gateway features and functions described in this Owner's Guide may be incorporated with later firmware versions. This Owner's Guide is valid for Conext Gateway Version 1.01 and above. To view the firmware version on your product, see the Conext Gateway Status Information in the web user interface.

Abbreviations and Acronyms

DHCP	Dynamic host configuration protocol
LED	Light emitting diode (used for indicator lights)
SELV	Safety extra low voltage
TCP/IP	Transmission control protocol/Internet protocol

Related Documents

For more information about related products, refer to:

- *Conext XW Pro Inverter/Charger Owner's Guide*
- *Conext XW+ Inverter/Charger Owner's Manual*
- *Conext Automatic Generator Start (AGS) Owner's Guide*
- *Conext System Control Panel (SCP) Owner's Guide*
- *Conext SW Inverter/Charger Owner's Guide*
- *Conext MPPT 80 600 Solar Charge Controller Operation Guide*
- *Conext MPPT 60 150 Solar Charge Controller Operation Guide*
- *Conext Battery Monitor Owner's Manual*

Related Information

You can find more information about Schneider Electric's Solar products, as well as its services at <http://solar.schneider-electric.com/>.

Contents

Safety Information	2
Audience	5
About	6
Purpose	6
Scope	6
Firmware Revision	6
Abbreviations and Acronyms	6
Related Documents	6
Related Information	6
Overview	10
Introduction	11
Compatible Xanbus™ Components	11
Material List	12
Physical Features	13
Types of Conext Gateway Networks	15
Power Sources for the Conext Gateway	15
Conext Gateway User Interface	16
Installation	18
Choosing a Location	19
Materials and Tools Required	20
Mounting the Conext Gateway	21
Wall Mount	21
DIN Rail Mount	21
Connecting the Conext Gateway to the Xanbus Network	22
Connecting the Conext Gateway to the Internet	23
Turning On the Conext Gateway	25
Turning Off the Conext Gateway	26
Power Cycle	26
Configuration	28
Using the Conext Gateway Web App via Wi-Fi Access Point (AP)	29
Web Security	30
Configuration Steps	30
Logging in to the Conext Gateway Web Application	32
Changing the Password	33
Changing Conext Gateway Settings	34
Plant Setup	35
Time Setup	35

Import and Export Settings	36
Units	36
Modbus Settings	37
Restart Conext Gateway	38
Install Package	38
Changing Device Settings	40
Upgrading Firmware	42
Installing Upgrades From a Thumb Drive	42
Installing Upgrades Remotely	43
Upgrading Device Firmware	43
Monitoring	46
Monitoring LED Indicators	47
Startup	47
Monitoring the Power Plant	47
Troubleshooting	50
Events	51
Specifications	54
Electrical Specifications	55
Physical Specifications	55
Features	56
Regulatory	56
FCC Regulatory Compliance	56
ISED Regulatory Compliance	57
Simplified EU Declaration of Conformity	58
Schneider Electric Products that work with the Conext Gateway	58
Dimensions	58
Using Chrome to Install the Conext Gateway Security Certificate	60
Installing the Conext Gateway Security Certificate	61

1 Overview

What's in This Chapter?

Introduction	11
Compatible Xanbus™ Components	11
Material List	12
Physical Features	13
Types of Conext Gateway Networks	15
Power Sources for the Conext Gateway	15
Conext Gateway User Interface	16

Introduction

The Conext Gateway is a multi-function communication device that provides an overall view of system performance for residential power monitoring systems. It also provides a communications gateway between a network of Xanbus™-enabled devices and Modbus devices. Operators can configure the Conext Gateway system and monitor performance with third party software packages and building management systems.

DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION, ARC FLASH, AND FIRE

- Connect only to Safety Extra Low Voltage (SELV) circuits and power sources.
- All wiring must be done by qualified personnel to ensure compliance with all applicable installation codes and regulations.
- For Indoor Use Only.
- Do not disassemble. No user serviceable parts inside.

Failure to follow these instructions will result in death or serious injury.

Other features of the Conext XW+ include:

- Compatibility—connects directly to Xanbus-enabled devices
- Real-time clock—keeps time for the entire system
- Non-volatile memory—preserves the latest Conext Gateway settings if power is interrupted or network communication is disrupted.
- Firmware storage and upgrade capability—uses the Conext Gateway to upgrade or downgrade firmware for Xanbus-enabled devices on the network.
- Cloud storage capability—Save and synchronize settings with the Conext Gateway cloud service.

Compatible Xanbus™ Components


The Conext Gateway works with several Schneider Electric products including:

- Conext XW Pro Inverter/Charger
- Conext XW+ Inverter/Charger
- Conext Automatic Generator Start (AGS)
- Conext System Control Panel (SCP)
- Conext SW Inverter/Charger
- Conext MPPT 80 600 Solar Charge Controller
- Conext MPPT 60 150 Solar Charge Controller
- Conext Battery Monitor

For details on specific models supported, see the “Specifications” section. The Conext Gateway supports up to a maximum of 20 devices on a Xanbus network depending on the device types.

Material List

Figure 1 Material list

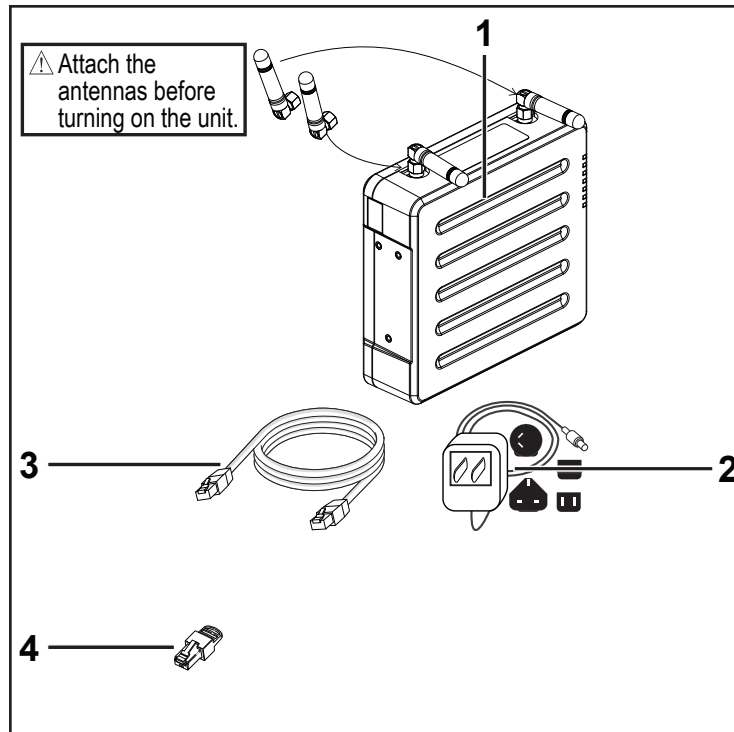

NOTE:


- Do not discard the packaging box.
- The Wi-Fi password is printed on the unit.
- Install the antennas before turning on the unit.

1	Conext Gateway unit
2	AC/DC power adapter with interchangeable plugs
3	Ethernet cable (CAT5e)
4	Network terminator
not shown	• 8GB Micro SD card • 75mm DIN rail • CAN terminator • 26-pin connector (see <i>Physical Features</i> on page 13)

Physical Features

The following illustration shows the Related Documents. The tables in the following sections contain descriptions of the connectors, indicators, and data ports on the Related Documents.

Figure 2 Ports, buttons, and indicators

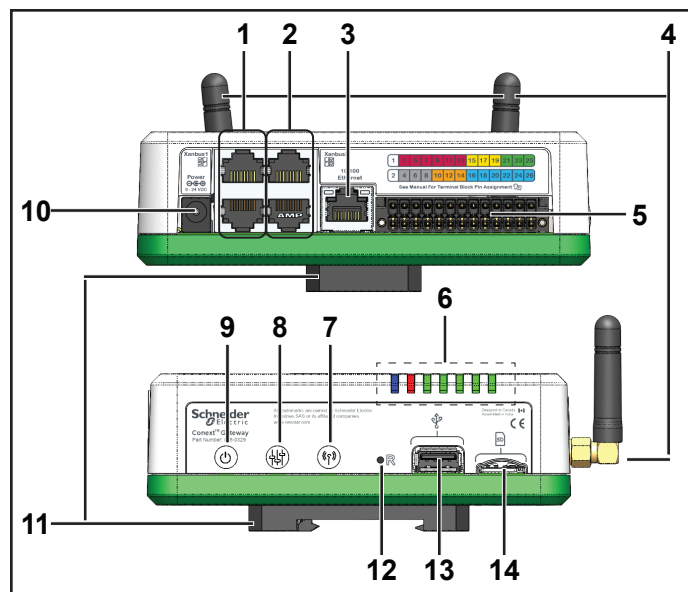

1	Xanbus ports 1	1st pair of Xanbus ports used for Xanbus communications
2	Xanbus ports 2	2nd pair of Xanbus ports used for Xanbus communications
3	Ethernet port	Use to connect to the internet via an Ethernet cable.
4	Antenna	Adjustable antenna for Wi-Fi transmission and reception
5	26-pin port	Use for connecting the 26-pin connector.
6	LED indicators	LED indicators are used for signifying device, communication, and monitoring statuses.
7	Wi-Fi button	Press to connect to Wi-Fi.
8	Settings button	Press to enter device configuration mode.
9	Power button	Press to enable/disable the Conext Gateway.
10	Power port	Use for connecting the AC/DC power plug.
11	DIN rail clip (detachable)	Use for attaching the device to a 35mm EN50022 DIN rail. The clip can be detached and re-attached to one of the narrow sides of the device.
12	Reset pinhole button	Press to reset the Conext Gateway.
13	USB port	Use for firmware updates only. Do not use to charge USB devices.
14	SD card slot	Insert a mini-SD card (up to 128GB) for data storage.


Figure 3 LED indicators



	Green	Power	The Conext Gateway is powered on.
	Green	Memory	Device is logging data to internal memory when flashing.
	Green	Cloud	Device is actively transferring data with the cloud.
	Green	Xanbus	Device is actively transferring data with a Xanbus device/s.
	Green	Modbus	Device is actively transferring data with a Modbus device/s.
	Red	Event	Devices on the Power system have events to report.
	Blue	Wi-Fi	Wi-Fi connectivity is established.

Figure 4 26-pin connector

	Bottom Row
2	9–24VDC power input
4	GND
6	12VDC digital input 1
8	12VDC digital input 2
10	ISO1 CAN GND
12	ISO1 CAN L
14	ISO1 CAN H
16	ISO2 RS485 GND
18	ISO2 RS485 1A
20	ISO2 RS485 1B
22	ISO2 RS485 GND
24	ISO2 RS485 2A
26	ISO2 RS485 2B

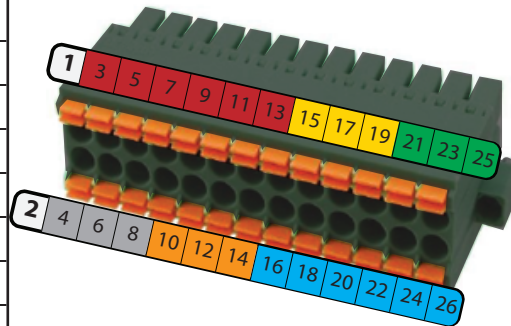

	Top Row
1	GND
3	0–10VDC analog input 1
5	0–10VDC analog input 2
7	GND
9	4–20mA input 1
11	4–20mA input 2
13	GND
15	Relay 1 NO
17	Relay 1 COM
19	Relay 1 NC
21	Relay 2 NO
23	Relay 2 COM
25	Relay 2 NC

Types of Conext Gateway Networks

The Conext Gateway can interface with different LAN devices using wired or wireless connections, so you can configure your Xanbus devices and monitor your power system performance.

- Conext Gateway on Xanbus (two separate networks can be supported)
- Conext Gateway on Modbus (via the 26-pin connector)
- Conext Gateway on Local Area Network (LAN, via Ethernet or Wi-Fi)

When the Conext Gateway is part of a LAN, you can access the Conext Gateway web user interface from a computer on the same LAN or through a wireless or wired LAN connection. An Ethernet connection is required between the Conext Gateway and a router and computer for configuring the Conext Gateway.

Power Sources for the Conext Gateway

The Conext Gateway consumes an average of 2 W under most operating conditions and up to 10 W maximum. The power sources connected to the Conext Gateway must be capable of providing this power requirement.

There are three power sources for the Conext Gateway:

- AC/DC power adapter (supplied)
- Xanbus-enabled device via CAT5 or CAT5e cable (Xanbus cable)
- 9–24 V DC power input connections on the 26-pin connector

All three sources can be used alone or simultaneously. Typically, the AC/DC power adapter (supplied) is used as a primary source with either a Xanbus connection or the 26-pin connector as secondary sources. See *"Physical Features" on page 13* for connection locations.

DANGER

HAZARD OF ELECTRIC SHOCK AND FIRE

Connect only to Safety Extra Low Voltage (SELV) circuits and power sources.

Failure to follow these instructions will result in death or serious injury.

Safety Extra Low Voltage (SELV) is a designation that refers to a circuit in which the voltages within the circuit and from the circuit to ground have values that are not a shock hazard, under both normal and single fault conditions.

In the Conext Gateway , the SELV circuits and their intended connections are:

- The supplied AC/DC power adapter connected to the power port of the Conext Gateway.
- Xanbus communications and power which come from SELV circuits on Xanbus-enabled Schneider products.
- 9–24 V DC power input connections which must be SELV and are connected to the Conext Gateway via the 26-pin connector.
- Ethernet circuits or Class 2 circuits (Class 2 is a 24V, 100VA limited circuit).

Conext Gateway User Interface

This section describes the elements of the web-based user interface for the Conext Gateway. This interface is used to check the status of the Conext Gateway, configure the communications options, monitor and log data for your network, and perform upgrades. The menu bar contains icons for going to the home screen, linking to the Schneider Electric Web site, and closing or logging out of the Web interface. all functions plus home, close and setup icons. You can also link to the Schneider Electric website.


Correct operation of the web interface has been verified with the following browsers:

- Google Chrome™ 34.x or later
- Microsoft® Windows® Internet Explorer® 10.x or later
- Safari® 5.x or later

IMPORTANT: JavaScript and cookies must be enabled in your Web browser for the interface to function.

To access the web user interface, log in with a user name and password. For more details see *Logging in to the Conext Gateway Web Application on page 32*.

Figure 5 Web user interface

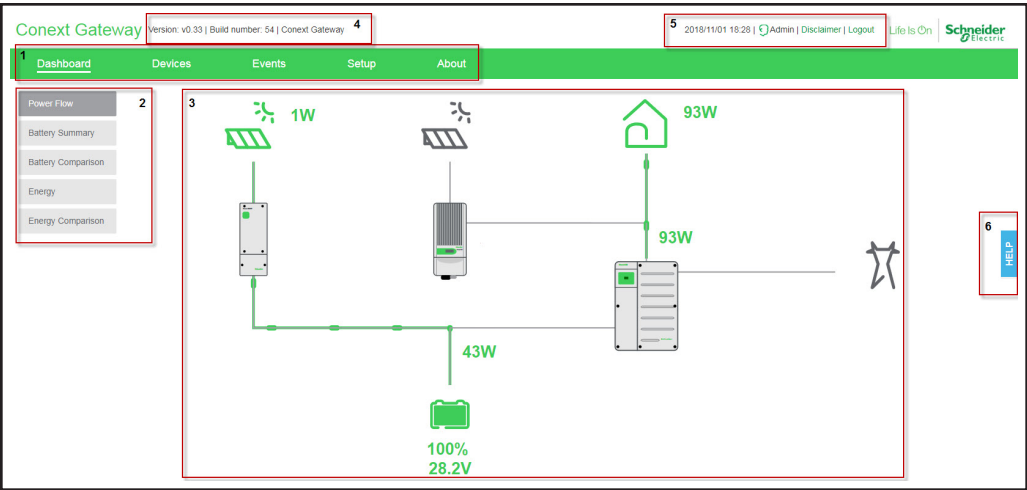

1	Main menu bar – displays major menu items including the Dashboard, Devices, Events, and Setup commands. It includes About which shows Conext Gateway device information.
2	Sub-menu tabs – displays sub-menu items expanding commands associated with the major menu items.
3	Main display area
4	Web app version and build number
5	Information bar – displays the system date, time, and user type. Also, contains a link to the Disclaimer page and Logout.
6	Floating Help tab


2 Installation

What's in This Chapter?

Choosing a Location	19
Materials and Tools Required	20
Mounting the Conext Gateway	21
Wall Mount	21
DIN Rail Mount	21
Connecting the Conext Gateway to the Xanbus Network	22
Connecting the Conext Gateway to the Internet	23
Turning On the Conext Gateway	25
Turning Off the Conext Gateway	26
Power Cycle	26

Choosing a Location

Figure 6 Location choices

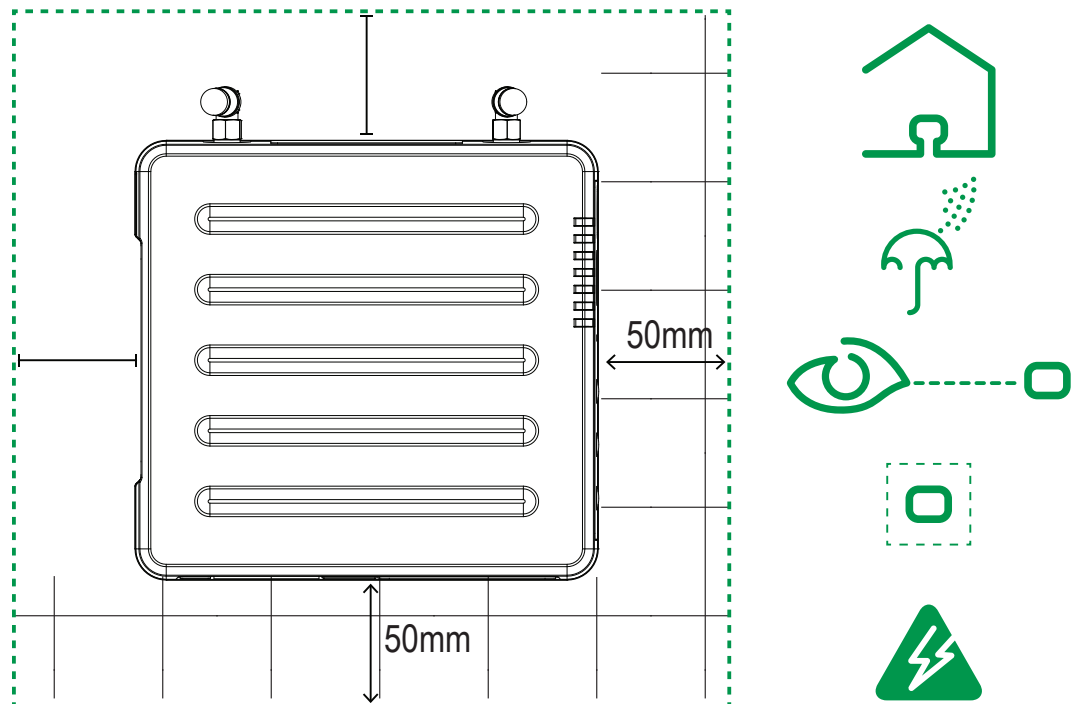

- Choose a clean, dry, easily accessible location indoors.
- If you mount the Conext Gateway on a wall, the recommended height is at eye-level so that you can clearly see the LED indicators and have easy access to the data and communication ports.
- All the ports on the Conext Gateway are accessible from the sides of the device when mounted on a wall or DIN rail. Clearance of at least 2 inches (50 mm) around the device is needed to allow for the bending radius of cables that connect to the Conext Gateway.
- You should not run cables through conduits that can be exposed to lightning strikes. The following are recommended maximum cable lengths in a Conext Gateway system:
 - 131 feet (40 m) Total Xanbus network
 - 328 feet (100 m) Router to Conext Gateway
 - 164 feet (50 m) Modbus Master (RS 485) to Conext Gateway

Materials and Tools Required

The following materials are supplied in the Conext Conext Gateway package:

- one Conext Gateway unit
- one Conext Gateway Quickstart Guide
- one AC/DC power supply adapter
- one 8GB micro SD card
- one CAT5e Ethernet cable (7-ft)
- one 26-pin connector
- one 75mm DIN rail

The following materials and tools are not supplied but are required to complete the installation:

- CAT5e Ethernet cable(s)
- Modbus network cables(s)
- Wire stripper
- Ferrules
- Screwdriver set
- Pliers
- Diagonal cutter or heavy duty scissors

Mounting the Conext Gateway

Wall Mount


To mount the Conext Gateway on a wall:

1. Choose the location for mounting the device.
2. Using the template in the Conext Gateway Quickstart Guide, mark the mounting holes on the wall with a pencil.
3. The holes must be at the same height and 4 7/16 inches (112 mm) apart.
4. Insert the two anchors and mounting screws supplied in the marked locations on the wall, leaving a space of about ¼ inch (6 mm) between the wall and screw head.
5. If you are mounting the Conext Gateway on concrete, the supplied anchors and mounting screws are not suitable. Use two mounting screws that are equivalent to #6 screws.
6. Place the Conext Gateway on the mounting screws, and confirm a snug fit before going to the next step.
7. Connect the wiring and cables.


DIN Rail Mount

To mount the Conext Gateway on the DIN Rail:

1. Use a standard 35-mm “top hat” DIN rail (EN50022).
2. You may choose to move the mounting clip to the side as shown.



3. Attach the device to the DIN rail. Hook the bottom catch of the clip onto the rail, pull up a little to retract the bottom catch and hook the top catch of the clip onto the rail.



4. Connect the wiring and cables.

Connecting the Conext Gateway to the Xanbus Network

To connect the Conext Gateway to the Xanbus network:

1. Connect the Conext Gateway to the Xanbus network using daisy chain configuration.
2. Xanbus components can be arranged in any order.
3. Use a network terminator at both ends of the network. See *Figure 7*.


NOTICE

EQUIPMENT DAMAGE

- Do not connect a Xanbus cable plug into the Ethernet port on the Conext Gateway.
- Connect only to Xanbus ports and use the network terminators to each end device in the daisy chain.

Failure to follow these instructions can result in equipment damage.

Figure 7 Sample Xanbus network

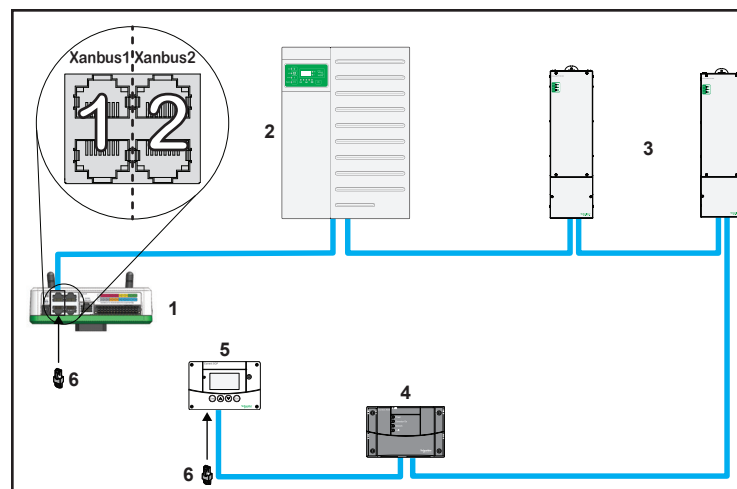

1	Conext Gateway unit
2	Conext XW Pro
3	MPPT 80 600
4	Related Products 5
5	Related Products 4
6	network terminators

NOTE: This Xanbus 1 network is for illustration purpose only.

Connecting the Conext Gateway to the Internet

Before connecting a computer and router to the Conext Gateway, make sure it meets the following prerequisites.

- Microsoft® Windows® 7 (recommended) or later
- Mac OS® X 10.4.8. or later
- Google Chrome™ 34.x or later
- Microsoft® Windows® Internet Explorer® 10.x or later
- Safari® 5.x or later
- JavaScript and cookies must be enabled in your web browser.
- Router - the network router must be able to supply DHCP addresses automatically to connected devices. If your network router does not support automatic DHCP, refer to your network router's user guide or contact your system administrator.

To connect the Conext Gateway to a Computer on an Ethernet Network:


NOTICE

EQUIPMENT DAMAGE

- For a complete list of prerequisites, see the Owner's Guide.
- Do not connect an Ethernet cable from the Conext Gateway to the MODEM port on the network router.
- Do not connect an Ethernet cable plug into a Xanbus port on the Conext Gateway.

Failure to follow these instructions can result in equipment damage.

1. Make sure the computer and network router are turned on and the Conext Gateway is not turned on. Make sure the network router selected has DHCP enabled.
2. Connect one end of an Ethernet cable to the computer's network port.
3. Connect the other end of the Ethernet cable to a vacant Ethernet/LAN port on the network router.
4. Connect one end of the Ethernet cable (supplied) to the LAN port on the network router.
5. At this stage, the network router should be on but the LED showing port activity on the router will not show any indication.
6. Connect the other end of the Ethernet cable to the Conext Gateway.
7. At this stage the Ethernet cable should be the only cable plugged into the Conext Gateway.

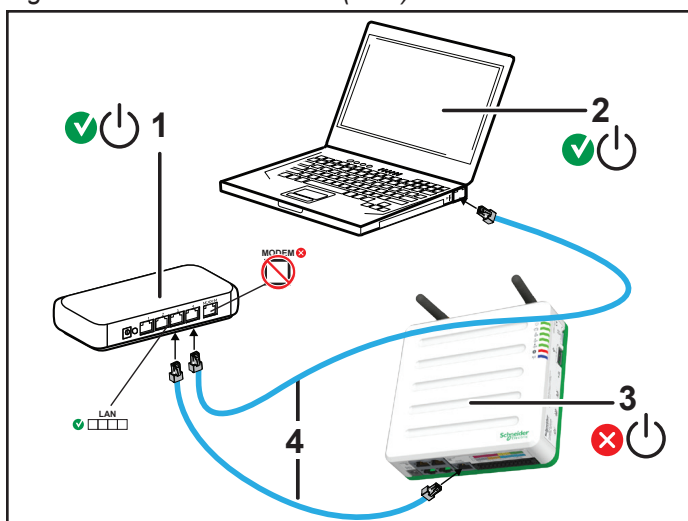
Figure 8 Ethernet connection (LAN)

1	Router/modem
2	Laptop
3	Conext Gateway unit
4	Ethernet cables

Turning On the Conext Gateway

Before turning on the Conext XW+, you must connect it to a power source.

Figure 9 Power connections and button

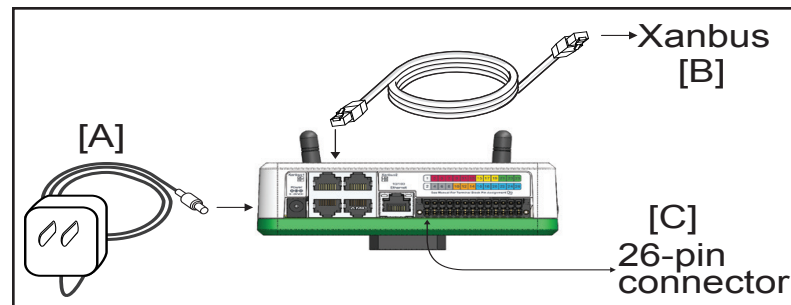

NOTE: In the 26-pin connector, pin 1 connects to a 9-24VDC source and pin 2 connects to GND Power input. See "26-pin connector" on page 14.

To turn on the Conext Gateway:

1. Select a power source to the Conext Gateway. You can choose either of the following:
 - a. Plug the **(A)** AC/DC power adapter into the AC wall outlet
 - b. Connect the Conext Gateway to the Xanbus network **(B)** using Ethernet cables
 - c. Provide 9–24 VDC power via by connecting to a power input source via the 26-pin connector **(C)**
2. Connect **(A)**, **(B)**, or **(C)**'s connector to Conext Gateway's Power port for **(A)**, Xanbus port for **(B)**, or terminal block for **(C)**, respectively.
3. Connect **(A)**'s power plug to an AC wall outlet or **(B)**'s other Xanbus cable connector to a Xanbus port on a Xanbus device. Alternatively, connect **(C)**'s pins 1 & 2 to a DC-powered device.
4. Observe the LED indicators and wait for the Power LED to light up steadily. The Conext Gateway is now turned on.
5. Proceed to "Logging in to the Conext Gateway Web Application" on page 32.

⚠ WARNING

PHYSICAL INJURY HAZARD

Xanbus is a valid power source for the Conext Gateway. However, for the first time set-up, using Xanbus as a power source is not recommended. the Conext Gateway clock will override the other Xanbus devices' clocks and could trigger unintentional time-based events. Therefore, DO NOT connect the Conext Gateway to the Xanbus network prior to setting up the internal clock of the Conext Gateway. Refer to *"Time Setup" on page 35* for instructions. If Xanbus is the only source powering the Conext Gateway, after installation verify the time settings in all devices.


Failure to follow these instructions can result in death, serious injury, or equipment damage.

Turning Off the Conext Gateway

To turn off the Conext Gateway:

- Press the Power button to safely shut down the unit and turn it off.

Figure 10 Power button

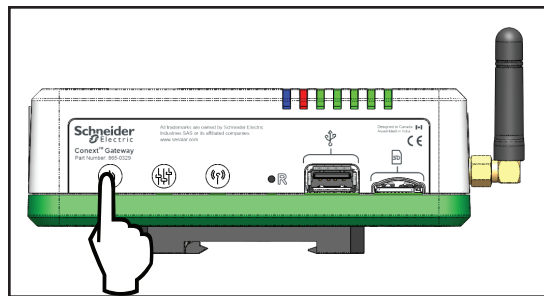

Power Cycle

To power cycle the Conext Gateway:

1. Turn the Conext Gateway OFF.
 - a. Press the Power button.
 - b. Remove the power connections to the Conext Gateway.
2. Wait ten seconds before the next step.
3. Ensure that there is no USB thumb drive inserted in the USB Host port.
4. Turn the Conext Gateway ON.
 - a. Plug and connect the Conext Gateway to a power source.
 - b. Press the Power button.

3 Configuration

What's in This Chapter?

Using the Conext Gateway Web App via Wi-Fi Access Point (AP)	29
Web Security	30
Configuration Steps	30
Logging in to the Conext Gateway Web Application	32
Changing the Password	33
Changing Conext Gateway Settings	34
Plant Setup	35
Time Setup	35
Import and Export Settings	36
Units	36
Modbus Settings	37
Restart Conext Gateway	38
Install Package	38
Changing Device Settings	40
Upgrading Firmware	42
Installing Upgrades From a Thumb Drive	42
Installing Upgrades Remotely	43
Upgrading Device Firmware	43


Using the Conext Gateway Web App via Wi-Fi Access Point (AP)

NOTE: This procedure is not about connecting to a local area network (LAN) via Wi-Fi.

In order to establish a user interface with Conext Gateway, a direct Wi-Fi connection is necessary. The following are the pre-requisites.

- Laptop with Microsoft® Windows® 7 (recommended) or later, Mac OS® X 10.4.8. or later
- Wi-Fi setting for the laptop is enabled
- Web browser such as Google Chrome™ 34.x or later, Microsoft® Windows® Internet Explorer® 10.x or later, Safari® 5.x or later
- JavaScript and cookies must be enabled in your web browser.

Figure 11 Wi-Fi connection requirements

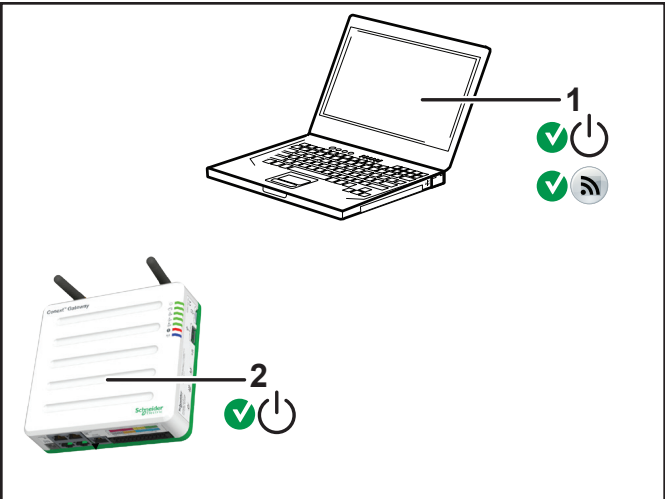


1	laptop
2	Conext Gateway unit. Wi-Fi password label is on the back panel.

To connect:

1. Make sure the laptop and Conext Gateway are turned on.
2. Enable Wi-Fi on the laptop, if not already.

3. Open Wi-Fi Settings and look for the Conext Gateway SSID. For example, you may look for something similar to **ConextGateway_fe808b** below.

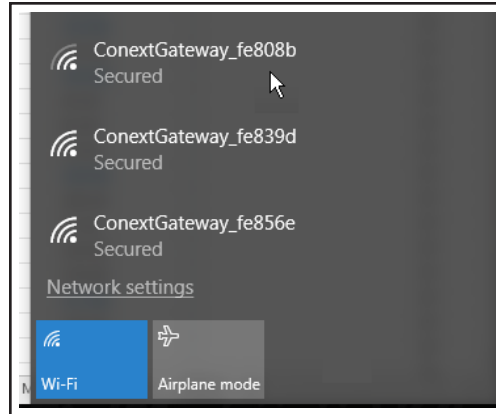

4. Enter the **Password** when prompted.
NOTE: The password is printed on a label on the back panel of the Conext Gateway unit.
5. Proceed to *Logging in to the Conext Gateway Web Application*.

Web Security

When you access the Conext Gateway Web UI you may see a warning stating that the web page is not trusted or the web page is not secure. This occurs because the Conext Gateway security certificate is not installed on your computer's operating system. You can elect to proceed anyway, if you are on a private local area network. Alternatively, you may choose to download the web security certificate from the Conext Gateway and install it on your PC. See *"Installing the Conext Gateway Security Certificate" on page 61* for instructions on how to do this using the Chrome web browser on Windows. Other browsers will have similar mechanisms for installing the certificate.

Configuration Steps

To complete Conext Gateway setup, you must successfully complete the procedures in the Installation section. Make sure the Conext Gateway is connected, the Power LED is on, and the Event LED is off. Your Xanbus devices should still be in standby mode.

When you initially log in to the web user interface, most of the setup information appears automatically with their default values. Some information requires change (such as passwords), some information can be modified as needed, and some information can only be modified by a qualified IT professional.

The following items are part of the Conext Gateway configuration process:

Primary

1. Log in - see *"Logging in to the Conext Gateway Web Application" on page 32*
2. Change the password - see *"Changing the Password" on page 33*

3. Set plant site information - see *"Plant Setup" on page 35*
4. Set the system time - see *"Time Setup" on page 35*

Optional/Occasional

1. Configure general device settings - see *"Changing Device Settings" on page 40*
2. Upgrade the device firmware - see *"Upgrading Firmware" on page 42*

Logging in to the Conext Gateway Web Application

1. Open a web browser.
2. Type the web address of the Conext Gateway web application.
IMPORTANT: The web address is a locally and privately assigned (LAN) device address that is also protected by a firewall.
3. Select your User Name. Select **Admin**.
4. Enter your Password. Initial password is **Admin123**.
5. When prompted, change the initial password immediately to protect the device from unauthorized users and to enable changes to device settings. This is an important step to follow.

NOTE: To perform administrative functions such as a firmware update, set User Name to **Admin**. Settings are disabled until the initial password is changed.

The screenshot shows the login interface of the Conext Gateway web application. On the left is a logo with a person climbing a ladder. The main form has a 'User name' dropdown menu set to 'Admin', a 'Password' text input field containing the text 'Password', and a green 'Login' button. Below the button, it says 'All fields are required'.

6. Change the Conext Gateway SSID password.
 - a. Go to **Setup > Network > Wifi Access Point Settings**
 - b. (Optional) Replace the current Wi-Fi network name under **SSID** field with an appropriate name, if so desired. Limit to 64 alphanumeric characters including symbols.
 - c. Replace the current password under the **Password** field with 10 or more alphanumeric characters including symbols.
 - d. Click **Apply** to save the new password and/or SSID.


The screenshot shows the 'Setup' page of the Conext Gateway web application. The 'Network' section is expanded, and 'Wifi Access Point Settings' is selected. The 'Access Point' is set to 'Enable'. The 'SSID' field contains 'ConextGateway_fe86fa'. The 'Password' field is masked with asterisks. The 'Apply' button is highlighted with a blue arrow. Dashed arrows indicate the navigation path from the 'Setup' menu to 'Network' and then to 'Wifi Access Point Settings'.

Changing the Password

What to expect when logging in for the first time


- When logging in to the web application for the first time, either as **Admin** or **User** or **Guest**, the system will automatically ask you to change the password from the factory default **Admin123** or **User123** or **Guest123**, respectively.

Figure 12 Message box to change password

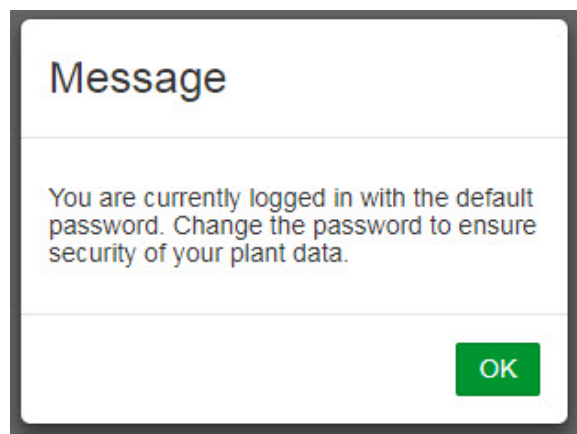

- Click **OK** and follow the instructions to change the password.

Figure 13 Password screen

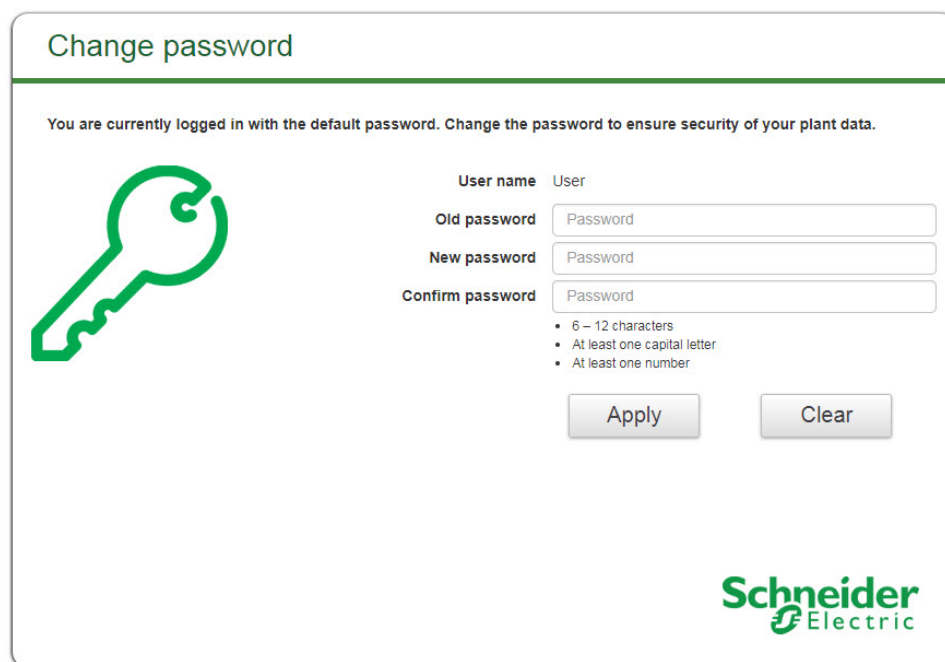

- You may have to log in again after changing the initial password.

To change the password after the initial log in:

Figure 14 Change password setting

1. Click **Setup > Manage Passwords > Change Passwords**.
2. Select the **User name** type.
 - Admin
 - User
 - Guest
3. Enter the **Old password**.
4. Enter the **New password**.
5. Enter the **Confirm password**.
6. Click **Apply**. Your settings will be immediately applied.

Changing Conext Gateway Settings

The procedures for configuring the other Conext Gateway Settings are described in the following sections.

To change Conext Gateway settings:


1. In the main menu bar, click **Setup > Configuration**.
The **Configuration** settings appear in the main display area.
2. Click any of the following settings.
 - a. Plant setup - see *Plant Setup on page 35*
 - b. Time setup - see *Time Setup on page 35*
 - c. Import & export settings - see *Import and Export Settings on page 36*
 - d. Units - see *Units on page 36*
 - e. Modbus settings - see *Modbus Settings on page 37*
 - f. Restart Conext Gateway - see *Restart Conext Gateway on page 38*
 - g. Install package - see *Install Package on page 38*
3. With only a few exceptions, you may save a setting by clicking **Apply** or ignoring changes by clicking **Cancel**.

That portion of the window expands to display the change options for that setting. The size and content of the expanded window varies depending on the setting type.

Plant Setup

It is appropriate to name the plant site to distinguish it from other installations in your power system.

Figure 15 Plant setup screen

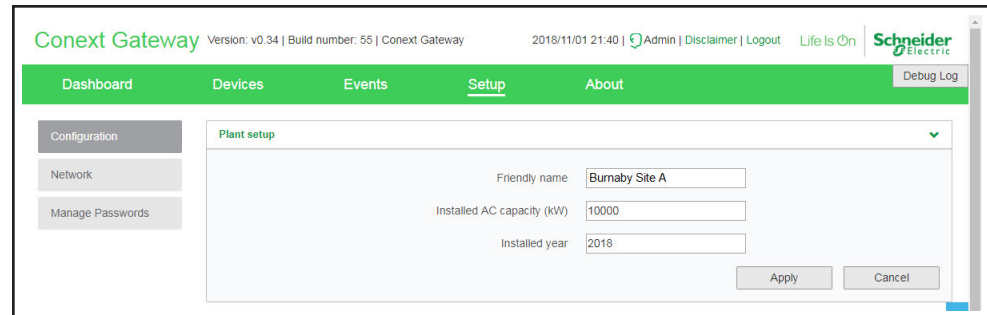


To enter plant information:

1. Click **Setup** > **Configuration** > **Plant setup**.
2. Enter a **Friendly name**. Choose a name that can easily identify the plant site to your customers.
3. Enter the **Installed AC capacity (kW)**.
4. Enter the **Installed year**.
5. Click **Apply**. Your settings will be immediately applied.

Time Setup

You can set the time zone plus date and time in the **Time setup** menu.

Figure 16 Time setup screen

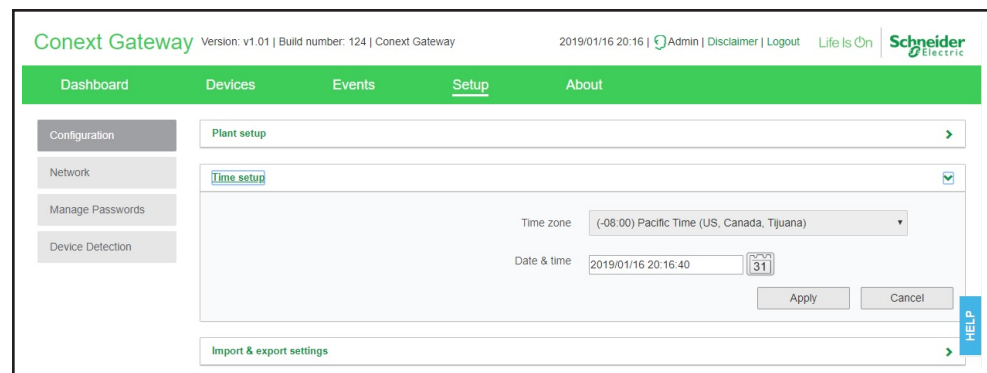


To change the Conext Gateway time:

1. Click **Setup** > **Configuration** > **Time setup**.
2. Select the **Time zone**. This time setting overrides settings on other devices in the system.
3. Enter the date and time by clicking the calendar icon beside **Date & time**.
4. Click **Apply**. Your settings will be immediately applied.

Import and Export Settings

This command setting allows .you to either export the configuration of this Conext Gateway to another Conext Gateway unit or import the configuration of another Conext Gateway to supersede this Conext Gateway unit.

Figure 17 Import & export setup screen

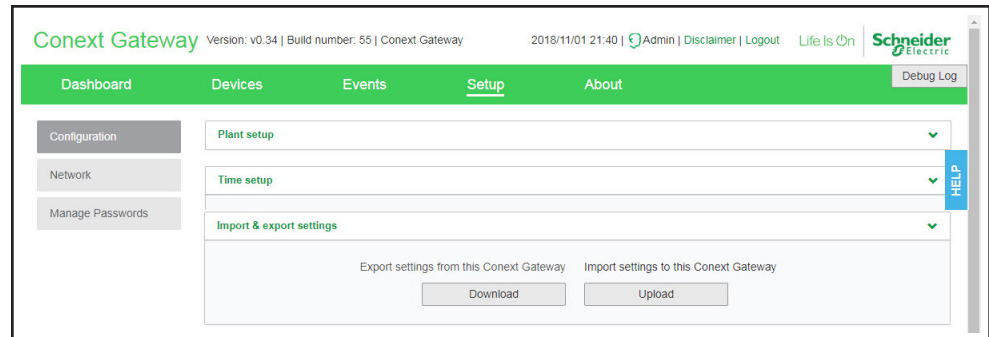

To export settings:

1. In the main menu bar, click **Setup > Configuration**.
The **Configuration** settings appear in the main display area.
2. Click **Import & export settings**.
 - a. Click **Download**. The compressed configuration file *usersettings.zip* will be automatically saved to the **Downloads** folder of the browser.
 - b. If necessary, you may copy this file to an external drive and later import it to a different Conext Gateway device.


To import settings:

1. In the main menu bar, click **Setup > Configuration**.
The **Configuration** settings appear in the main display area.
2. Click **Import & export settings**.
 - a. Click **Upload**.
 - b. Locate the compressed configuration file *usersettings.zip* from a local directory or an external drive.
 - c. Click **Restart now** to finish the importing of the configuration file.

Units

This setting allows .you to change the standard unit of measurement used in solar irradiance, temperature, and wind speed.

Figure 18 Units setup screen

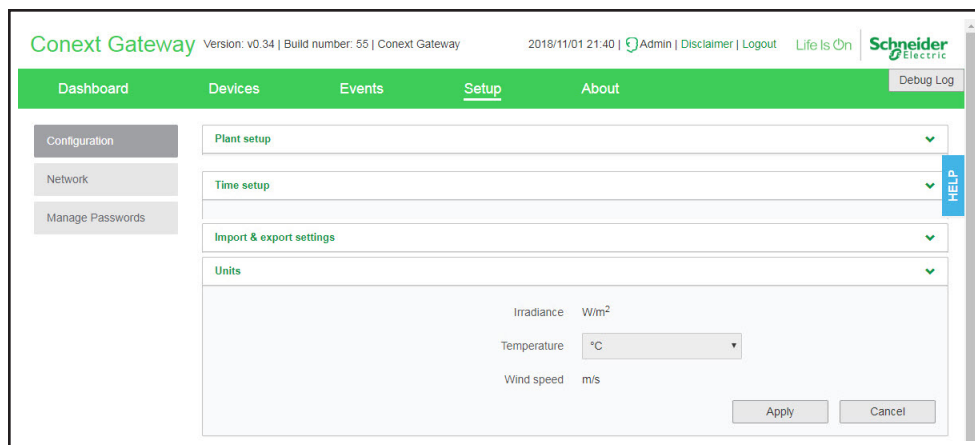


To change units:

1. In the main menu bar, click **Setup > Configuration**.
The **Configuration** settings appear in the main display area.
2. Click **Unit**.
Currently, only **Temperature** can be changed to either celsius or fahrenheit.
3. Save the settings by clicking **Apply**
Alternatively, ignore the changes by clicking **Cancel**.

Modbus Settings

This setting allows you to change the Modbus serial port communication settings.

Figure 19 Modbus settings screen

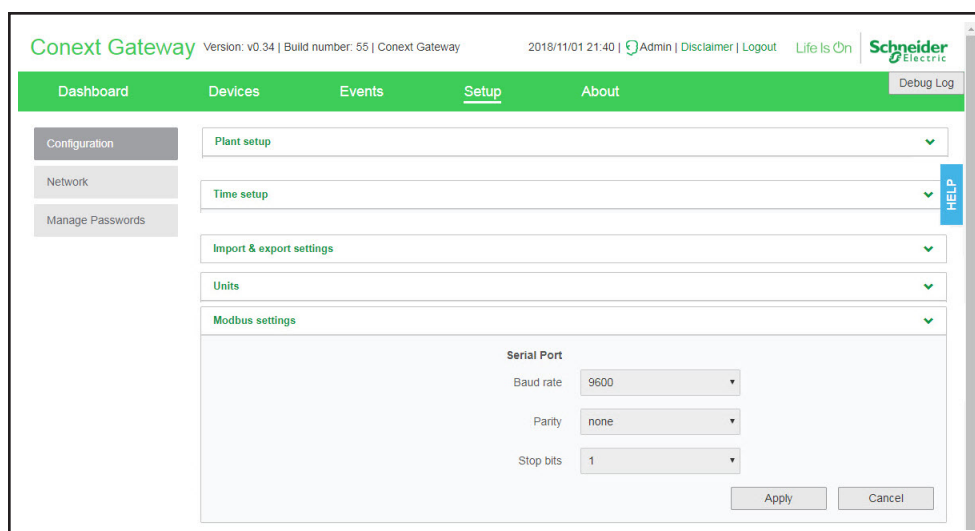

To change Modbus settings:


1. In the main menu bar, click **Setup > Configuration**.
The **Configuration** settings appear in the main display area.
2. Click **Modbus settings**.
 - a. Select the proper **Baud rate**.
 - b. Select the correct **Parity**.

- c. Select the corresponding **Stop bits**.
3. Save the settings by clicking **Apply**
Alternatively, ignore the changes by clicking **Cancel**.

Restart Conext Gateway

You are allowed remotely from the web application to restart, reset the configuration, or return the Conext Gateway to all of the original factory settings.

Figure 20 Restart Conext Gateway screen

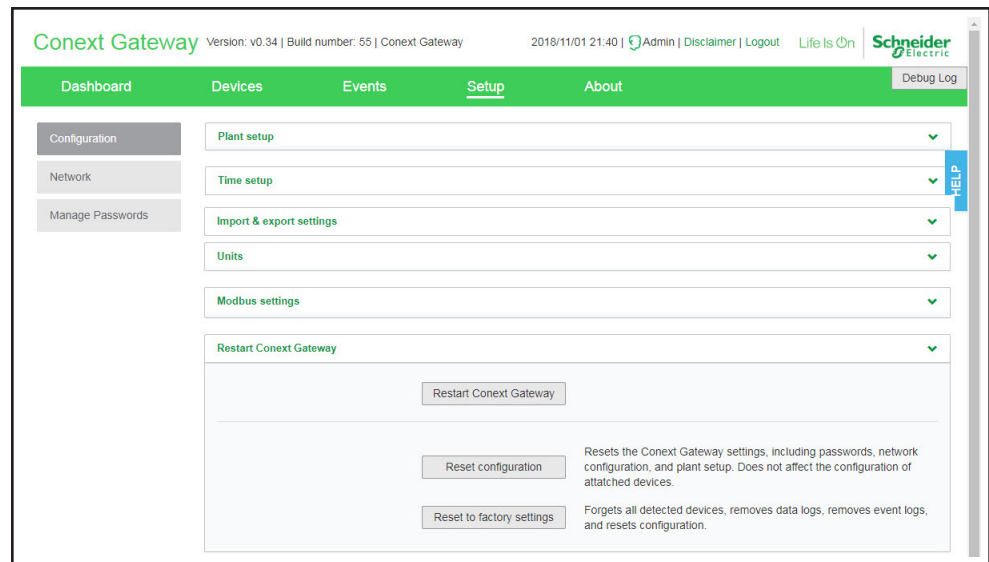

Choose what to do:

1. Click **Setup > Configuration > Restart Conext Gateway**.
2. Click any of the action buttons depending on the kind of reset you want to perform.
 - **Restart Conext Gateway** – will execute a soft restart of the Conext Gateway unit. Doing so will temporarily disconnect and put on Standby all connected Xanbus devices.
 - **Reset configuration** – will execute a reset of Conext Gateway settings, including passwords, network configuration, and plant setup. This action does not affect the configuration of connected devices.
 - **Reset to factory settings** – will execute a complete return to factory settings including forgetting all detected devices, removing data logs, removing event logs, and resetting all configuration.
3. Follow the succeeding instructions.

Install Package

To install a Conext Gateway upgrade remotely:

1. From the Conext Gateway Web Application home page, go to **Setup > Configuration > Install Package**.



2. Download the firmware package.
 - a. Click **Get package**. This will take you to the Conext Gateway product webpage.
 - b. From the product webpage, go to **DOWNLOADS > Firmware**.
 - c. Search for the latest firmware package from the list and click it to begin downloading.
 - d. Save the `.epkg` file to a local directory.
3. Go back to the Conext Gateway Web Application.
4. Click the **Upload package** button.
5. Search and select the firmware package (`.epkg` file) you saved in a local directory from the Conext Gateway product webpage.
6. Click **Open** from the Windows dialog. The upgrade begins automatically.
7. As the firmware package is transferred to the Conext Gateway, progress is indicated in percentage, and a message screen indicates when the file transfer has been completed successfully.
8. When prompted, reboot the Conext Gateway. See “Rebooting the Conext Gateway” on page 3–13.

Changing Device Settings

Before making any changes, familiarize yourself thoroughly with the effects of changing the settings of another device.

NOTICE

RISK OF EQUIPMENT DAMAGE

- Consult the device's Owner's Guide when changing the device's settings.
- Make sure the device connected on the Xanbus or Modbus network is in Standby mode before changing settings.
- Do not change any settings unless you are familiar with the device.

Failure to follow these instructions can result in equipment damage.

Figure 21 Sample Device Overview screen - Icons display

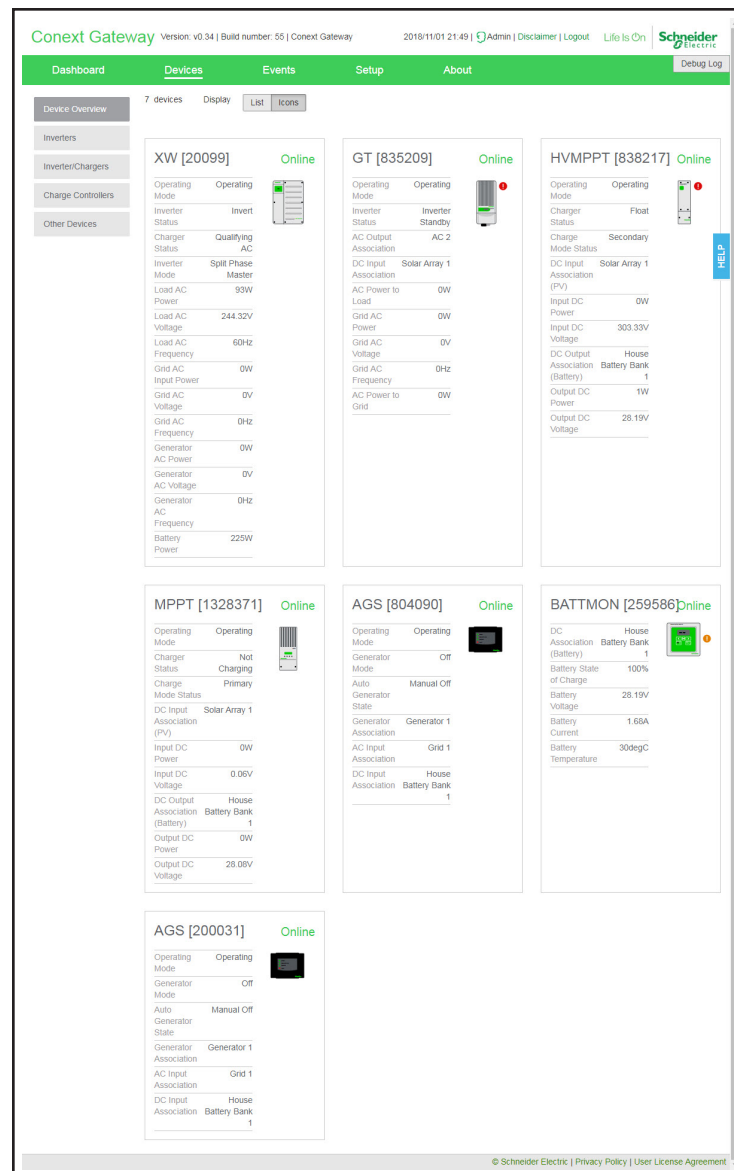


Figure 22 Sample Device Overview screen - List display

Device type	Device id	Status
XW	20099	Online
GT	835209	Online
HVMPPT	838217	Online
MPPT	1328371	Online
AGS	804090	Online
BATTMON	259586	Online
AGS	200031	Online

To change a device setting:

1. In the main menu bar, click **Devices**. See *Figure 21* for a sample of the default display of all connected devices.
2. If you want a shorter list of devices, switch to a List display. See *Figure 22*.
3. Put the device on Standby first.
 - a. Click a device you want to put on Standby.
 - b. Click **Configuration > Controls**.
Note that **Controls** may be called differently such as **AGS Control**.
 - c. Search for the control setting **Operating Mode**.
 - d. Select **Standby**.
 - e. Click **Apply**.
4. Click **Configuration**
5. Choose either **Basic** or **Advanced** settings.
6. Click a device setting category. For example, **Inverter Settings** in the case of an inverter device.
7. Change a specific setting by selecting from a drop down list, toggling a switch, or entering a different value.
8. Click **Apply** to save the changes.

Upgrading Firmware

You can perform firmware upgrades for your Conext Gateway and Xanbus-enabled devices when they are available for download.

There are three upgrade procedures, namely:

- *"Installing Upgrades From a Thumb Drive" below*
- *"Installing Upgrades Remotely" on the next page*
- *"Upgrading Device Firmware" on the next page*

Installing Upgrades From a Thumb Drive

Follow the procedure below to change the Conext Gateway firmware to an updated version.

To update the firmware:


1. Using a laptop computer, format a USB drive and open a web browser.
2. Go to <http://solar.schneider-electric.com> and download the latest Conext Gateway firmware version (contained in a ZIP file).
3. Navigate to **Products > Battery Based Inverters > Accessories > Conext Gateway**
4. Click **DOWNLOADS > Firmware > 865-0326 VX.X BNX**
5. Pick the firmware version (V) with a higher number and also a higher build number (BN). The ZIP file is approximately 35 MB.

NOTE: Pick the firmware version (V) with a higher number and also a higher build number (BN). The ZIP file is approximately 35 MB.

6. Extract the .epkg file from the ZIP file into the root directory of the USB drive (supplied with the unit).
7. Copy the new firmware file into the Conext Gateway unit by following the illustrated steps below.

NOTE: When copying the new firmware file into the unit (Step 5) is taking more than five minutes, repeat Step 4, and make sure that the .epkg file is copied into the root directory.

8. To initiate the update to the Conext Gateway firmware, follow the illustrated steps below.

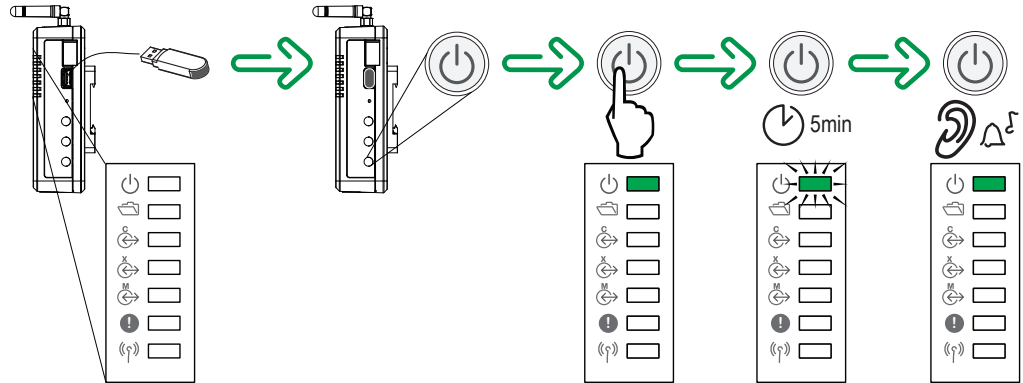

Installing Upgrades Remotely


For full instructions, see *"Install Package"* on page 38.

Upgrading Device Firmware

It is possible to upgrade a device's firmware through the Conext Gateway web application.

NOTICE
RISK OF EQUIPMENT DAMAGE ■ Consult the device's Owner's Guide when changing the device's settings. ■ Make sure the device connected on the Xanbus or Modbus network is in Standby mode before changing settings. ■ Do not change any settings unless you are familiar with the device. Failure to follow these instructions can result in equipment damage.

Figure 23 Sample Device Overview screen - List display

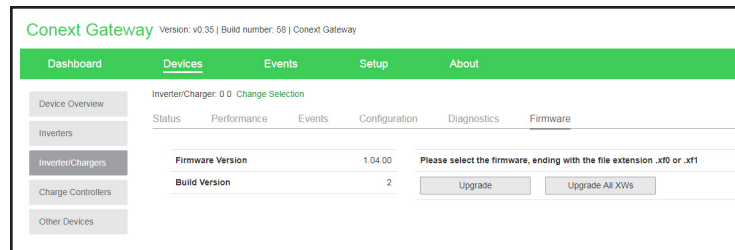

To obtain the firmware package:

1. From a laptop computer, open a web browser.
2. Go to <http://solar.schneider-electric.com> and download the latest Conext Gateway firmware version (contained in a ZIP file).
3. Navigate to **Products > Battery Based Inverters > Accessories > Conext Gateway**
4. Click **DOWNLOADS > Firmware > 865-0326 VX.X BNX**
5. Pick the firmware version (V) with a higher number and also a higher build number (BN). The ZIP file is approximately 35 MB.

NOTE: Pick the firmware version (V) with a higher number and also a higher build number (BN). The ZIP file is approximately 35 MB.

6. Extract the .epkg file from the ZIP file into a folder on the local drive.

To upgrade a device firmware:

1. In the main menu bar, click **Devices**.
2. Put the device on Standby first.
 - a. Click a device you want to put on Standby.
 - b. Click **Configuration > Controls**.
Note that **Controls** may be called differently such as **AGS Control**.
 - c. Search for the control setting **Operating Mode**.
 - d. Select **Standby**.
 - e. Click **Apply**.
3. Click **Firmware**
4. Click the **Upgrade** button.
5. Follow the step by step upgrade instructions.
6. To upgrade all similar devices in the network, click the **Upgrade All** button.
7. Follow the step by step upgrade instructions.

4 Monitoring

What's in This Chapter?

Monitoring LED Indicators	47
Startup	47
Monitoring the Power Plant	47

Monitoring LED Indicators

LED indicators allow you to monitor the functioning of the Conext Gateway.

Table 1 LED indicators

Icon	Color	LED	Description
	Green	Power	The Conext Gateway is powered and ready to communicate when on.
	Green	Memory	Device is logging data to internal memory when flashing.
	Green	Cloud	Device is actively transferring data with a communication device/s.
	Green	Xanbus	Device is actively transferring data with a Xanbus device/s.
	Green	Modbus	Device is actively transferring data with a Modbus device/s.
	Red	Event	Devices on the Power system have events or alerts when on.
	Blue	Wi-Fi	Wi-Fi connectivity is established.

Startup


The Power LED flashes slowly when the Conext Gateway application is loading and flashes quickly during application initialization. The other LEDs illuminate as startup progresses. Once the Conext Gateway is ready, the Power LED turns on steadily. This process takes about two minutes.

Monitoring the Power Plant

You can view the current state of the power plant by viewing the Conext Gateway dashboard.

With the **Dashboard**, you can view power flow between the connected devices, battery information, and energy production and consumption.

Figure 24 Dashboard

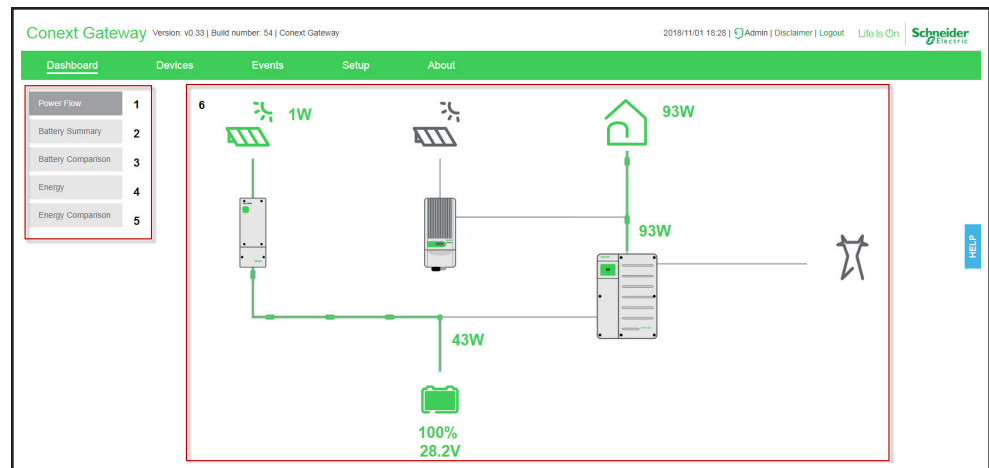

1	Power flow tab – shows an interactive and graphical view of the power plant with its different connected devices.
2	Battery summary tab – shows a historical line graph of four battery metrics such as current, volts, temperature, and state-of-charge (SOC). It shows one battery at a time.
3	Battery comparison tab – shows a historical and comparative line graph of the four battery metrics against all the different batteries.
4	Energy tab – shows a chronological summary of energy that is produced by three sources; solar, grid, and battery. Also shows a chronological summary of energy that is output to four energy consumers; load, grid, battery, and generator.
5	Energy comparison tab – shows a comparative graph between energy input and output.
6	Main display board – shows the different graphical elements of the power plant, the devices, battery, and energy information.

To view the dashboard:

1. After successfully logging in, the very first view to show on the main display board is the **Dashboard - Power Flow**.
2. Click each of the tabs on the left to switch to different views.

5 Troubleshooting

What's in This Chapter?

Events	51
---------------------	-----------

Events

The events detected and monitored by Conext Gateway vary in type. The types of events are categorized into warnings and detected faults. Warnings are displayed as orange icons with an exclamation point. Detected faults are displayed as red icons with an exclamation point.

When devices detect events that usually resolve by itself, it is still reported to Conext Gateway and logged. It is logged under **Historical**. See *Figure 26* However, events that happen repeatedly escalate to a fault or sometimes the device detects a fault, such as a ground fault. When a fault is detected, it is also reported to Conext Gateway and logged. If service intervention is required, it is logged under **Active**. See *Figure 25* It remains there until service is performed. Also, if user intervention is required, such as remotely resetting a device, the event is logged under **Active** and remain there until the user is able to perform the necessary action.

Figure 25 Active events

Conext Gateway Version: v0.34 | Build number: 55 | Conext Gateway

2018/11/01 21:46 | Admin | Disclaimer | Logout Life Is On Schneider Electric Debug Log

Dashboard Devices **Events** Setup About

Active Historical

Event Type	Time	Device Type	Device Id	Id	Name	Description
!	2018/08/25 08:47:09 +0100	HVMPPT	838217	82	Network Power Supply Fault	The Network Power Supply has failed. Solution:
!	Not Available	GT	835209	54	APS Off	PV Voltage is zero, and grid voltage is within limits (240V AC). Solution:

HELP CSV

© Schneider Electric | Privacy Policy | User License Agreement

Figure 26 Historical events

Conext Gateway Version: v0.34 | Build number: 55 | Conext Gateway

2018/11/01 21:48 | Admin | Disclaimer | Logout Life Is On Schneider Electric Debug Log

Dashboard Devices **Events** Setup About

Active Historical

Event Type	Time	Device Type	Device Id	Id	Name	Description
!	2018/10/30 00:54:39 +0000	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/25 07:14:23 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/15 21:34:48 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/15 08:05:59 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/03 02:03:53 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/02 19:14:09 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/10/01 14:57:11 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/09/28 16:48:48 +0100	HVMPPT	838217	4	Battery Over Temperature Warning	Cause: The battery is too hot. Solution:
!	2018/09/28 03:46:12 +0100	MPPT	1328371	71	DC Over-current shutdown	Cause: DC output current is too high. Solution:
!	2018/09/28 03:46:12 +0100	HVMPPT	838217	71	DC Over-current shutdown	Cause: DC output current is too high. Solution:

First Previous 1 2 3 4 5 6 7 8 9 10 Next Last

HELP CSV

© Schneider Electric | Privacy Policy | User License Agreement

To view Events:

1. In the main menu bar, click **Events**.
The **Active** events are displayed first in the main display board.
2. Click **Historical** to view events that have been logged and/or resolved.
3. To download a copy of the events, click the **CSV** icon on the lower right hand corner of the main display board.

6 Specifications

What's in This Chapter?

Electrical Specifications	55
Physical Specifications	55
Features	56
Regulatory	56
FCC Regulatory Compliance	56
ISED Regulatory Compliance	57
Simplified EU Declaration of Conformity	58
Schneider Electric Products that work with the Conext Gateway	58
Dimensions	58

Electrical Specifications

NOTE: Specifications subject to change without prior notice.

NOTICE	
EQUIPMENT DAMAGE Do not power the unit without first installing the supplied antennas. Failure to follow these instructions can result in equipment damage.	
Power Consumption	2 W average / 10 W peak
AC/DC adapter (supplied)	Input: 100-240 V AC, 50-60 Hz, 0.48 A, Output: 12 V DC, 1.6 A, 5.5 mm outer, 2.1 mm center-positive jack. NOTE: Required when used with the Conext SW.
Xanbus	When connected to Conext XW Pro/XW+ or MPPT 80 600 providing network power
9–24V on 26-pin connector	9–24 V DC, 1 A max input only through pins 1 and 2 Accepts 16–24 AWG pin wire size.
Operation Frequency	2412–2472 MHz (Europe) 2414–2462 MHz (N. America)
Max. radio frequency power transmitted	17.06 dBm (E.I.R.P., Declaration for EU)

Physical Specifications

NOTE: Specifications subject to change without prior notice.

Weight (device only)	337 g (0.74 lb)
Dimensions (device only) (W × H × D)	137 x 131 x 41 mm (5.4 × 5.2 × 1.6 inches)
Shipping package dimensions	158 × 158 × 188 mm (6.2 × 6.2 × 7.4 inches)
Shipping package weight	920 g (2 lbs)
Housing/Mounting system	ABS Plastic / 35-mm DIN rail clip
IP rating / Mounting Location	IP 20, NEMA 1, Indoor only
Status Display	7 x LEDs
Temperature	Operating: -4 to 122 °F (-20 to 50 °C) Storage: -40 to 185 °F (-40 to 85 °C) Maximum case temperature: 140 °F (60 °C)
Humidity	Operating: < 95%, non-condensing Storage: < 95%

Features

NOTE: Specifications subject to change without prior notice.

Programmable dry contact relay	Screw 3-terminal, 16-24 AWG, NC-Com-NO, Form: Class 2, 24 V DC, 4 A max SELV input only
Graphical user interface	Internet Browser
Remote firmware upgrades	Yes (Related Products 2 and connected Xanbus devices)
Custom Data logger	Yes (requires Micro-SD card)
Micro-SD card (supplied)	8GB

Regulatory

NOTE: Specifications subject to change without prior notice.

EMC immunity	EN61000-6-1 EN 55035 EN 301 489-1, -17
EMC emissions	EN61000-6-3 EN 55032 EN 301 489-1, -17 FCC part 15B ICES-003
Substances / environmental	RoHS
FCC ID	Contains 2AODL-CONEXTGTWY
IC ID	Contains 24209-CONEXTGTWY
Model number	865-0329

FCC Regulatory Compliance

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Note: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications.

However, there is no guarantee that interference will not occur in a particular installation.

If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.

- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Note: changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

RF Exposure Compliance

This equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 20 cm between the radiator and your body. This transmitter must not be co-located or operating in conjunction with any other antenna or transmitter.

Supplier's Declaration of Conformity

47 CFR § 2.1077 Compliance Information

Unique Identifier:

Trade Name: Conext Gateway

Model No.: 865-0329

Responsible Party – U.S. Contact Information

Schneider Electric Solar Inverters USA, Inc.

250 S. Vasco Road, Livermore, CA 94551

<https://solar.schneider-electric.com/>

FCC Compliance Statement

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

ISED Regulatory Compliance

This device contains licence-exempt transmitter(s) that comply with Innovation, Science and Economic Development Canada's licence-exempt RSS(s).

Operation is subject to the following two conditions:

1. This device may not cause interference.
2. This device must accept any interference, including interference that may cause undesired operation of the device.

L'émetteur exempt de licence contenu dans le présent appareil est conforme aux CNR d'Innovation, Sciences et Développement économique Canada applicables aux appareils radio exempts de licence. L'exploitation est autorisée aux deux conditions suivantes :

1. L'appareil ne doit pas produire de brouillage;
2. L'appareil doit accepter tout brouillage radioélectrique subi, même si le brouillage est susceptible d'en compromettre le fonctionnement.

This equipment complies with IC RSS-102 radiation exposure limits set forth for an uncontrolled environment. This transmitter must not be co-located or operating in conjunction with any other antenna or transmitter. This equipment should be installed and operated with minimum distance 20 cm between the radiator and your body.

Cet équipement est conforme aux limites d'exposition aux radiations IC CNR-102 établies pour un environnement non contrôlé. Cet émetteur ne doit pas être situé ou fonctionner conjointement avec une autre antenne ou un autre émetteur. Cet équipement doit être installé et utilisé avec une distance minimale de 20 cm entre le radiateur et votre corps.

CAN ICES-3 (B)/NMB-3(B)

Simplified EU Declaration of Conformity

Hereby, Schneider Electric declares that the radio equipment type 865-0329 is in compliance with Directive 2014/53/EU. The full text of the EU declaration of conformity is available at the following internet address:


<https://solar.schneider-electric.com/>

Schneider Electric Products that work with the Conext Gateway

- Conext XWPro Inverter / Charger:
 - Conext XWPro 6848 NA Product No. 865-6848-21
- Conext XW+ Inverter / Chargers:
 - Conext XW+ 7048 E Product No. 865-1040
 - Conext XW+ 8548 E Product No. 865-1035
 - Conext XW+ 5548 NA Product No. 865-1005
 - Conext XW+ 6848 NA Product No. 865-1000-01
- Conext SW Inverter / Chargers:
 - SW 2524 120 Product No. 865-2524
 - SW 4024 120 Product No. 865-4024
 - SW 2524 230 Product No. 865-2524-61
 - SW 4024 230 Product No. 865-4024-61
- Conext MPPT 60 150 Solar Charge Controller: Product No. 865-1030-1
- Conext MPPT 80 600 Solar Charge Controller: Product No. 865-1032
- Conext System Control Panel (SCP): Product No. 865-1050
- Conext Automatic Generator Start (AGS): Product No. 865-1060
- Conext Battery Monitor: Product No. 865-1081-01

Dimensions

NOTE: Specifications subject to change without prior notice.

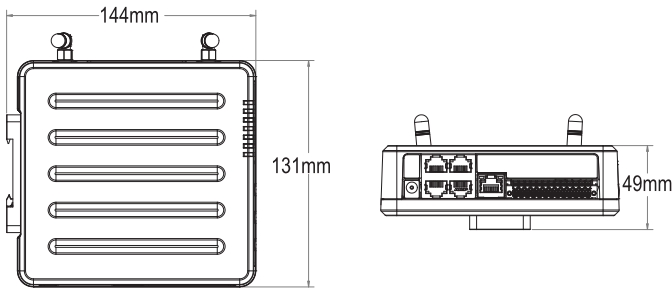

A Using Chrome to Install the Conext GatewaySecurity Certificate

What's in This Chapter?

Installing the Conext Gateway Security Certificate 61


Installing the Conext Gateway Security Certificate

These instructions explain how to download the web security certificate from the Conext Gateway and install it on your PC using Chrome on Windows 10.


To export the security certificate:

1. Open the Chrome developer tools using one of the following methods:
 - a. Press F12.
 - b. Click the three dots in the top right-hand corner of the window, then click **More Tools** and then **Developer Tools**.
 - c. Use the keyboard command Ctrl+Shift+I.
2. Navigate to the **Security** tab in **Developer Tools**.
3. Click **View Certificate**.

Figure 27 Security tab

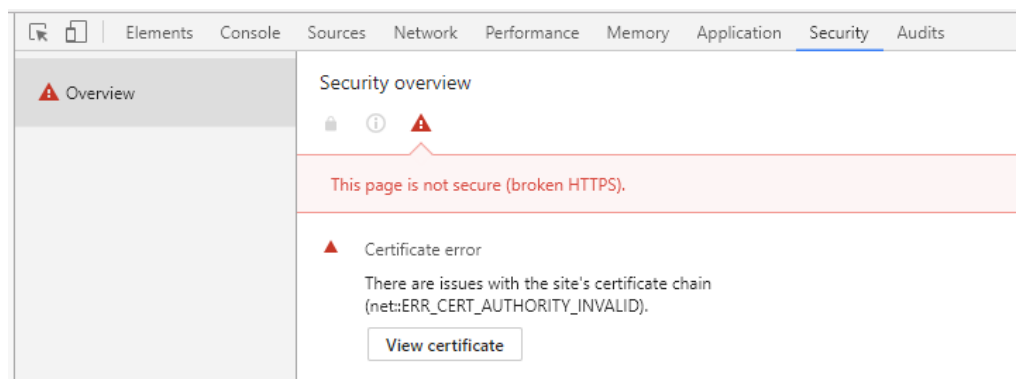


4. Click the **Certification Path** tab.

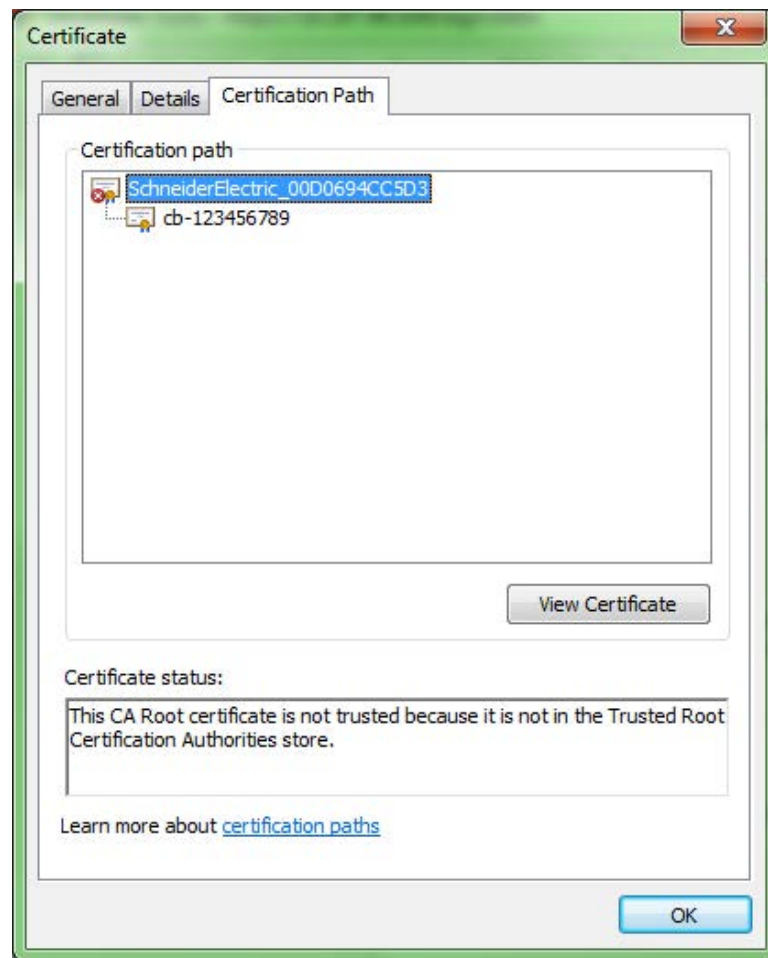Figure 28 Certificate path tab


5. Click **View Certificate**.
6. Confirm that the hex string following the underscore in the Issued By: statement matches the MAC Address of your Conext Gateway.

Figure 29 View certificate

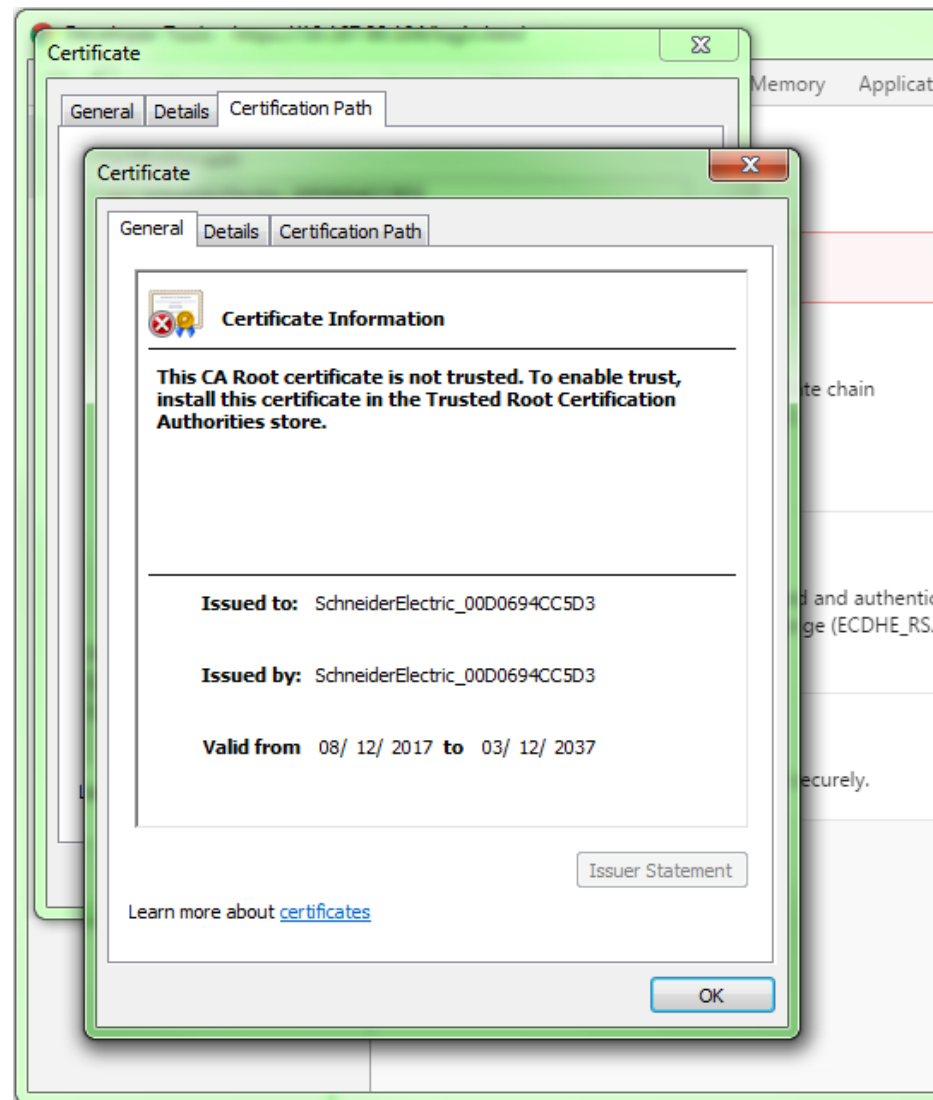

7. Click the **Details** tab.


Figure 30 Details tab

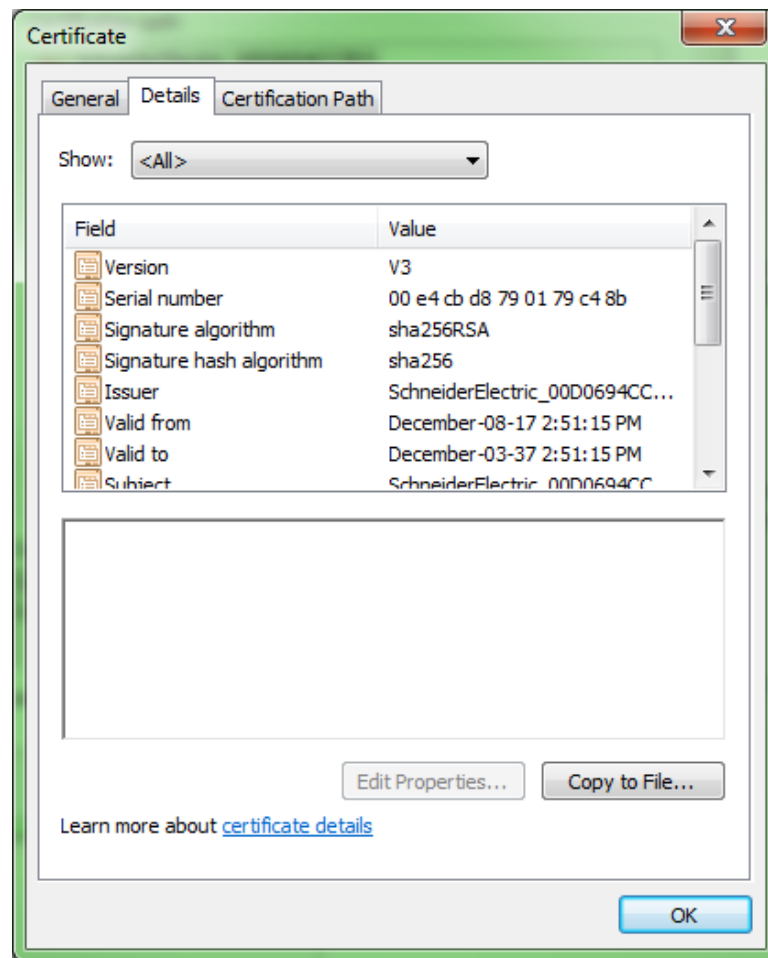

8. Click **Copy to File...** to open the Certificate Export Wizard and then click **Next**.


Figure 31 Certificate Export Wizard

9. Click the radio button beside **DER encoded binary** and then click **Next**.

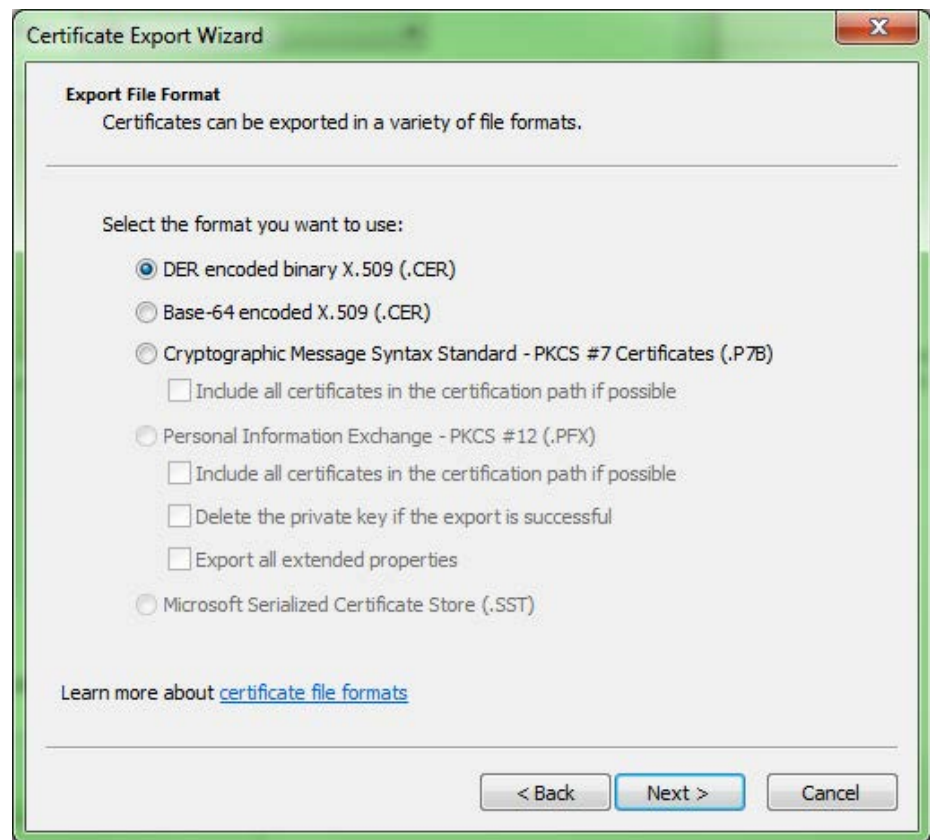Figure 32 Export settings

10. Click **Finish** to save it to your file system (remember where it has saved).

Figure 33 Confirmation

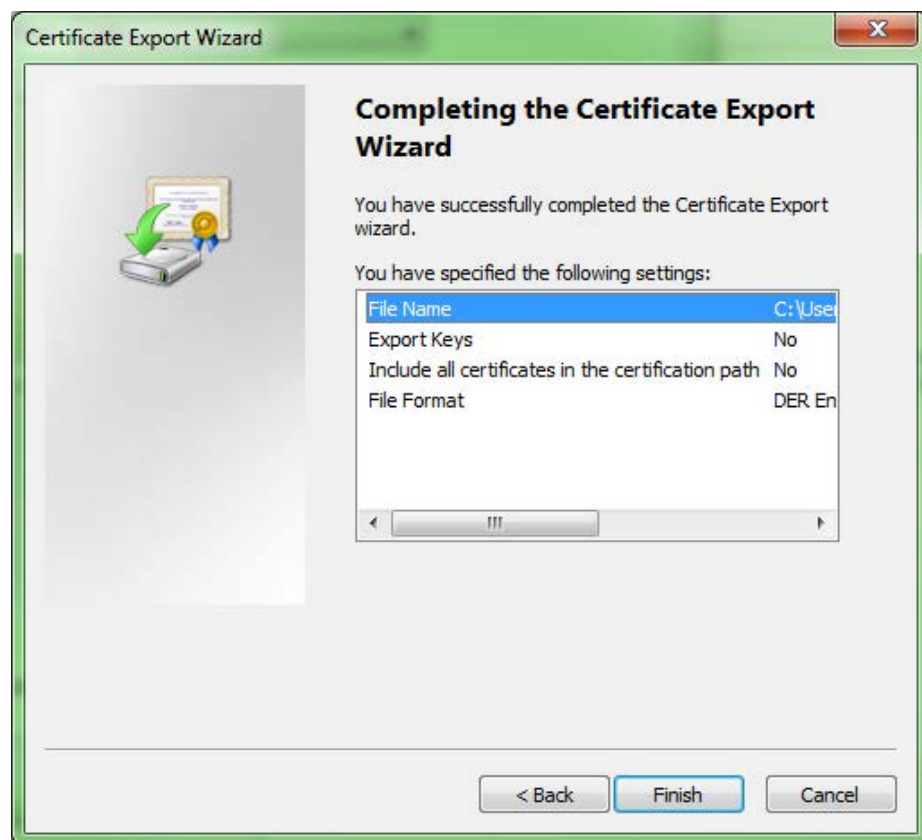
**To import the security certificate:**

1. Using the windows file browser, go to the location where you saved the certificate file, and double-click the certificate file.
2. Click **Install Certificate** and then click **Next**.

Figure 34 Certificate Import Wizard


3. Click the radio button beside **Place all certificates in the following store** and then click **Browse**.

Figure 35 Import settings

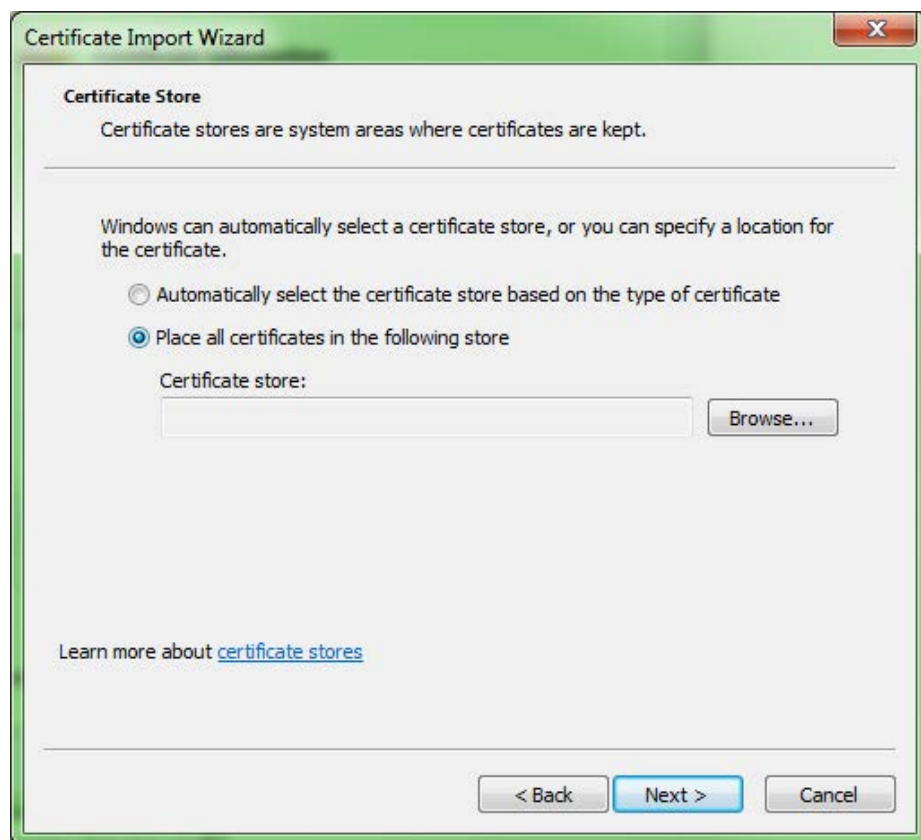


4. Click **Trusted Root Certificate Authorities** and then click **OK**.


Figure 36 Select certificate store

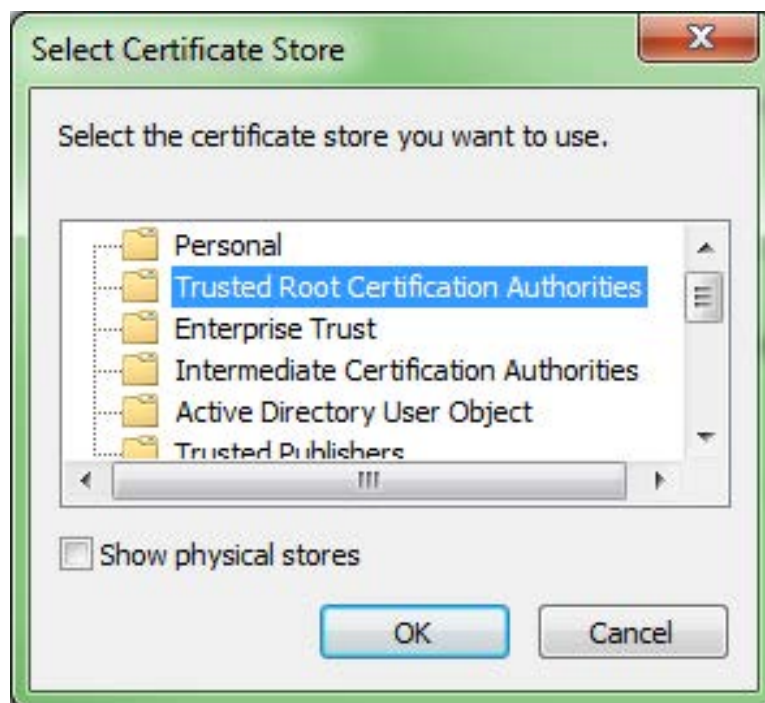

The Certificate Import Wizard should look like this:

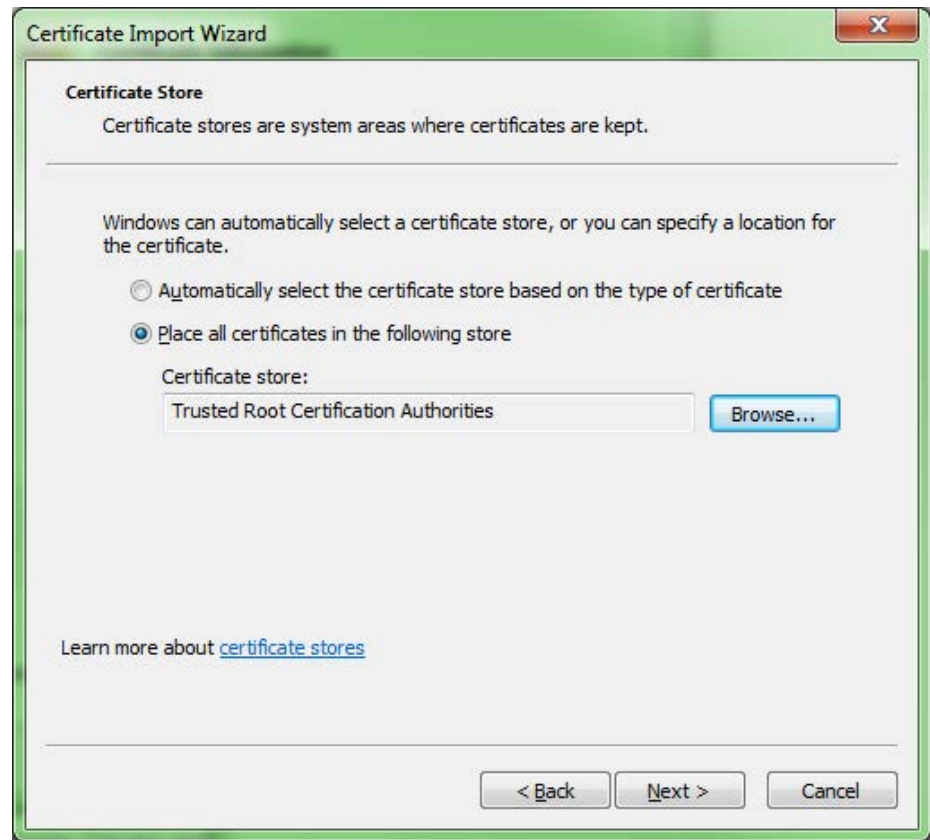Figure 37 Import settings confirmation

5. Click **Next** and then click **Finish**.
6. Click Yes to the security warning, and then click OK when the Certificate Import Wizard confirms the import was successful.
7. Restart your browser and confirm the word Secure is now beside the Conext Gateway web UI address.

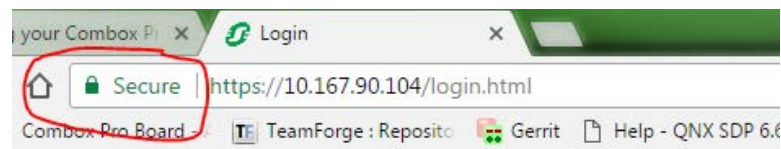Figure 38 Website secure

Schneider Electric

As standards, specifications, and designs change from time to time, please ask for confirmation of the information given in this publication.

For other country details please contact your local Schneider Electric Sales Representative or visit the Schneider Electric Solar Business website at: <http://solar.schneider-electric.com/>

© 2019 Schneider Electric. All Rights Reserved.