

LABELLING REQUIREMENTS

Labelling Requirements

Since there is not enough space to display everything on the product label, the 15.19(a)(3) statement is placed in the manual and on the full system packaging.

§ 15.19 (a)(5) Labeling requirements:



When the device is so small or for such use that it is impracticable to label it with the statement specified under paragraph (a) of this section in a font that is four-point or larger, and the device does not have a display that can show electronic labeling, then the information required by this paragraph shall be placed in the user manual and must also either be placed on the device packaging or on a removable label attached to the device.

RSS-Gen Section 4. Labelling requirements:

If the dimensions of the product are extremely small or it is not practical to place the label or marking on the product, and if electronic labelling cannot be implemented, the label shall be placed in a prominent location in the user manual supplied with the product, as agreed upon with ISED prior to the certification application. The user manual may be in an electronic format; if it is not supplied to the user, the user manual must be readily available.

TAE YOUNG E&T Co., LTD.

FCC ID : 2BRMJ-JOYPLUS / IC : 34443-JOYPLUS

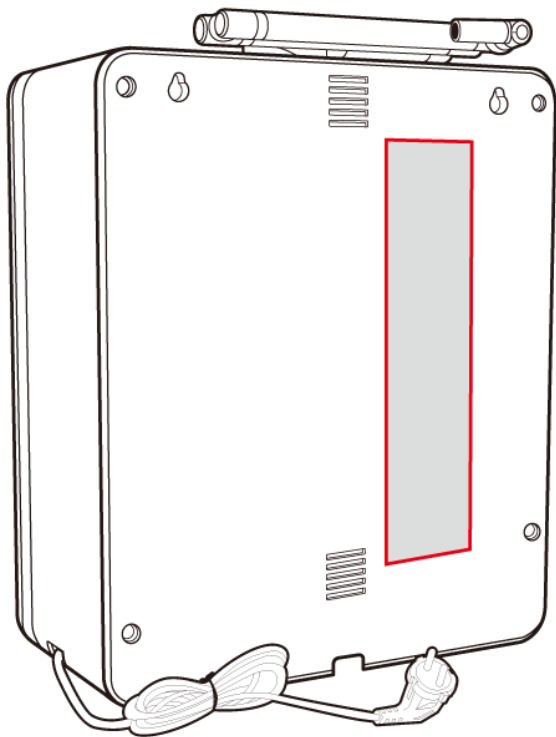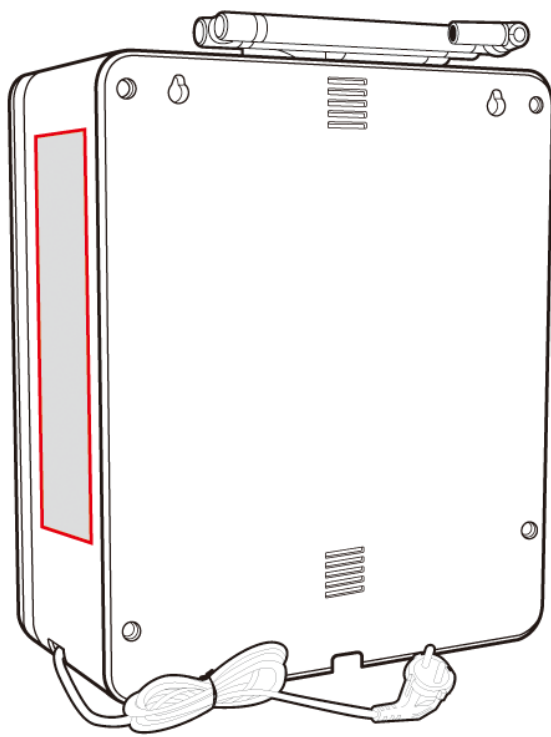Label Location	
Primus Joy PLUS	TY12-NMP5T, TY12-NMP5N, TY12-NMP7T, TY12-NMP7N, TY12-NMP9T, TY12-NMP9N, TY12-NTY5T, TY12-NTY5N, TY12-NTY7T, TY12-NTY7N, TY12-NTY9T, TY12-NTY9N
	

TAE YOUNG E&T Co., LTD.


FCC ID : 2BRMJ-JOYPLUS / IC : 34443-JOYPLUS

Product Label

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION


TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION


TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION


TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION


TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION


TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

Product indication details

PRODUCT

Product Name	WATER IONIZER
Rated Input	100-240 V~, 50Hz-60Hz
Power Consumption	Max. 270W
Operating Temperature	4-35°C
Operating Pressure	0.1-0.5 MPa
Electrolyte Cell	Platinum and Titanium
Filter Configuration	2 Filters system
Model Number, Serial Number, Mfg.Date	



FCCID: 2BRMJ-JOYPLUS
IC: 34443-JOYPLUS

Protection form about electricity shock :
Class 2 machinery. Please see Safety
precautions in User Manual references.



WARNING

Do not open or disassemble this
product as electric shock may
occur.

When using water to swallow
medication, only use purified (H₂O)
water. Do not use alkaline or acidic
water to swallow medication.

Not recommended for people
with achlorhydria. People who
suffer from achlorhydria should
always consult with a physician
before consuming alkaline water.

If you experience any negative
side effects from consuming
alkaline water, stop immediately
and consult with your physician.

People who suffer from any type
of disease or other health issues
should always consult with a
physician before consuming alkaline
water, stop immediately and consult
with your physician.

If skin irritation occurs from the
use of acid water, stop using the
water immediately and consult
with a physician.

After initializing the filter, press
the H₂O button and run purified
water for 3minutes. You are highly
recommended to follow this process
to use the machine properly.

Use only source water approved
as drinking water by an authorized
organization (i.e. tap water). If using
groundwater, make sure the water
meets drinking water compliance
standards before installation. If not,
a pre-filter may be required. (source
water quality greatly affects pH values
and filter performance) Do NOT use
excessively hard water or saltwater.
(may cause malfunctions and/or
shorten the product life)

CORPORATION

TAEYOUNG E&T CO., LTD.
908, Ungsang-daero, Yangsan-si, Gyeongsang
nam-do, Korea | TEL: 82-53-953,9570
http://www.tyentgroup.com

MADE IN KOREA

END

TAE YOUNG E&T Co., LTD.

FCC ID : 2BRMJ-JOYPLUS / IC : 34443-JOYPLUS