

SPECIFICATION FOR APPROVAL

CUSTOMER: 微 电 能

CUST P/N: TX- Wireless Charging Transmitter Coil Module

FINE P/N:

DESC: TX43.5*0.8-12TS-0.08*48P-6.5UH-55MM

DATE: 2026/04/23

Version: A.0

PREPARED BY	CHECKED BY	APPROVED BY	CUSTOMER APPROVE
陈诚佳	张燕	罗勇军	

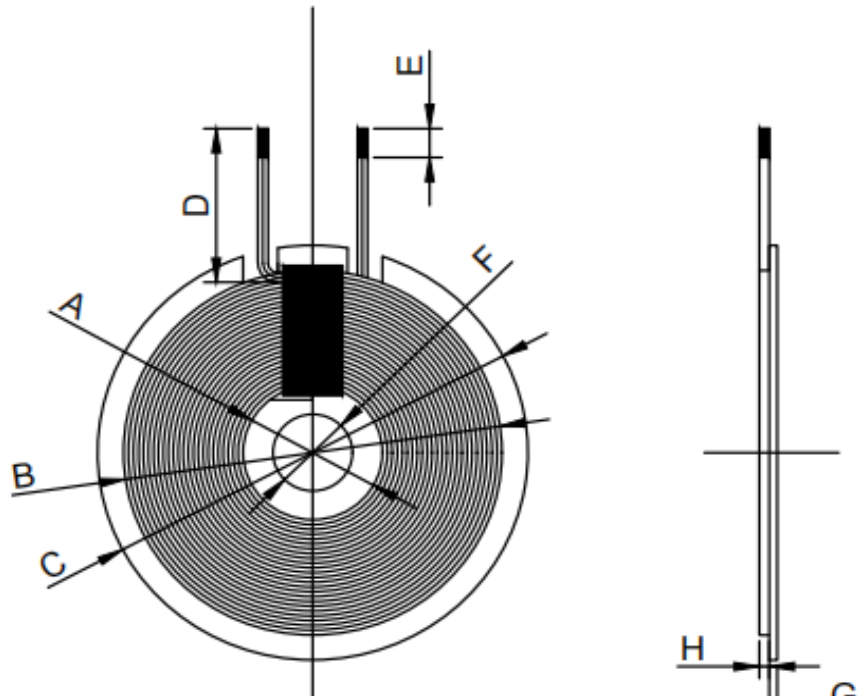
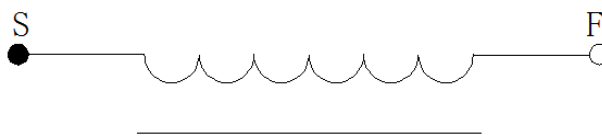
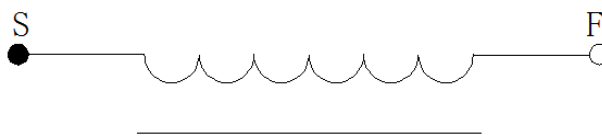
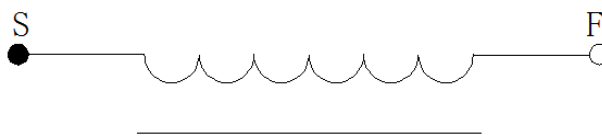
Shenzhen Tianxia Technology Co., LTD

Address: Room 523-525, 5th Floor, C33 Science and Technology
Innovation Park, District 33, Bao 'an District, Shenzhen City
TEL : 18718699959
E-mail : 2321113770@qq.com

Version Change History

[illegible]

SPECIFICATION

DESC	TX43.5*0.8-12TS-0.08*48P-- -6.5UH-55MM	Rev : A.0	CUST:																																																																																								
			CUST P/N:																																																																																								
一、 DIMENSION:(mm)  <tr><td>A</td><td>13±0.5</td></tr> <tr><td>B</td><td>38±1</td></tr> <tr><td>C</td><td>43.5±0.5</td></tr> <tr><td>D</td><td>55±2</td></tr> <tr><td>E</td><td>3±1</td></tr> <tr><td>F</td><td>5.3±0.3</td></tr> <tr><td>G</td><td>0.8±0.05</td></tr> <tr><td>H</td><td>1.8±0.1</td></tr> <tr><td></td><td></td></tr> <tr><td colspan="4" rowspan="10"> 二、 SCHEMATIC DIAGRAM  <tr><td colspan="2" rowspan="3"> 注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line </td></tr><tr></tr><tr></tr><tr><td colspan="4">三、 Winding Specification:</td></tr><tr><td>NO.</td><td colspan="2">TERMINAL</td><td>WIRE</td><td>Turns</td><td>Winding Direction</td></tr><tr><td>1</td><td>S</td><td>F</td><td>0.08*24P*2</td><td>12Ts</td><td>CCW</td></tr><tr><td colspan="6">四、 ELECTRICAL CHARACTERISTICS:</td></tr><tr><td colspan="6">TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%</td></tr><tr><td>NO.</td><td>ITEM</td><td>TERMINAL</td><td>SPECIFICATION</td><td>TEST FREQUENCY</td><td>TEST EQUIPMENTS</td></tr><tr><td>1</td><td>IND.</td><td>S-F</td><td>4.0uH ± 10%Alone</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr><tr><td>2</td><td>IND.</td><td>S-F</td><td>6.5uH ± 10%Attach magnetic sheets</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr><tr><td>3</td><td>DCR</td><td>S-F</td><td>120mΩ Max</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr><tr><td colspan="3">PREPARED BY/DATE</td><td colspan="3">CHECKED BY/DATE</td></tr><tr><td colspan="3">陈诚佳2025/03/11</td><td colspan="3">张燕 2025/03/11</td></tr></td></tr>				A	13±0.5	B	38±1	C	43.5±0.5	D	55±2	E	3±1	F	5.3±0.3	G	0.8±0.05	H	1.8±0.1			二、 SCHEMATIC DIAGRAM  <tr><td colspan="2" rowspan="3"> 注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line </td></tr> <tr></tr> <tr></tr> <tr><td colspan="4">三、 Winding Specification:</td></tr> <tr><td>NO.</td><td colspan="2">TERMINAL</td><td>WIRE</td><td>Turns</td><td>Winding Direction</td></tr> <tr><td>1</td><td>S</td><td>F</td><td>0.08*24P*2</td><td>12Ts</td><td>CCW</td></tr> <tr><td colspan="6">四、 ELECTRICAL CHARACTERISTICS:</td></tr> <tr><td colspan="6">TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%</td></tr> <tr><td>NO.</td><td>ITEM</td><td>TERMINAL</td><td>SPECIFICATION</td><td>TEST FREQUENCY</td><td>TEST EQUIPMENTS</td></tr> <tr><td>1</td><td>IND.</td><td>S-F</td><td>4.0uH ± 10%Alone</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td>2</td><td>IND.</td><td>S-F</td><td>6.5uH ± 10%Attach magnetic sheets</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td>3</td><td>DCR</td><td>S-F</td><td>120mΩ Max</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td colspan="3">PREPARED BY/DATE</td><td colspan="3">CHECKED BY/DATE</td></tr> <tr><td colspan="3">陈诚佳2025/03/11</td><td colspan="3">张燕 2025/03/11</td></tr>				注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line		三、 Winding Specification:				NO.	TERMINAL		WIRE	Turns	Winding Direction	1	S	F	0.08*24P*2	12Ts	CCW	四、 ELECTRICAL CHARACTERISTICS:						TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%						NO.	ITEM	TERMINAL	SPECIFICATION	TEST FREQUENCY	TEST EQUIPMENTS	1	IND.	S-F	4.0uH ± 10%Alone	100KHz/1.0V	LCR METER 106X	2	IND.	S-F	6.5uH ± 10%Attach magnetic sheets	100KHz/1.0V	LCR METER 106X	3	DCR	S-F	120mΩ Max	100KHz/1.0V	LCR METER 106X	PREPARED BY/DATE			CHECKED BY/DATE			陈诚佳2025/03/11			张燕 2025/03/11		
				A	13±0.5																																																																																						
				B	38±1																																																																																						
				C	43.5±0.5																																																																																						
				D	55±2																																																																																						
				E	3±1																																																																																						
				F	5.3±0.3																																																																																						
				G	0.8±0.05																																																																																						
				H	1.8±0.1																																																																																						
二、 SCHEMATIC DIAGRAM  <tr><td colspan="2" rowspan="3"> 注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line </td></tr> <tr></tr> <tr></tr> <tr><td colspan="4">三、 Winding Specification:</td></tr> <tr><td>NO.</td><td colspan="2">TERMINAL</td><td>WIRE</td><td>Turns</td><td>Winding Direction</td></tr> <tr><td>1</td><td>S</td><td>F</td><td>0.08*24P*2</td><td>12Ts</td><td>CCW</td></tr> <tr><td colspan="6">四、 ELECTRICAL CHARACTERISTICS:</td></tr> <tr><td colspan="6">TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%</td></tr> <tr><td>NO.</td><td>ITEM</td><td>TERMINAL</td><td>SPECIFICATION</td><td>TEST FREQUENCY</td><td>TEST EQUIPMENTS</td></tr> <tr><td>1</td><td>IND.</td><td>S-F</td><td>4.0uH ± 10%Alone</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td>2</td><td>IND.</td><td>S-F</td><td>6.5uH ± 10%Attach magnetic sheets</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td>3</td><td>DCR</td><td>S-F</td><td>120mΩ Max</td><td>100KHz/1.0V</td><td>LCR METER 106X</td></tr> <tr><td colspan="3">PREPARED BY/DATE</td><td colspan="3">CHECKED BY/DATE</td></tr> <tr><td colspan="3">陈诚佳2025/03/11</td><td colspan="3">张燕 2025/03/11</td></tr>				注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line		三、 Winding Specification:				NO.	TERMINAL		WIRE	Turns	Winding Direction	1	S	F	0.08*24P*2	12Ts	CCW	四、 ELECTRICAL CHARACTERISTICS:						TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%						NO.	ITEM	TERMINAL	SPECIFICATION	TEST FREQUENCY	TEST EQUIPMENTS	1	IND.	S-F	4.0uH ± 10%Alone	100KHz/1.0V	LCR METER 106X	2	IND.	S-F	6.5uH ± 10%Attach magnetic sheets	100KHz/1.0V	LCR METER 106X	3	DCR	S-F	120mΩ Max	100KHz/1.0V	LCR METER 106X	PREPARED BY/DATE			CHECKED BY/DATE			陈诚佳2025/03/11			张燕 2025/03/11																								
						注： 1.The coil is in a counterclockwise direction 2.Double-sided adhesive tape should be applied to the back of the coil 3.Apply 4MM high-temperature adhesive at the wire outlet 4. Insert a 52MM heat shrink tube at the outgoing line																																																																																					
				三、 Winding Specification:																																																																																							
				NO.	TERMINAL		WIRE	Turns	Winding Direction																																																																																		
				1	S	F	0.08*24P*2	12Ts	CCW																																																																																		
				四、 ELECTRICAL CHARACTERISTICS:																																																																																							
				TEMPERATURE:25±10°C, RELATIVE HUMIDITY:65±20%																																																																																							
				NO.	ITEM	TERMINAL	SPECIFICATION	TEST FREQUENCY	TEST EQUIPMENTS																																																																																		
1	IND.	S-F	4.0uH ± 10%Alone	100KHz/1.0V	LCR METER 106X																																																																																						
2	IND.	S-F	6.5uH ± 10%Attach magnetic sheets	100KHz/1.0V	LCR METER 106X																																																																																						
3	DCR	S-F	120mΩ Max	100KHz/1.0V	LCR METER 106X																																																																																						
PREPARED BY/DATE			CHECKED BY/DATE																																																																																								
陈诚佳2025/03/11			张燕 2025/03/11																																																																																								