

**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A: Test Setup Photo

FCC ID

A3LSMA047M

File No.

HCT-RF-2206-FC041-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC007-P
HCT-RF-2207-FC002-P	HCT-RF-2207-FC005-P	HCT-RF-2207-FC008-P
HCT-RF-2207-FC003-P	HCT-RF-2207-FC006-P	

REVISION HISTORY

The revision history for this document is shown in table.

Revision No.	Date of Issue	Description
0	July 14, 2022	Initial Release

File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		


1. Radiated Test Setup Photo




File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		




File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

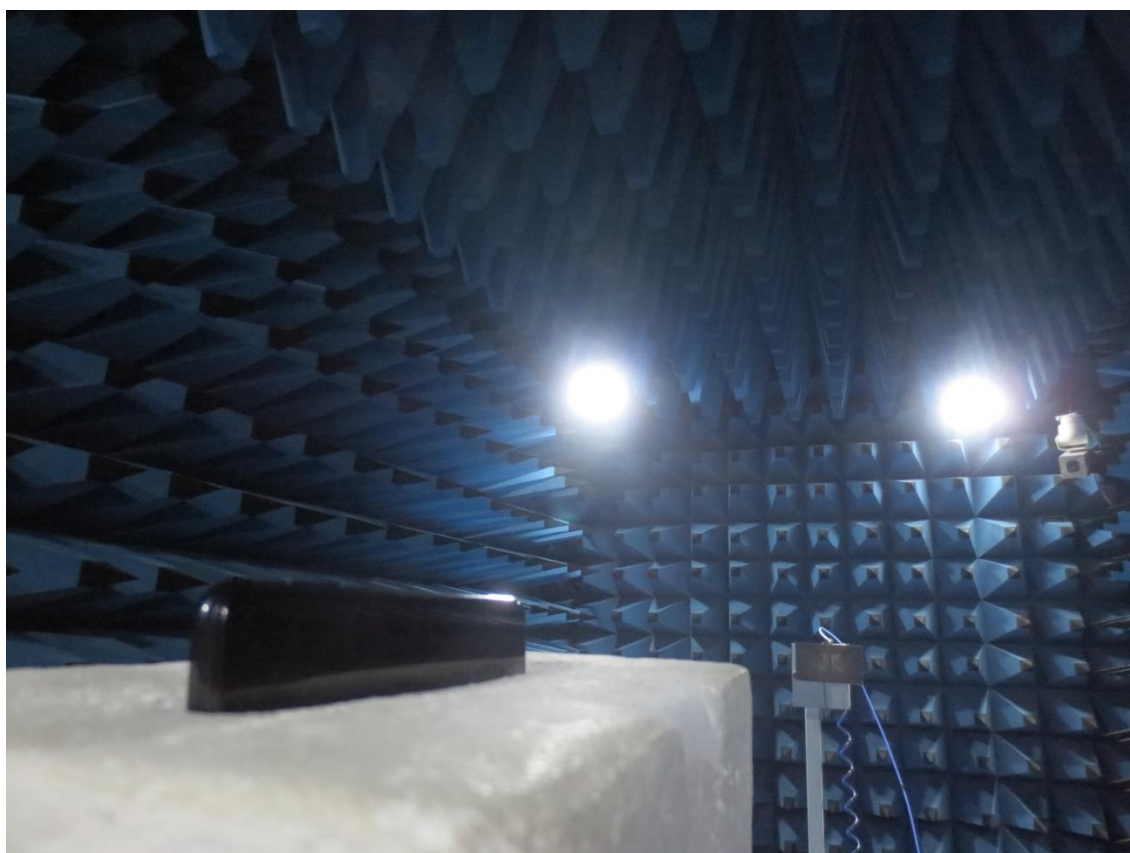


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

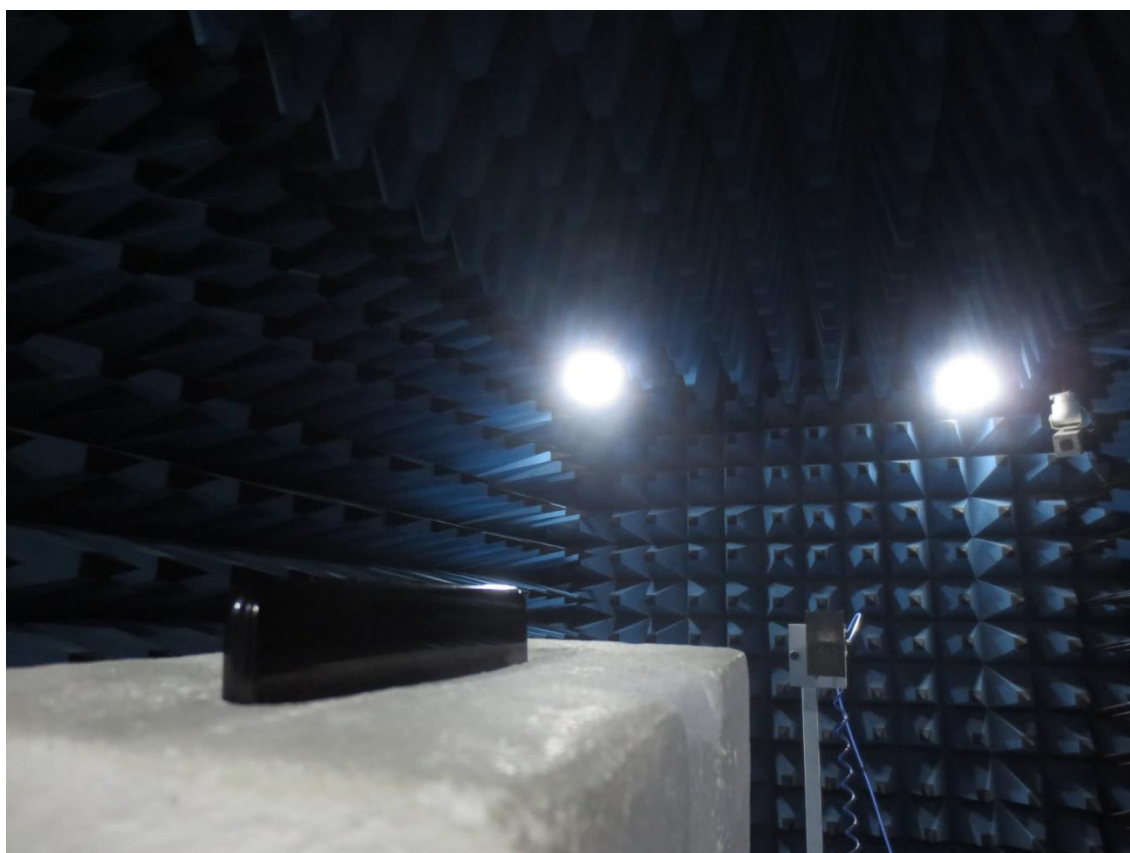


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

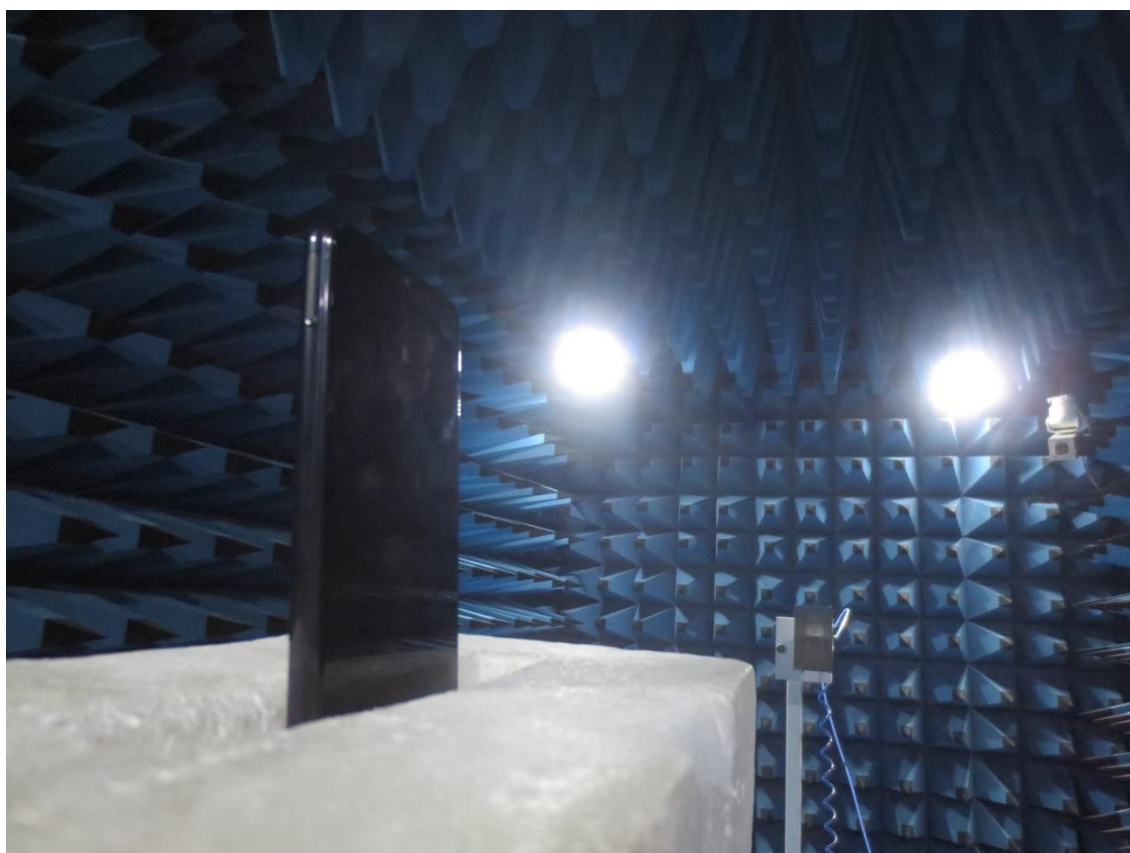


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

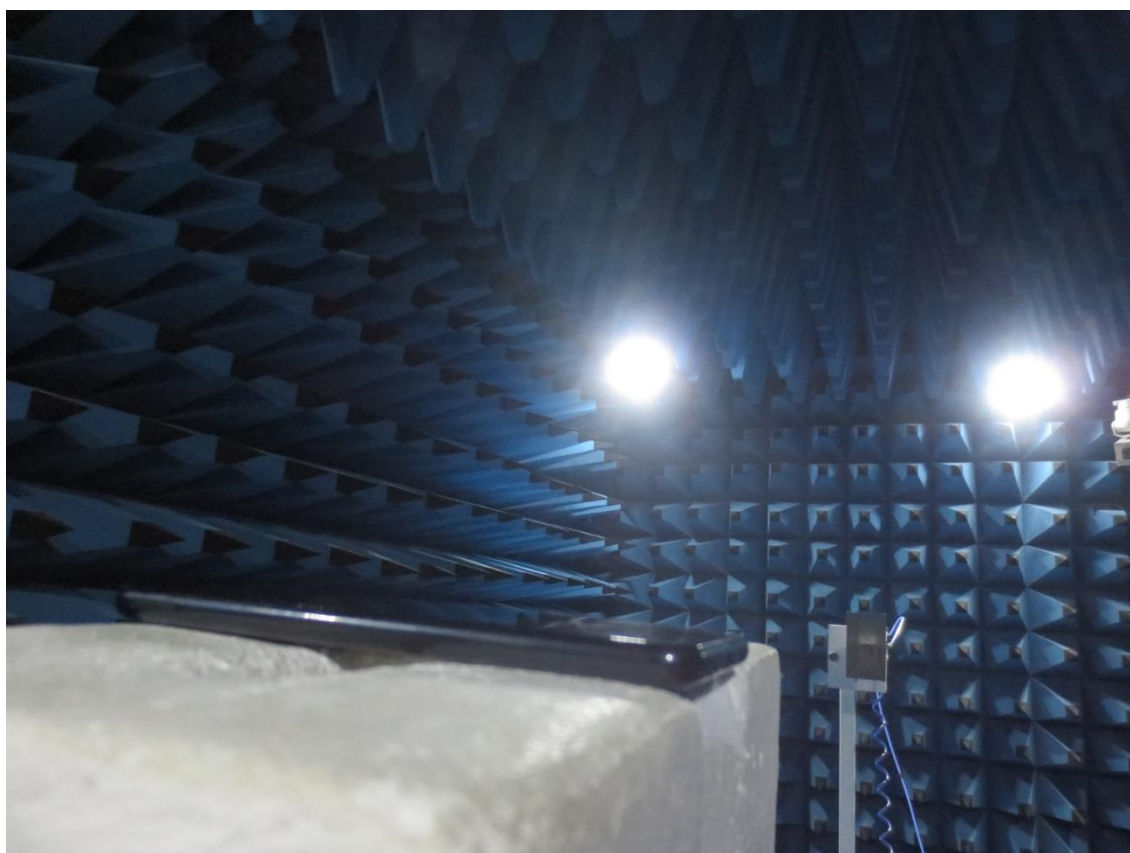

File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

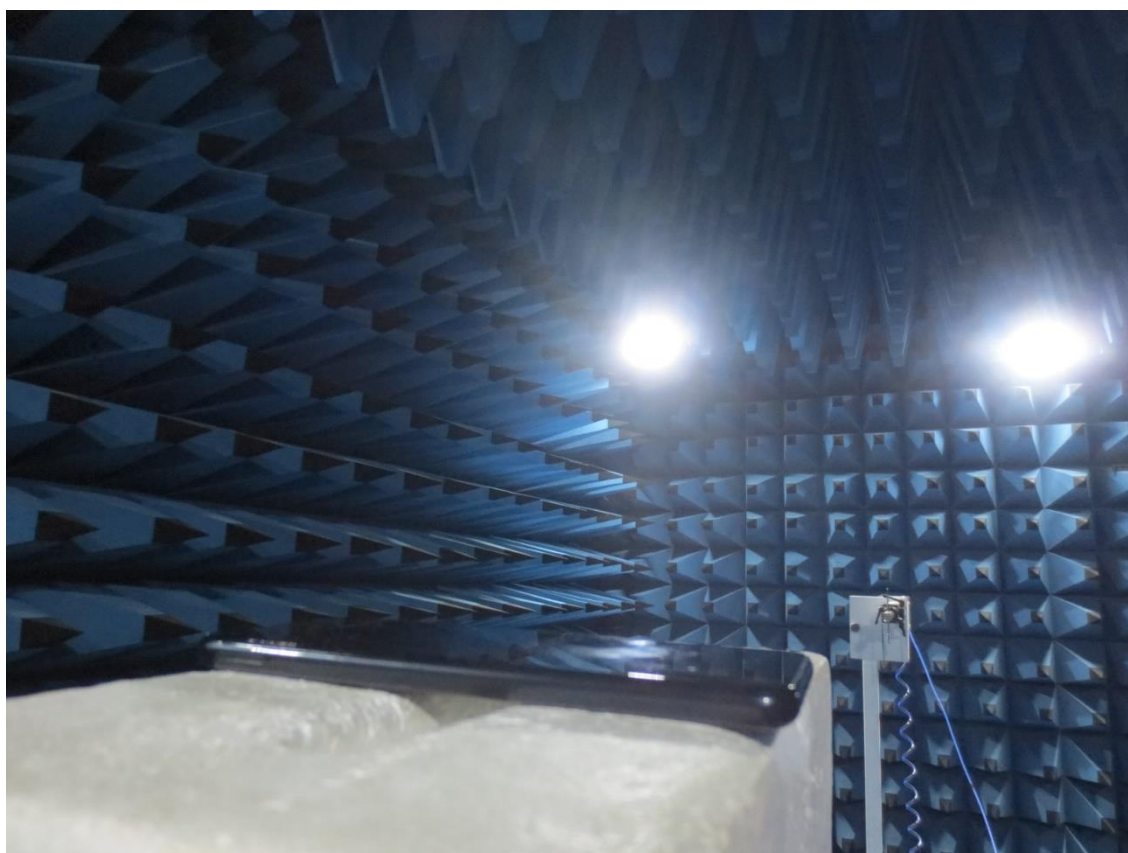


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

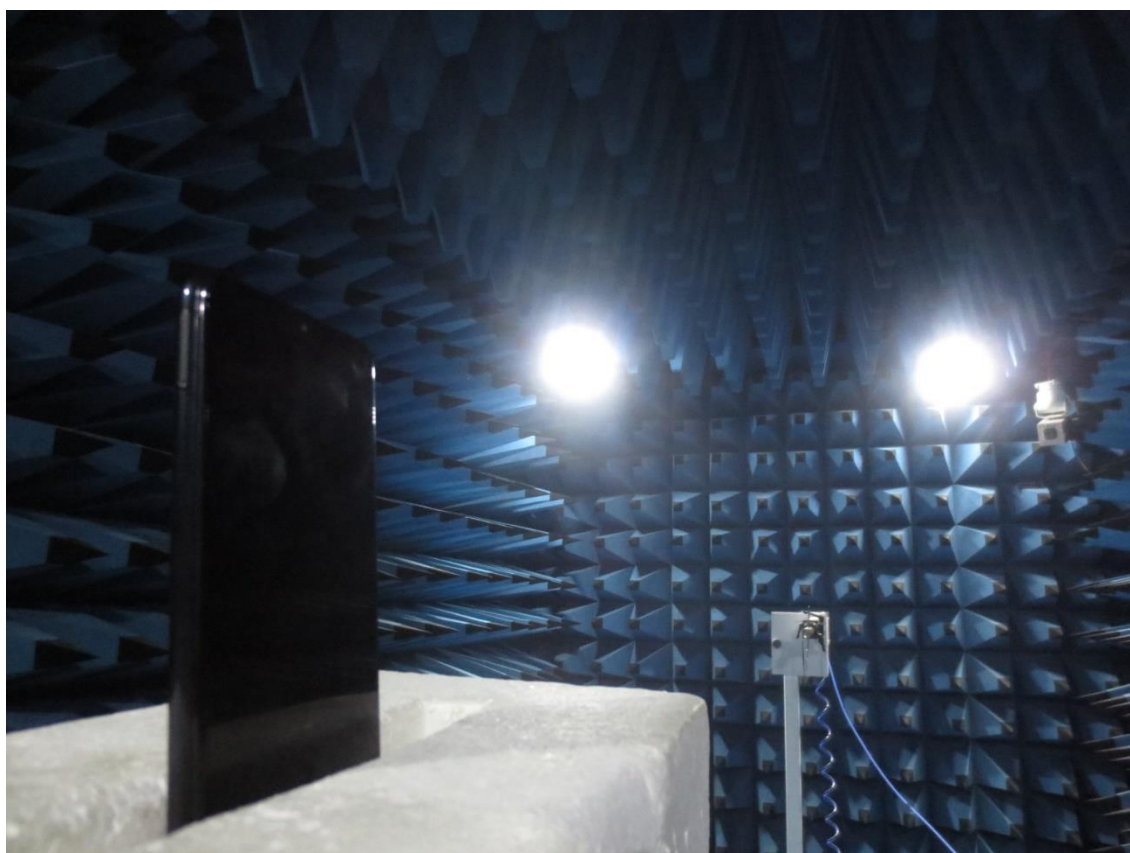


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		




File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

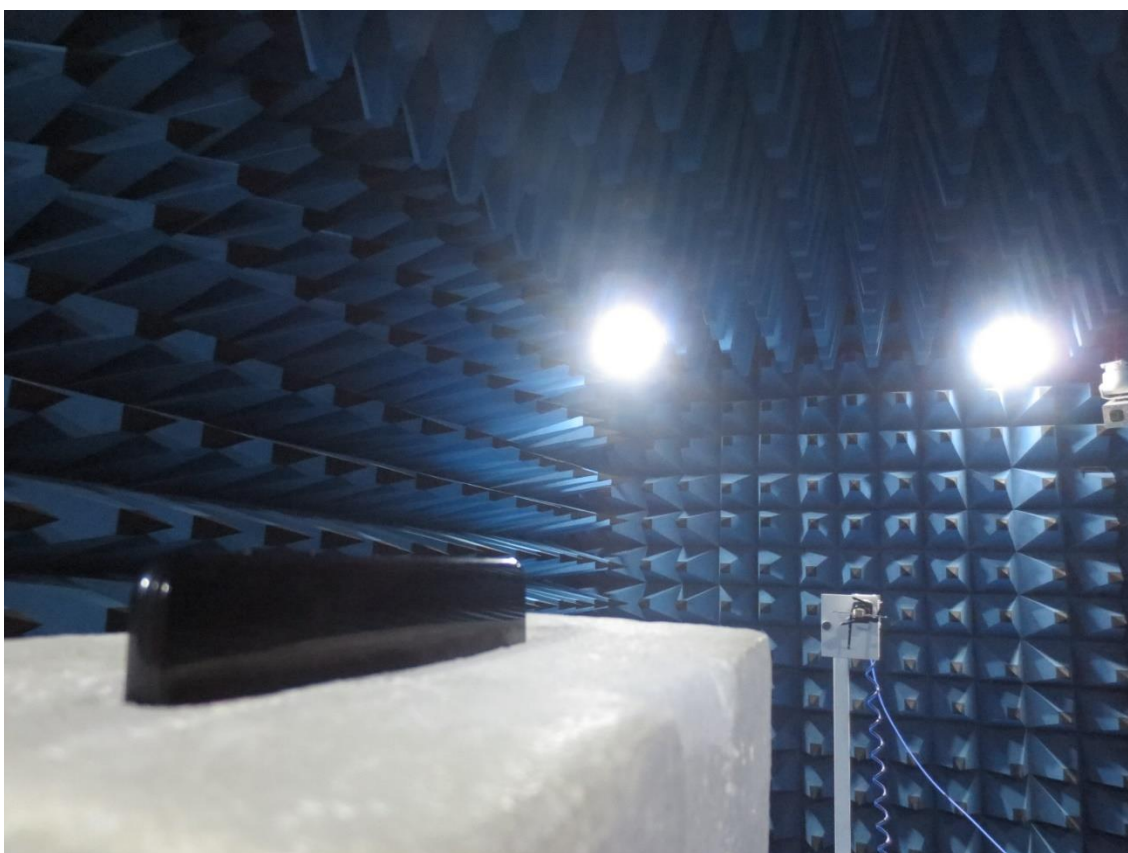

File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

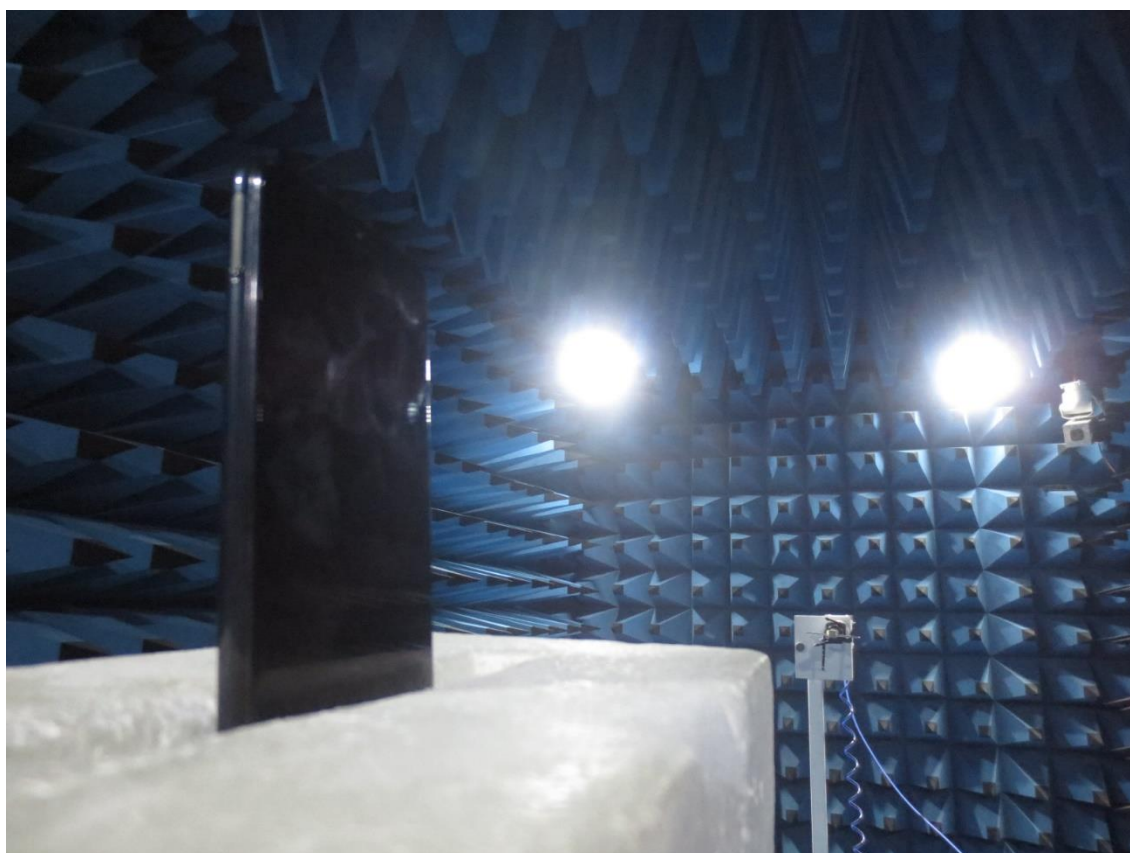


File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

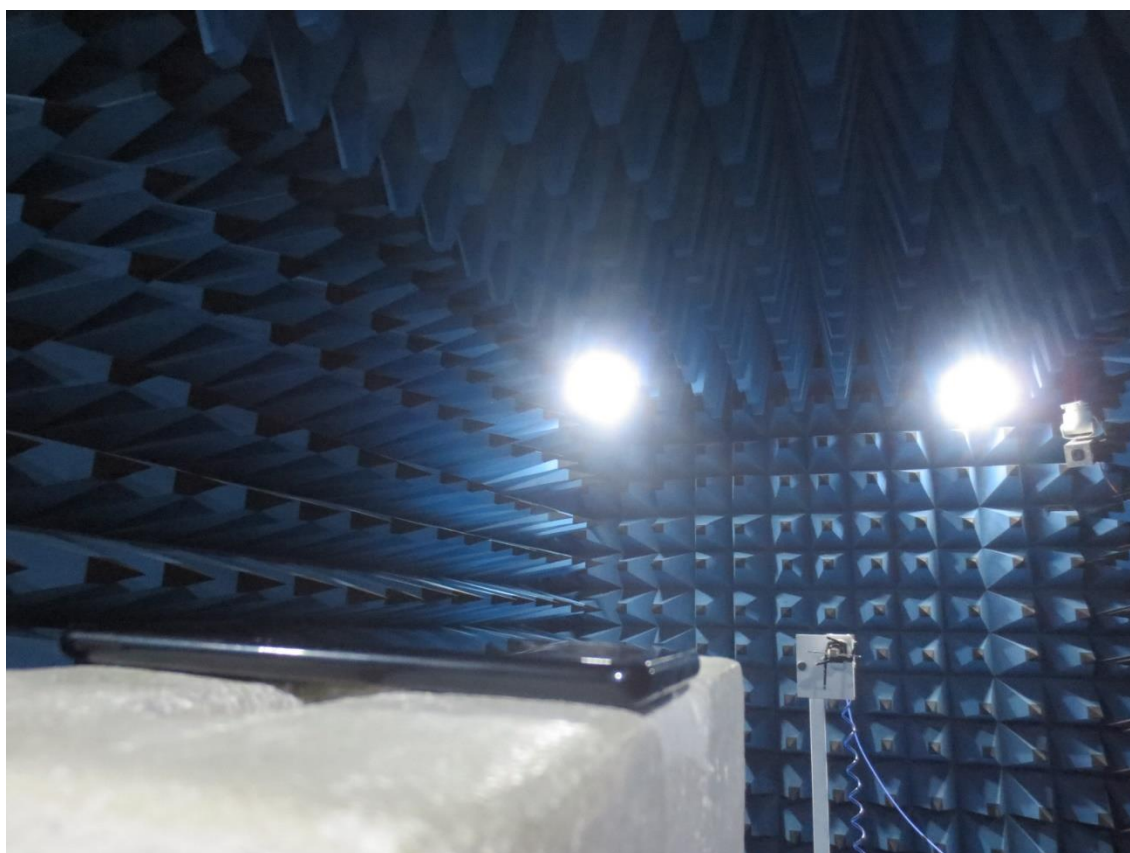

File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		

2. Conducted Test Setup Photo

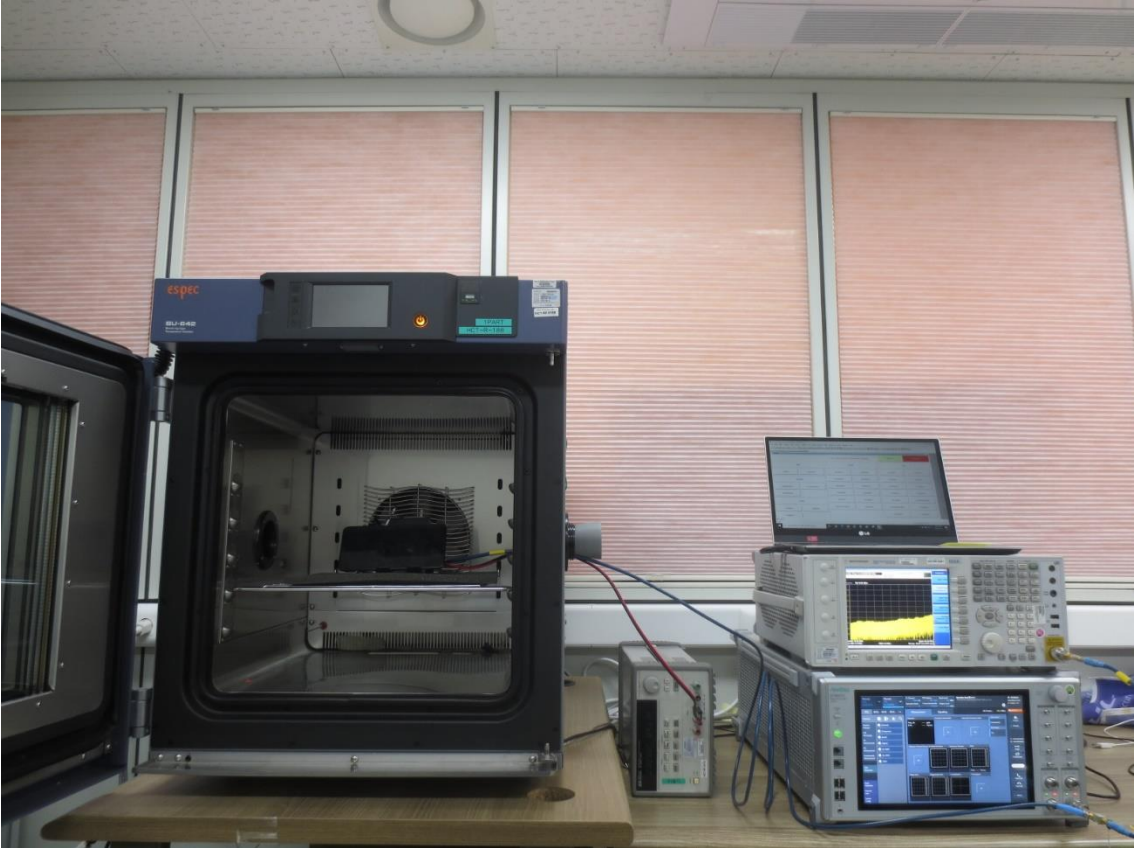

File	HCT-RF-2206-FC041-P	HCT-RF-2207-FC002-P	HCT-RF-2207-FC003-P	HCT-RF-2207-FC004-P	HCT-RF-2207-FC005-P
No.	HCT-RF-2207-FC006-P	HCT-RF-2207-FC007-P	HCT-RF-2207-FC008-P		