



HCT Co., Ltd.

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A:
Test Setup
Photo

FCC ID
A3LSMA155M

File No.		
HCT-RF-2311-FC001-P	HCT-RF-2311-FC005-P	HCT-RF-2311-FC008-P
HCT-RF-2311-FC002-P	HCT-RF-2311-FC006-P	HCT-RF-2311-FC009-P
HCT-RF-2311-FC003-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC010-P
HCT-RF-2311-FC004-P		


REVISION HISTORY

The revision history for this document is shown in table.

Revision No.	Date of Issue	Description
0	November 06, 2023	Initial Release

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

1. Radiated Test Setup Photo

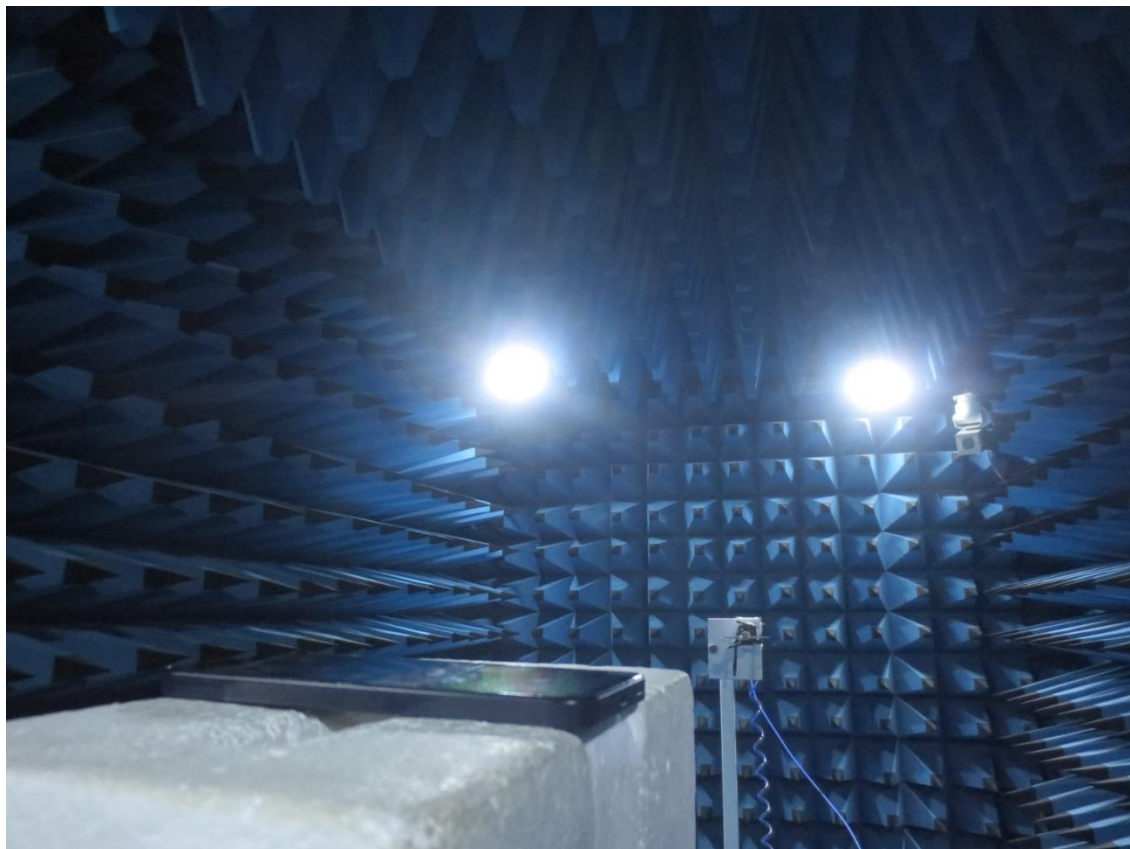

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P




File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P




File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P




File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

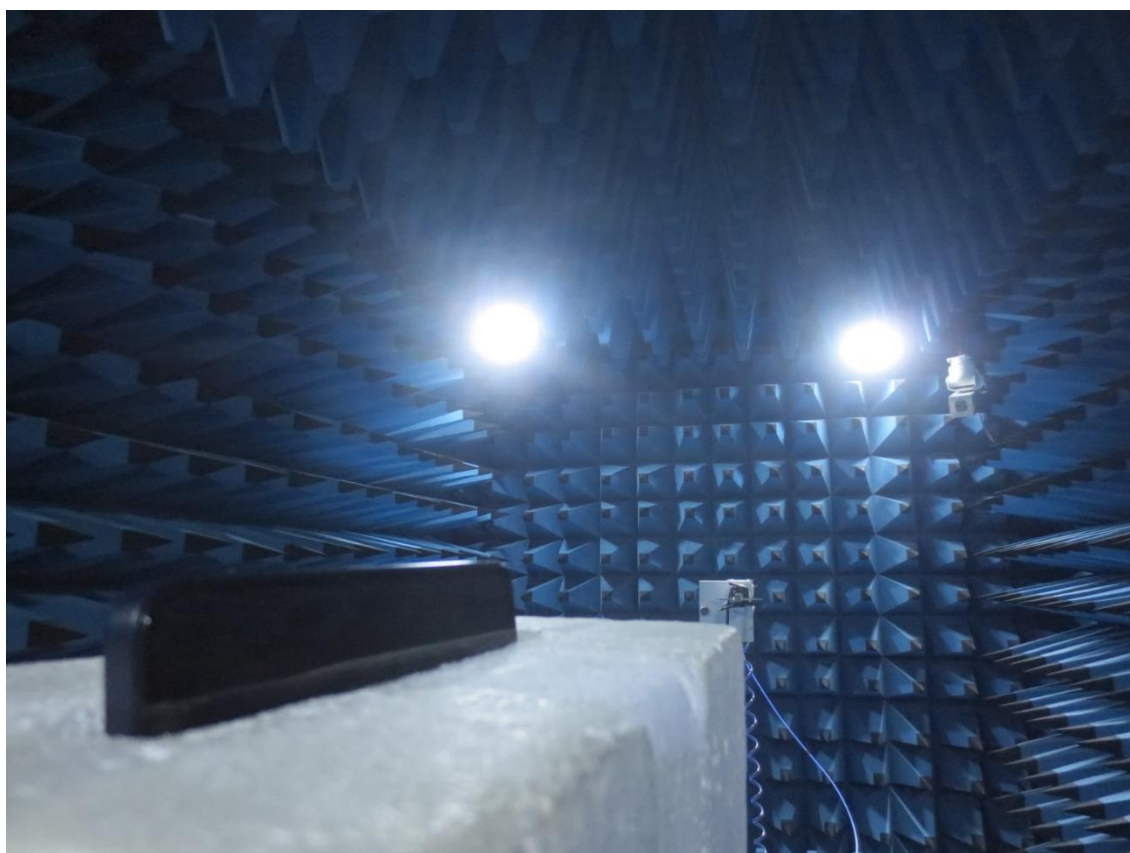

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

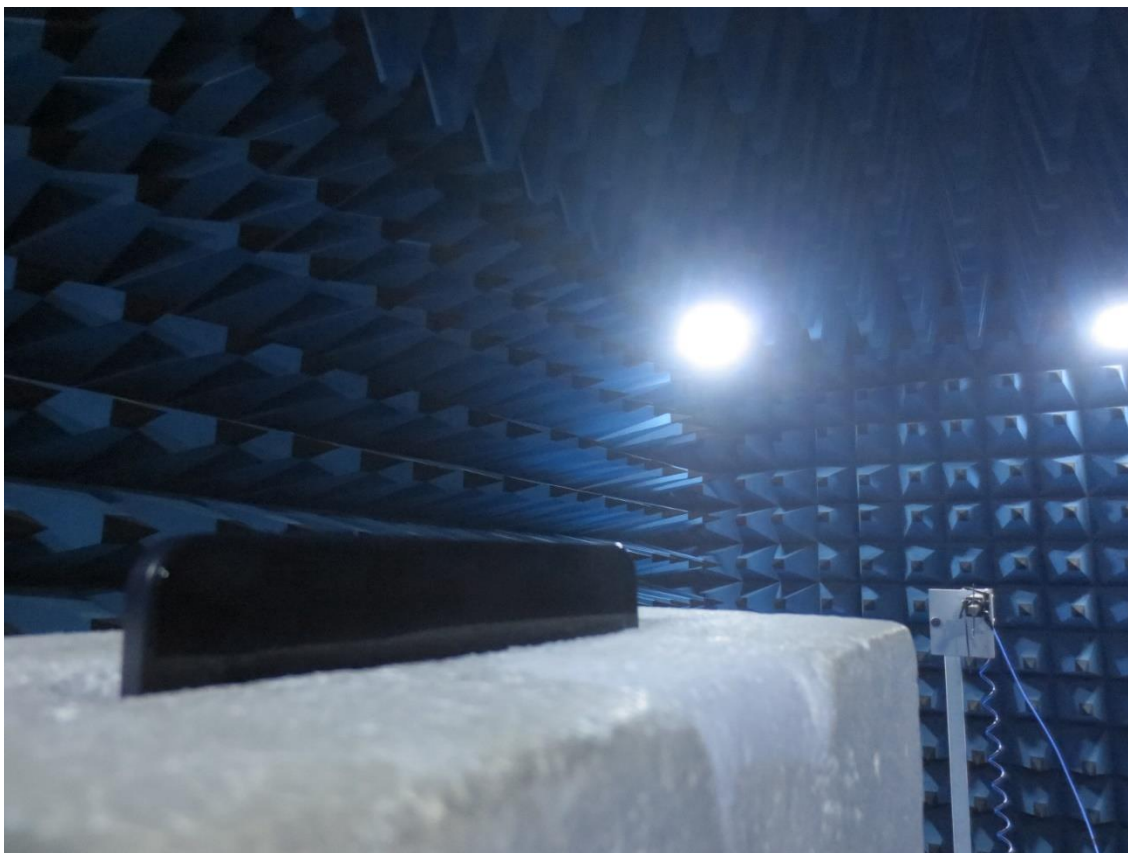

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

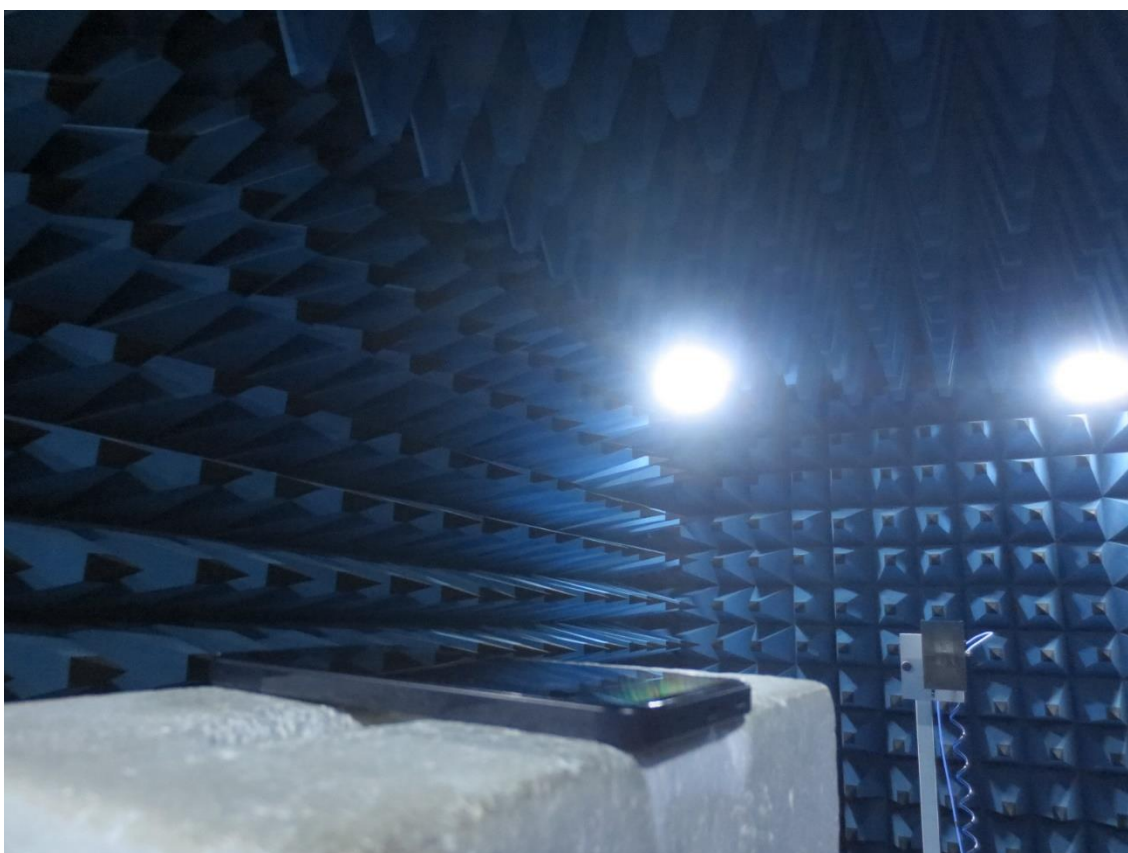


File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P



File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P




File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

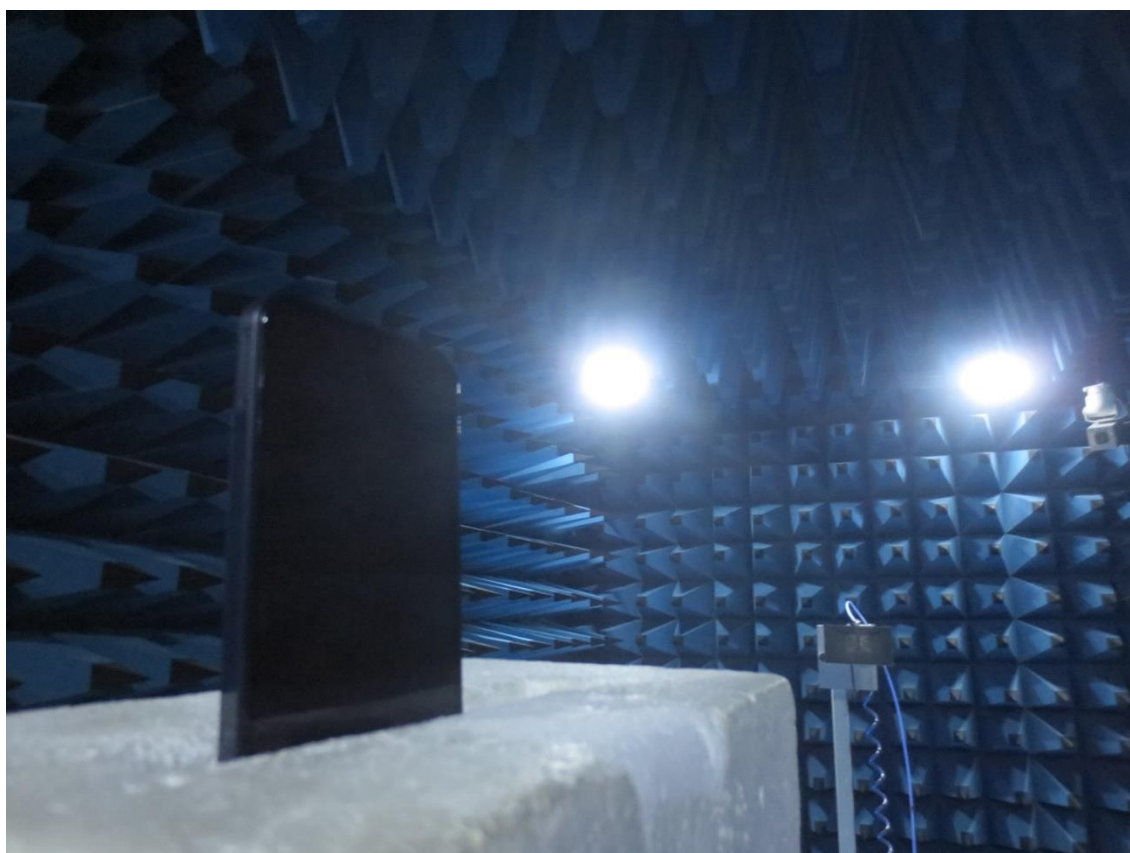

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P




File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

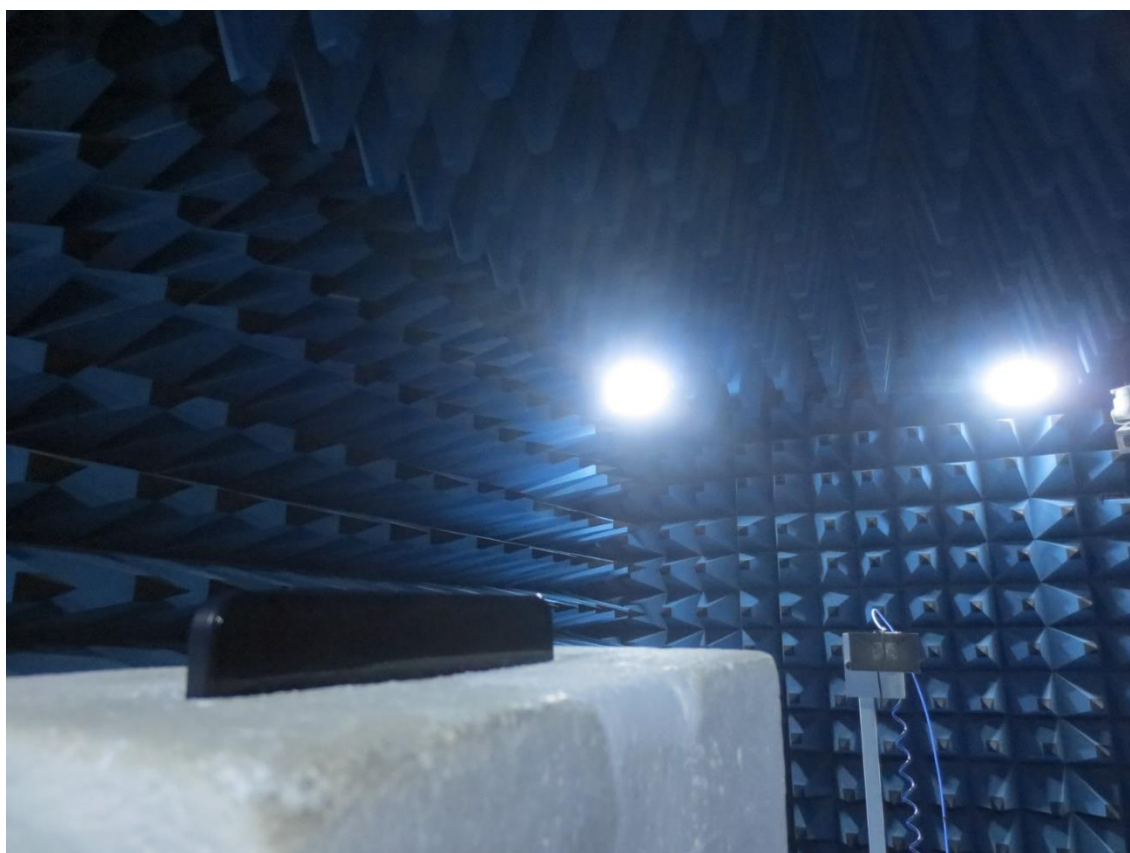

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P

2. Conducted Test Setup Photo

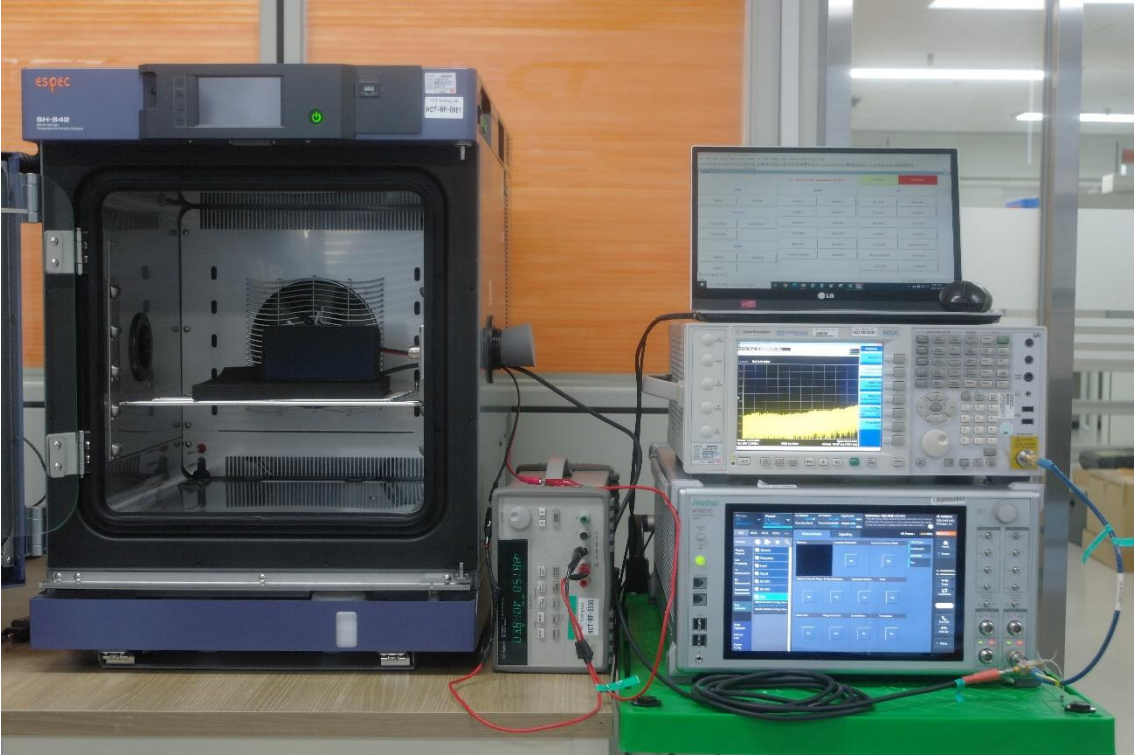

File	HCT-RF-2311-FC001-P	HCT-RF-2311-FC002-P	HCT-RF-2311-FC003-P	HCT-RF-2311-FC004-P	HCT-RF-2311-FC005-P
No.	HCT-RF-2311-FC006-P	HCT-RF-2311-FC007-P	HCT-RF-2311-FC008-P	HCT-RF-2311-FC009-P	HCT-RF-2311-FC010-P