

**HCT Co., Ltd.**

74, Seoicheon-ro 578beon-gil, Majang-myeon, Icheon-si, Gyeonggi-do, 17383 KOREA
Tel. +82 31 634 6300 Fax. +82 31 645 6401

Appendix A: Test Setup Photo

FCC ID
A3LSMA908B

File No.

HCT-RF-1908-FC042-P	HCT-RF-1908-FC047-P
HCT-RF-1908-FC043-P	HCT-RF-1908-FC048-P
HCT-RF-1908-FC044-P	HCT-RF-1908-FC049-P
HCT-RF-1908-FC045-P	HCT-RF-1908-FC050-P
HCT-RF-1908-FC046-P	

REVISION HISTORY

The revision history for this document is shown in table.


Revision No.	Date of Issue	Description
0	August 27, 2019	Initial Release

File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

1. Radiated Test Setup Photo



File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

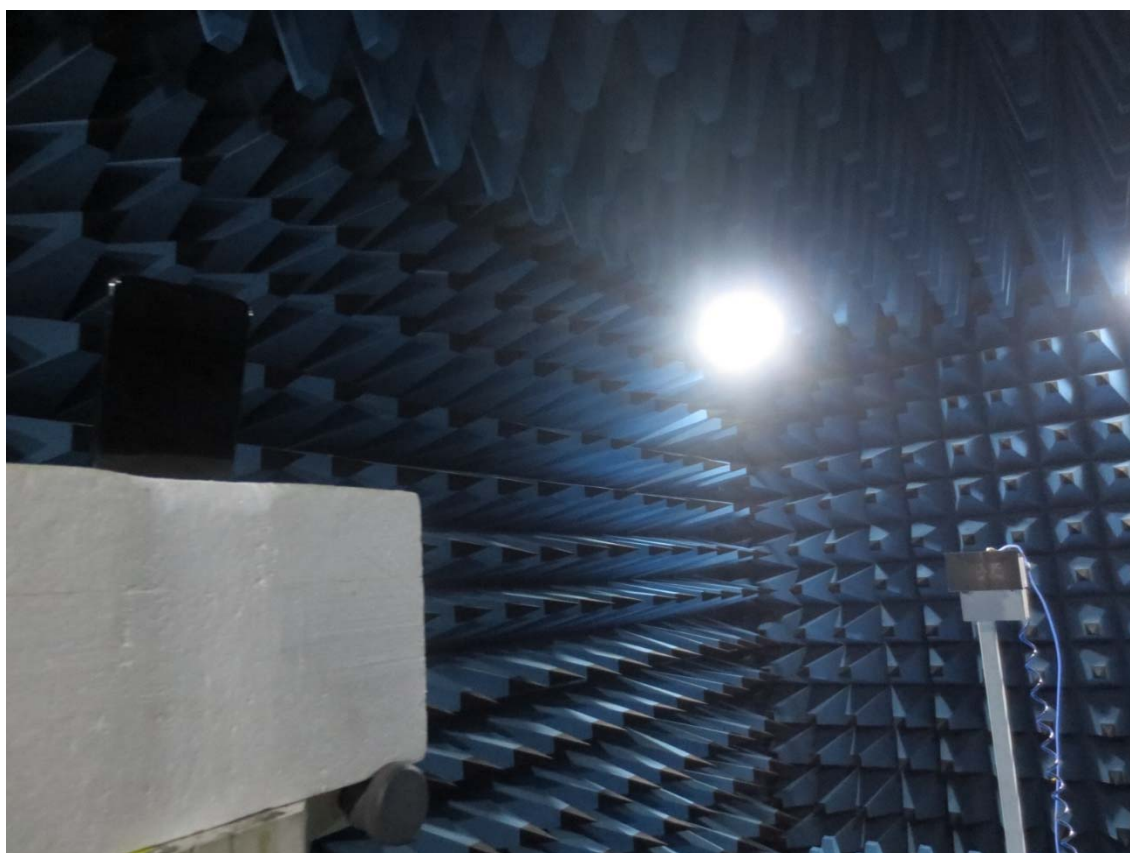


File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	



File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	



File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

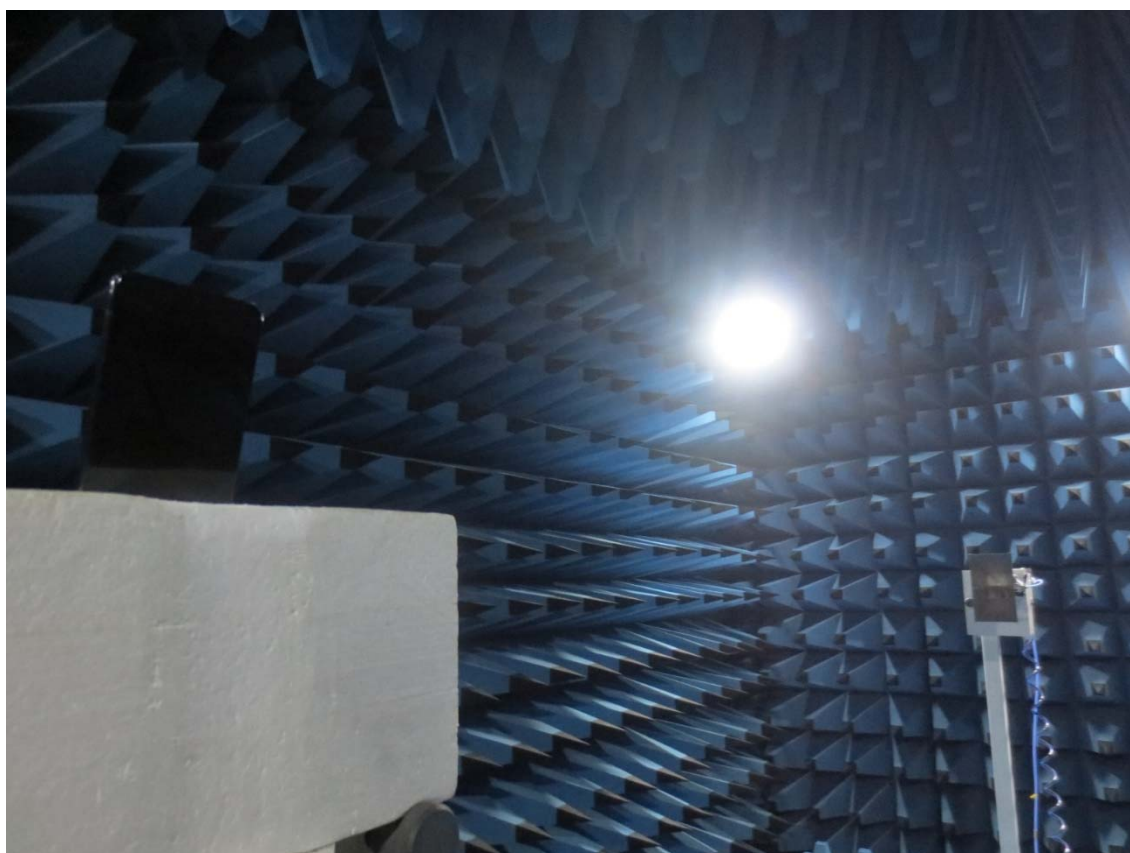


File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	




File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	




File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

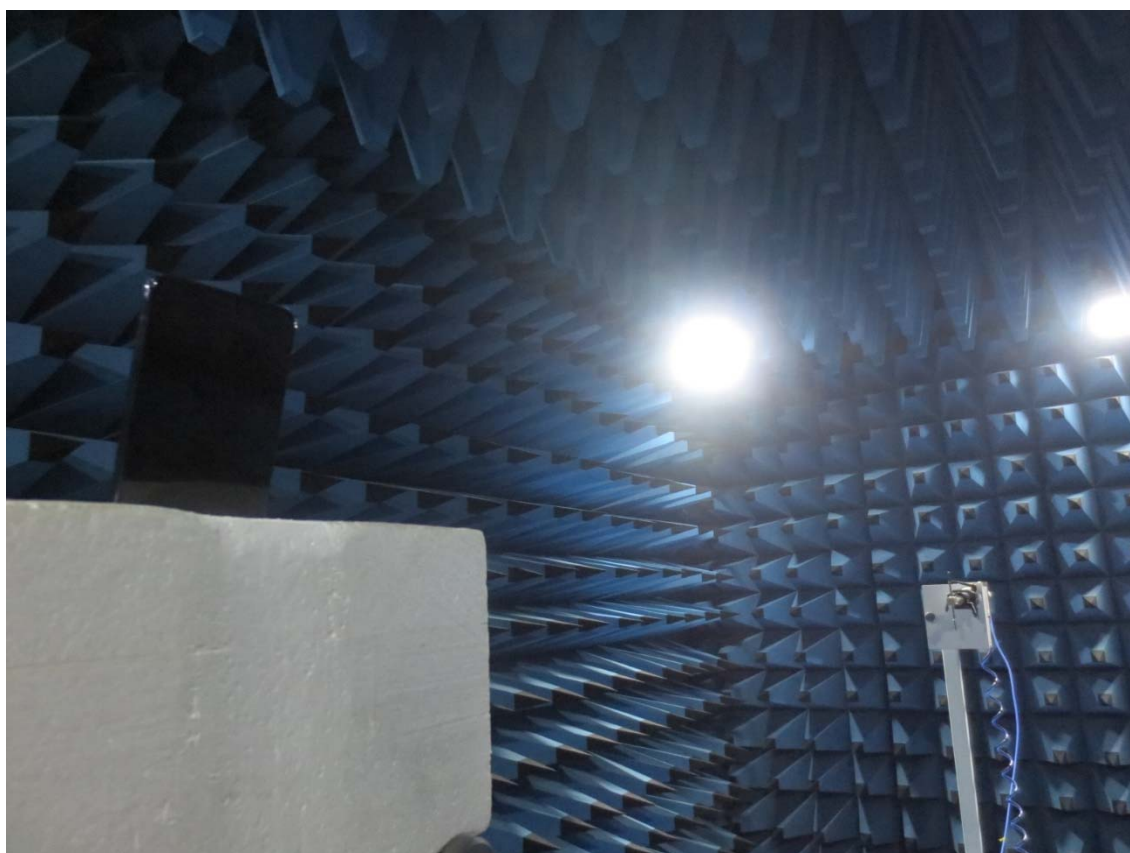

File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

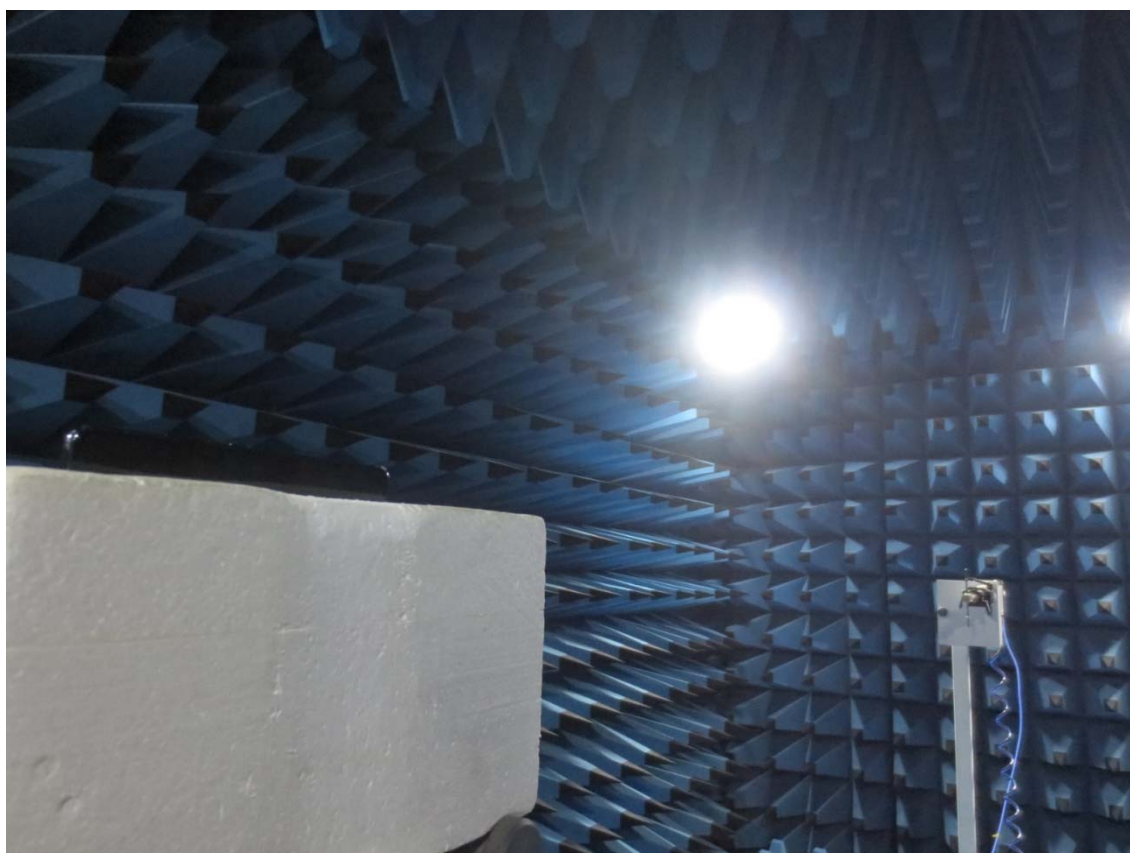

File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

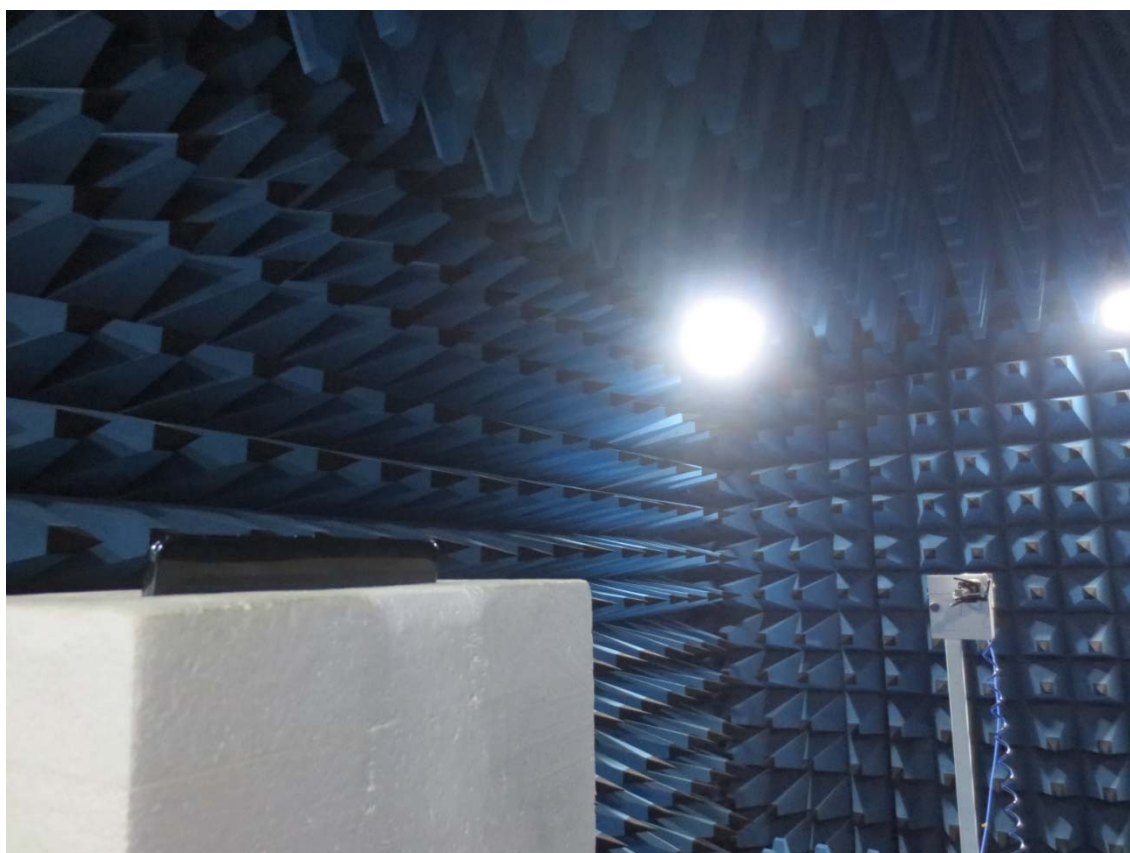

File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	




File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	



File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	

2. Conducted Test Setup Photo

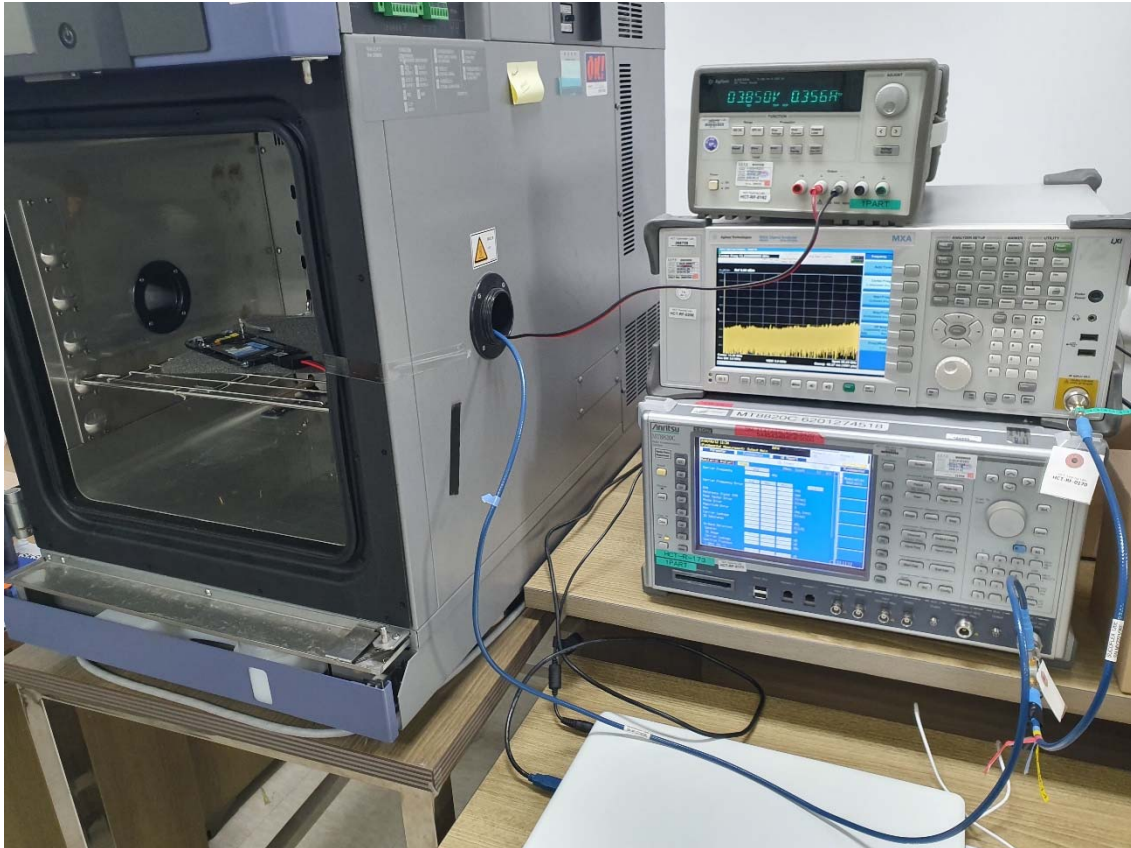

File	HCT-RF-1908-FC042-P	HCT-RF-1908-FC043-P	HCT-RF-1908-FC044-P	HCT-RF-1908-FC045-P	HCT-RF-1908-FC046-P
No.	HCT-RF-1908-FC047-P	HCT-RF-1908-FC048-P	HCT-RF-1908-FC049-P	HCT-RF-1908-FC050-P	