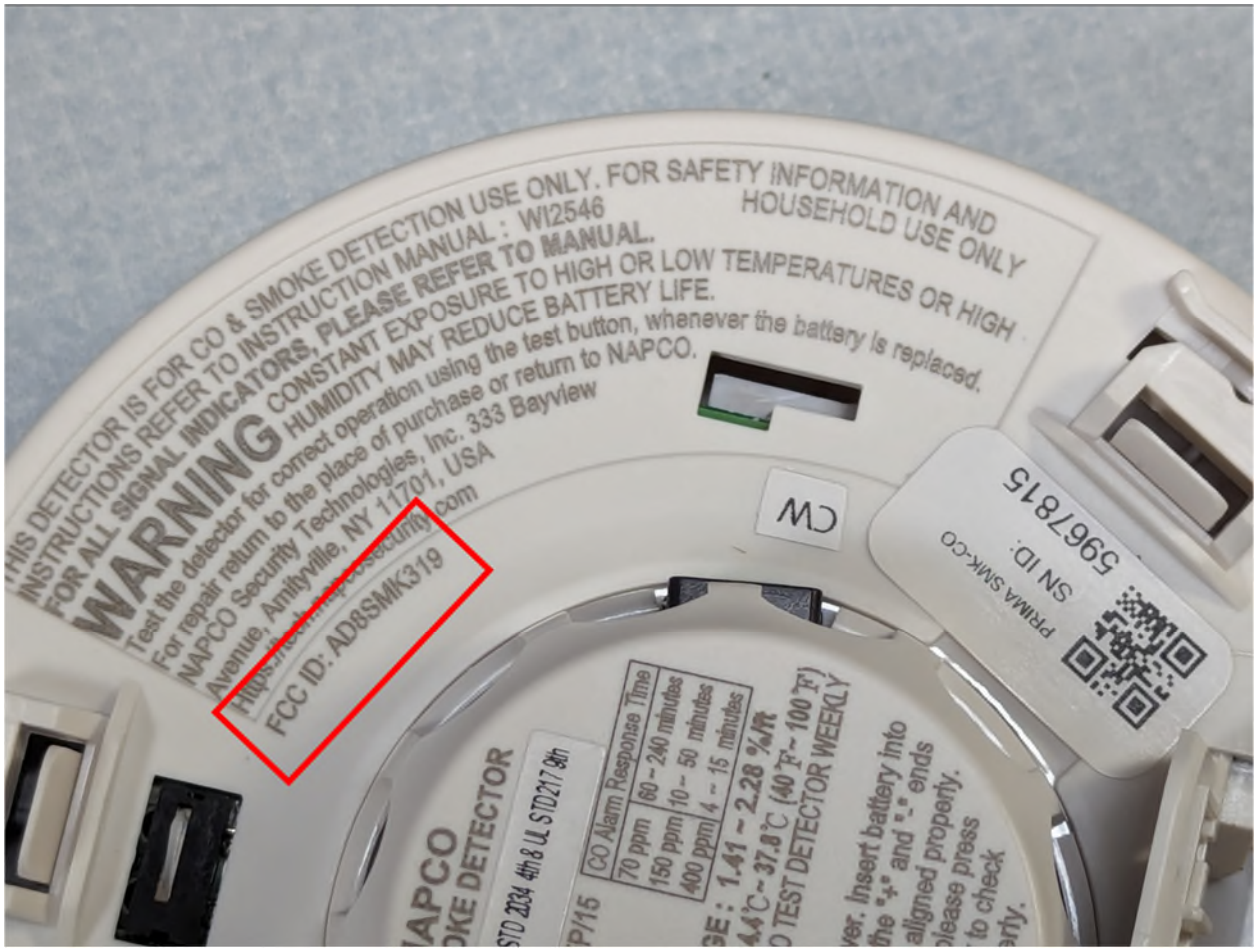
THIS DETECTOR IS FOR CO & SMOKE DETECTION USE ONLY. FOR SAFETY INFORMATION AND
INSTRUCTIONS REFER TO INSTRUCTION MANUAL : WI2546
HOUSEHOLD USE ONLY
FOR ALL SIGNAL INDICATORS, PLEASE REFER TO MANUAL.
WARNING CONSTANT EXPOSURE TO HIGH OR LOW TEMPERATURES OR HIGH HUMIDITY MAY REDUCE BATTERY LIFE.
Test the detector for correct operation using the test button, whenever the battery is replaced.
For repair return to the place of purchase or return to NAPCO.
NAPCO Security Technologies, Inc. 333 Bayview Avenue, Amityville, NY 11701, USA
https://tech.napcosecurity.com
FCC ID: AD8SMK319
PRIMA SMK-CO
SN ID: 59678 15
CW
APCO
KE DETECTOR
STD 2034 4th & UL STD 217 9th
P/15
CO Alarm Response Time
70 ppm 60 ~ 240 minutes
150 ppm 10 ~ 50 minutes
400 ppm 4 ~ 15 minutes
GE : 1.41 ~ 2.28 %/ft
4.4℃ ~ 37.8℃ (40 ℉ ~ 100 ℉)
O TEST DETECTOR WEEKLY
ver. Insert battery into
the "+" and "-" ends
aligned property.
please press
to check
arty.