


L1942S Block diagram

INPUT: 120V 60Hz

FUNDAMENTAL OPERATION FREQUENCY IS 0.030-0.083 MHz .

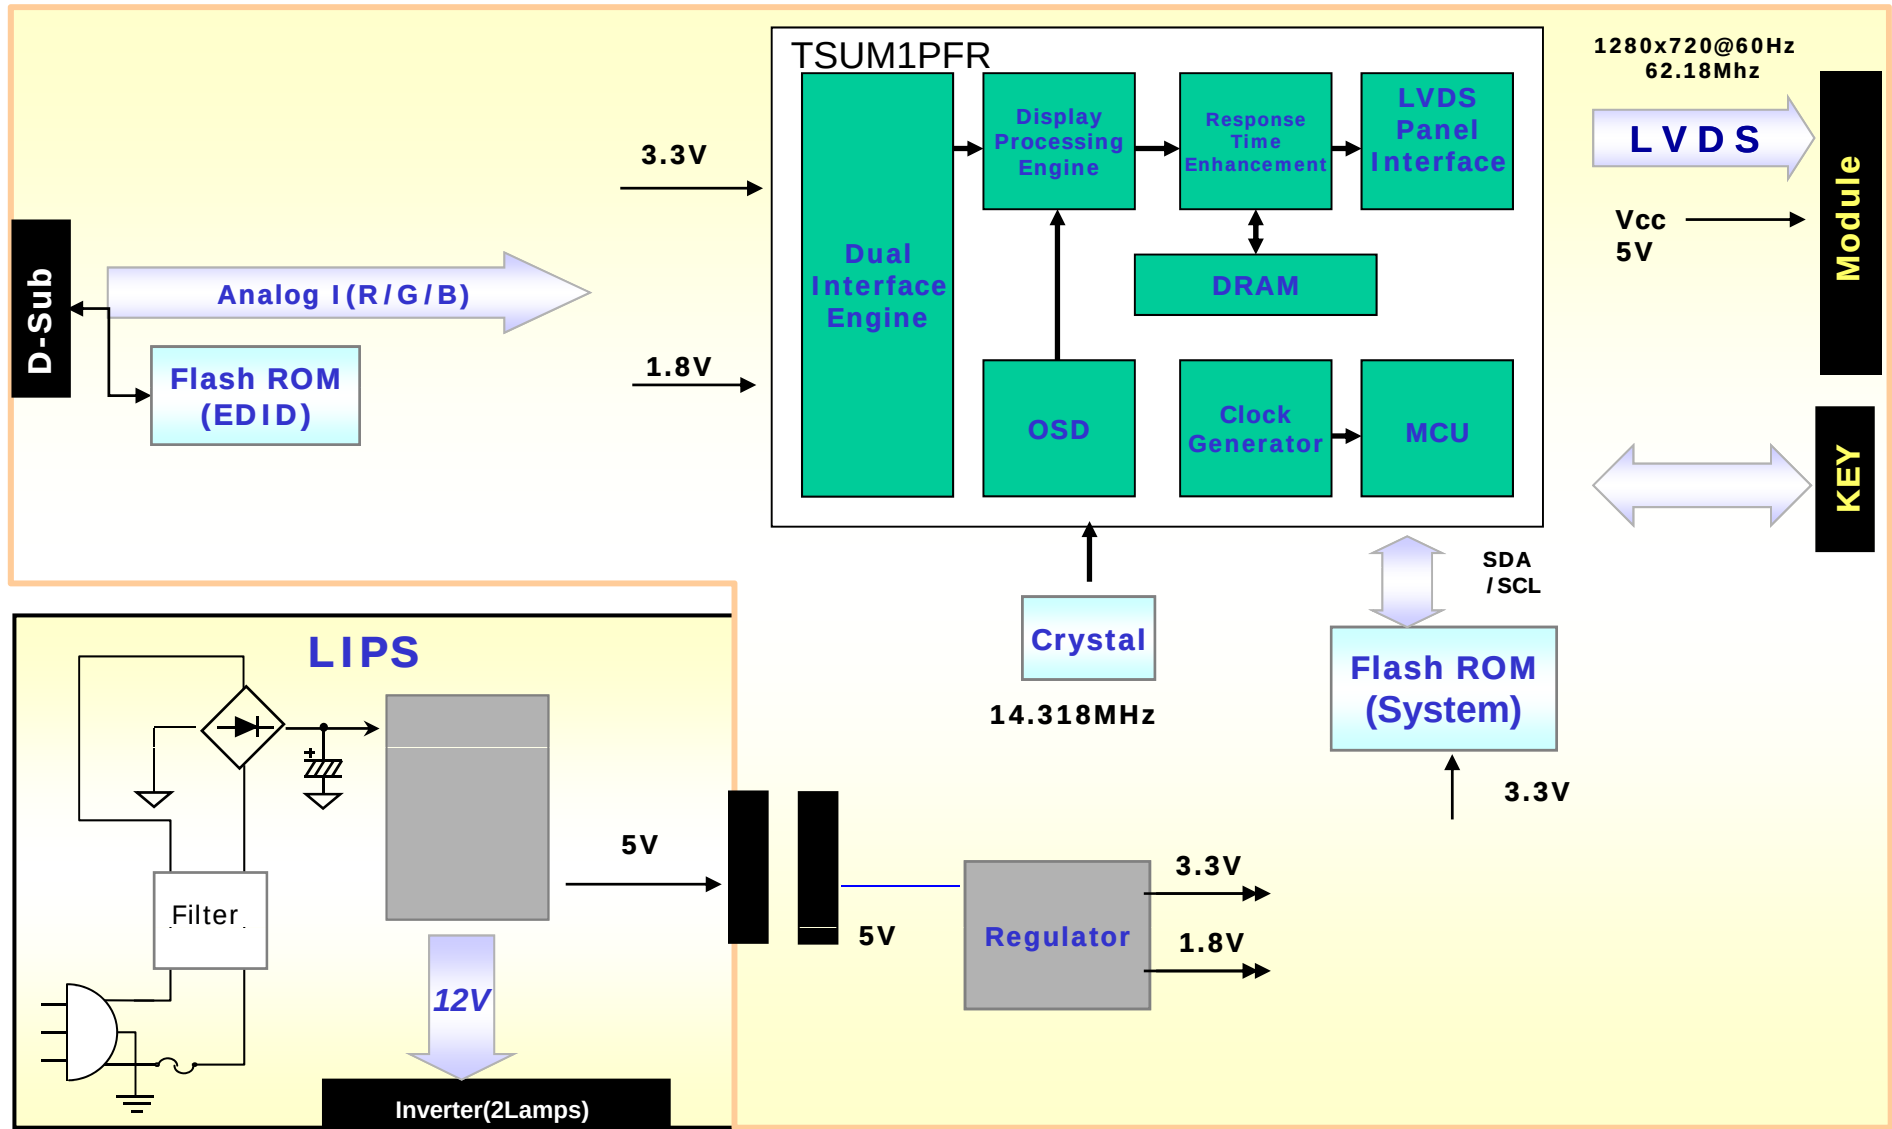

Crystal: HLX-U-F ; HC-49/U (alternate)

Regulation: 14.31818MHz+/- 30PPM