


POWER SUPPLY BLOCK DIAGRAM


HOT CIRCUIT. BE CAREFUL AND USE AN ISOLATION TRANSFORMER WHEN SERVICING

NOTE : IF YOU CHECK THE VOLTAGE FOR PARTS IN HOT CIRCUIT. YOU MUST USE PRIMARY GND AS A COMMON TERMINAL

HOT

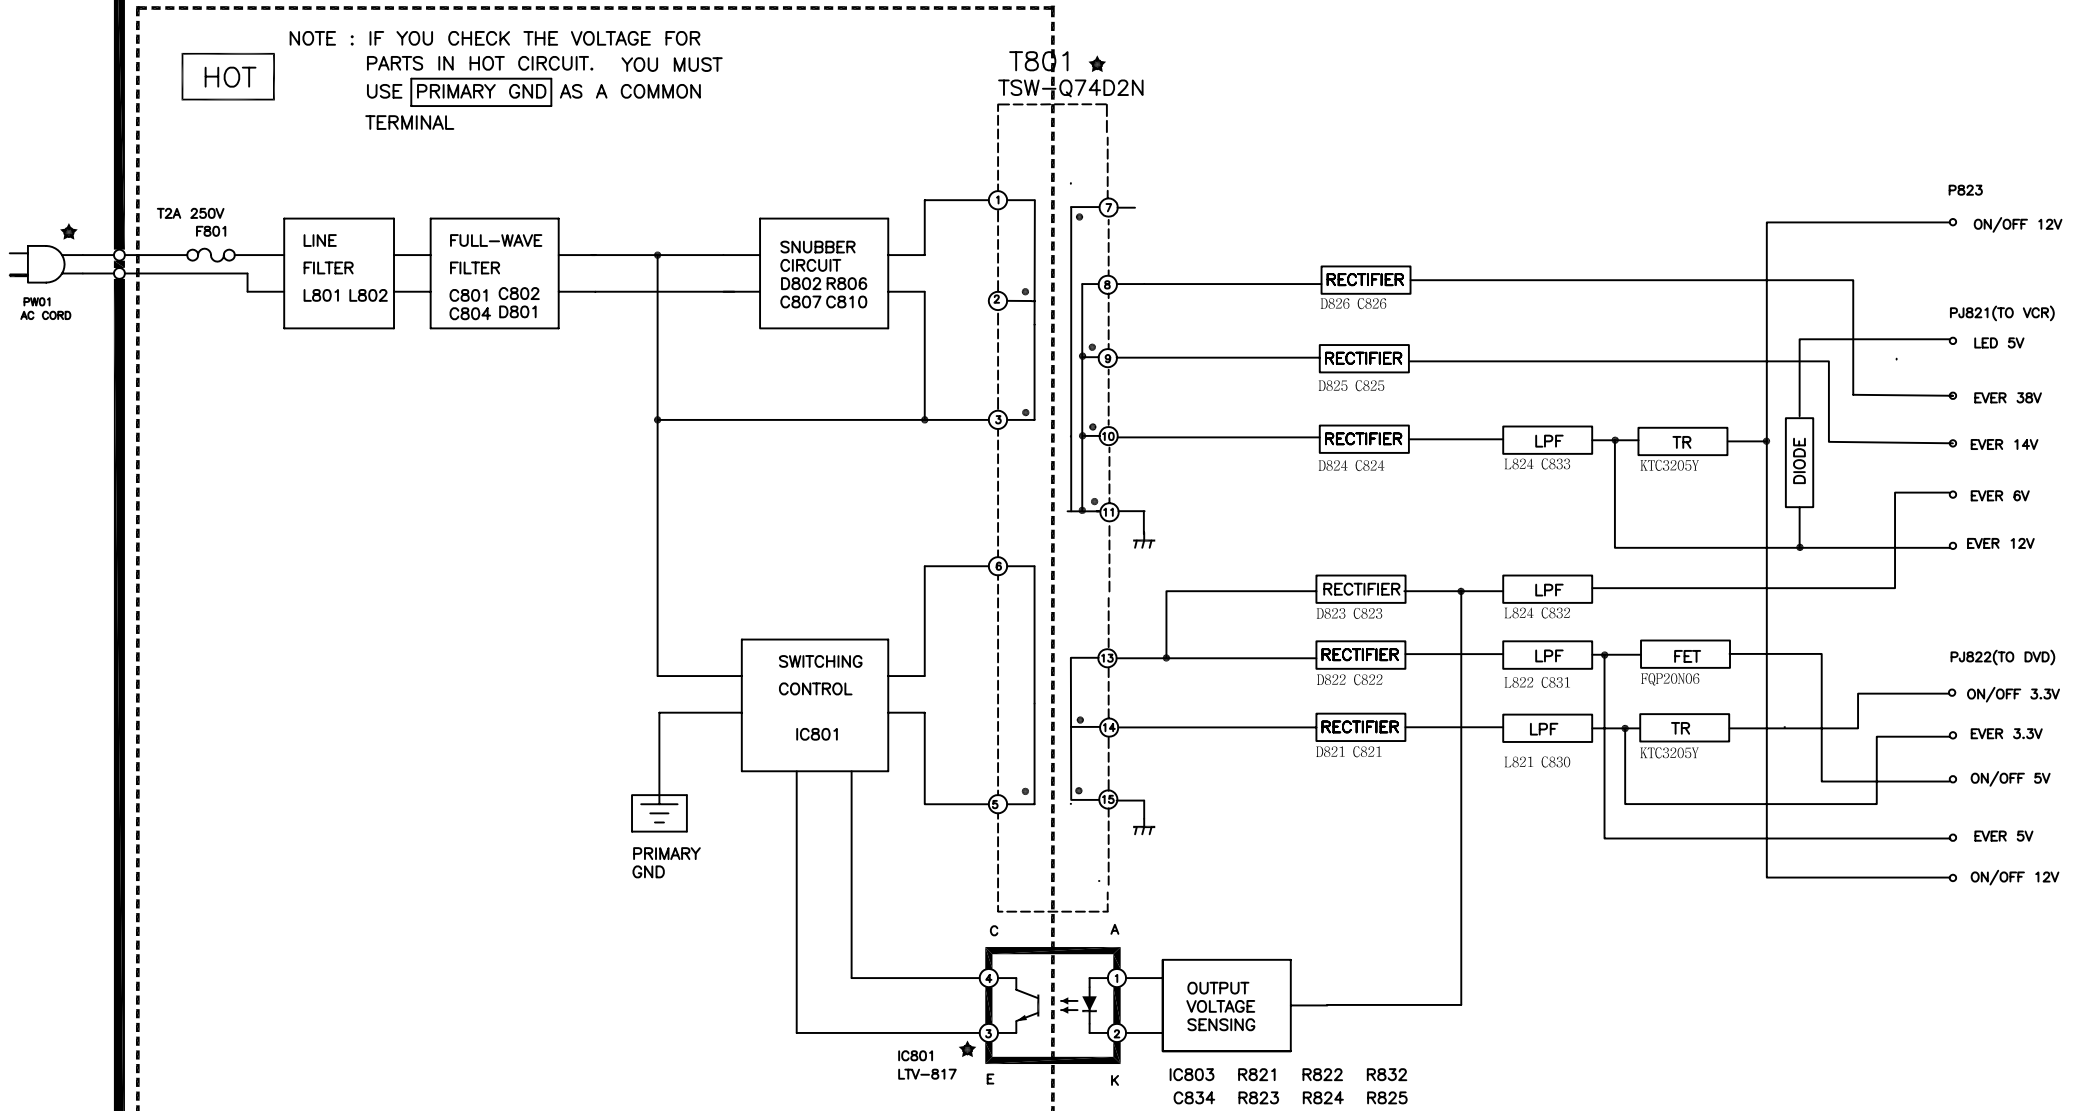


VCR_PART_BLOCK_DIAGRAM

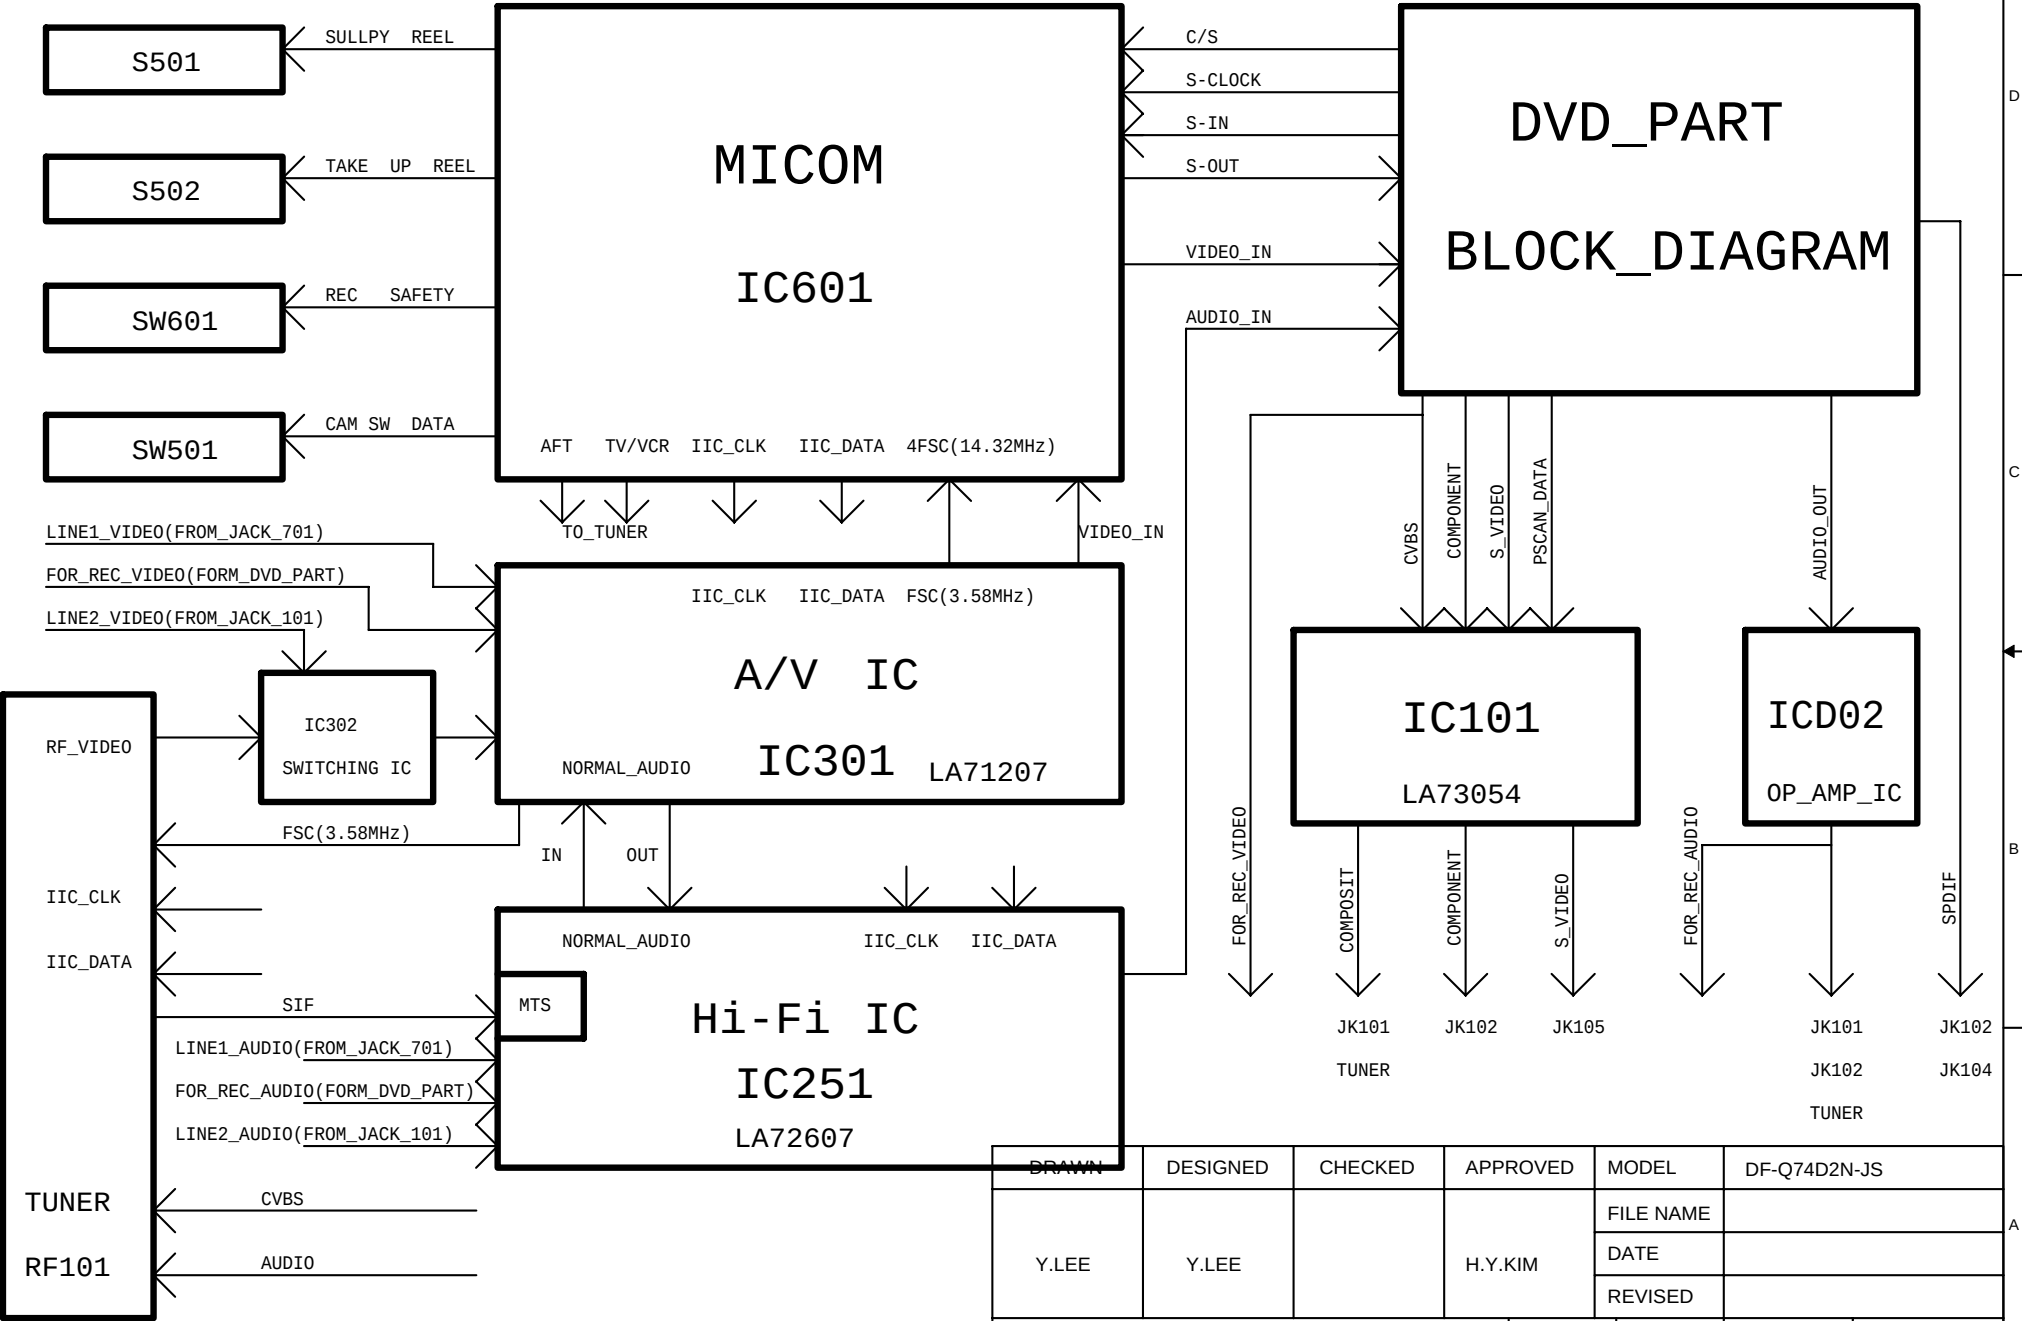

DRAWN	DESIGNED	CHECKED	APPROVED	MODEL	DF-Q74D2N-JS	
Y.LEE	Y.LEE		H.Y.KIM	FILE NAME		
				DATE		
				REVISED		
3 Team			REV NO.		SHEET	/
DAEWOO ELECTRONICS Digital Video Lab.			VCR PART BLOCK DIAGRAM			

DVD_PART_BLOCK_DIAGRAM

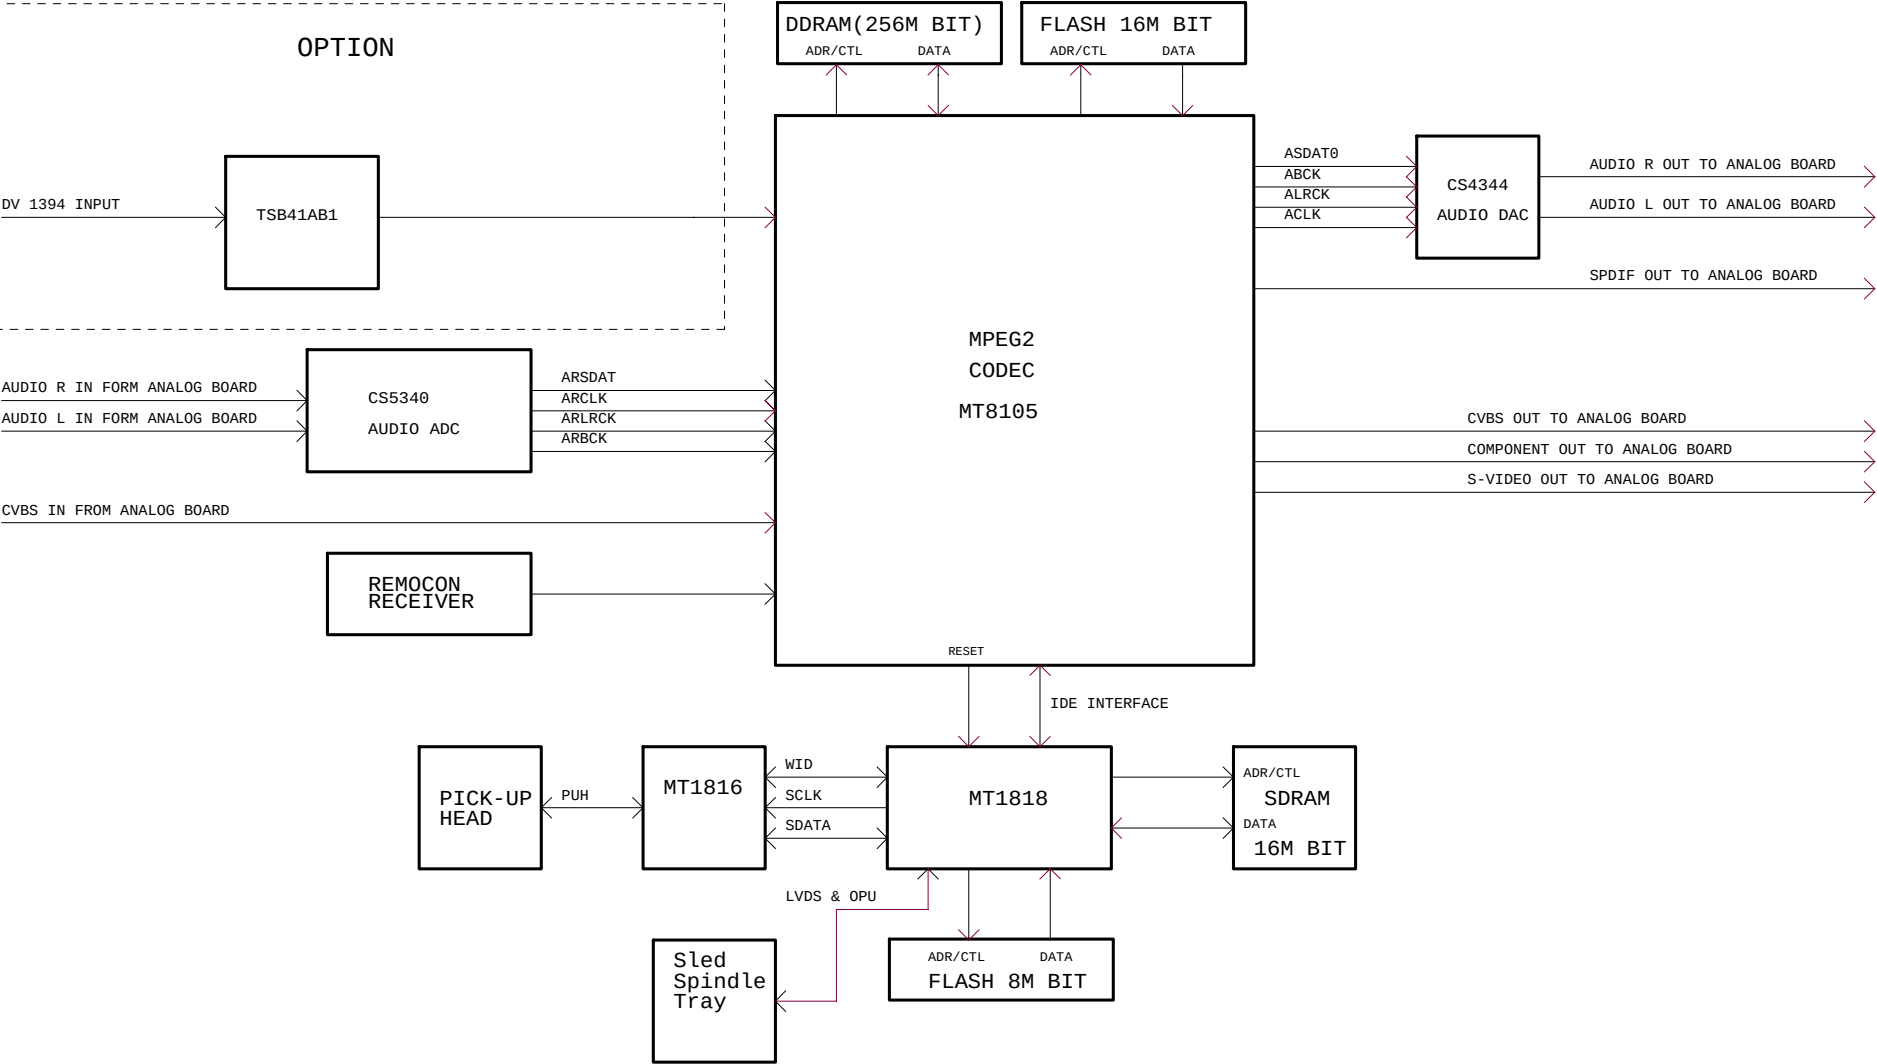

DRAWN	DESIGNED	CHECKED	APPROVED	MODEL	< MODEL NAME >	
				FILE NAME	<FILE NAME>	
				DATE	Monday, February 28, 2005	
<DRAWN>	<DESIGNED>	<CHECKED>	<APPROVED>	REVISED	<REVISED>	
1 Team			REV NO.	<REV NO.>	SHEET	1 / 9
DAEWOO ELECTRONICS Digital Media Lab.			01 : Figaro_2 COVER PAGE			