


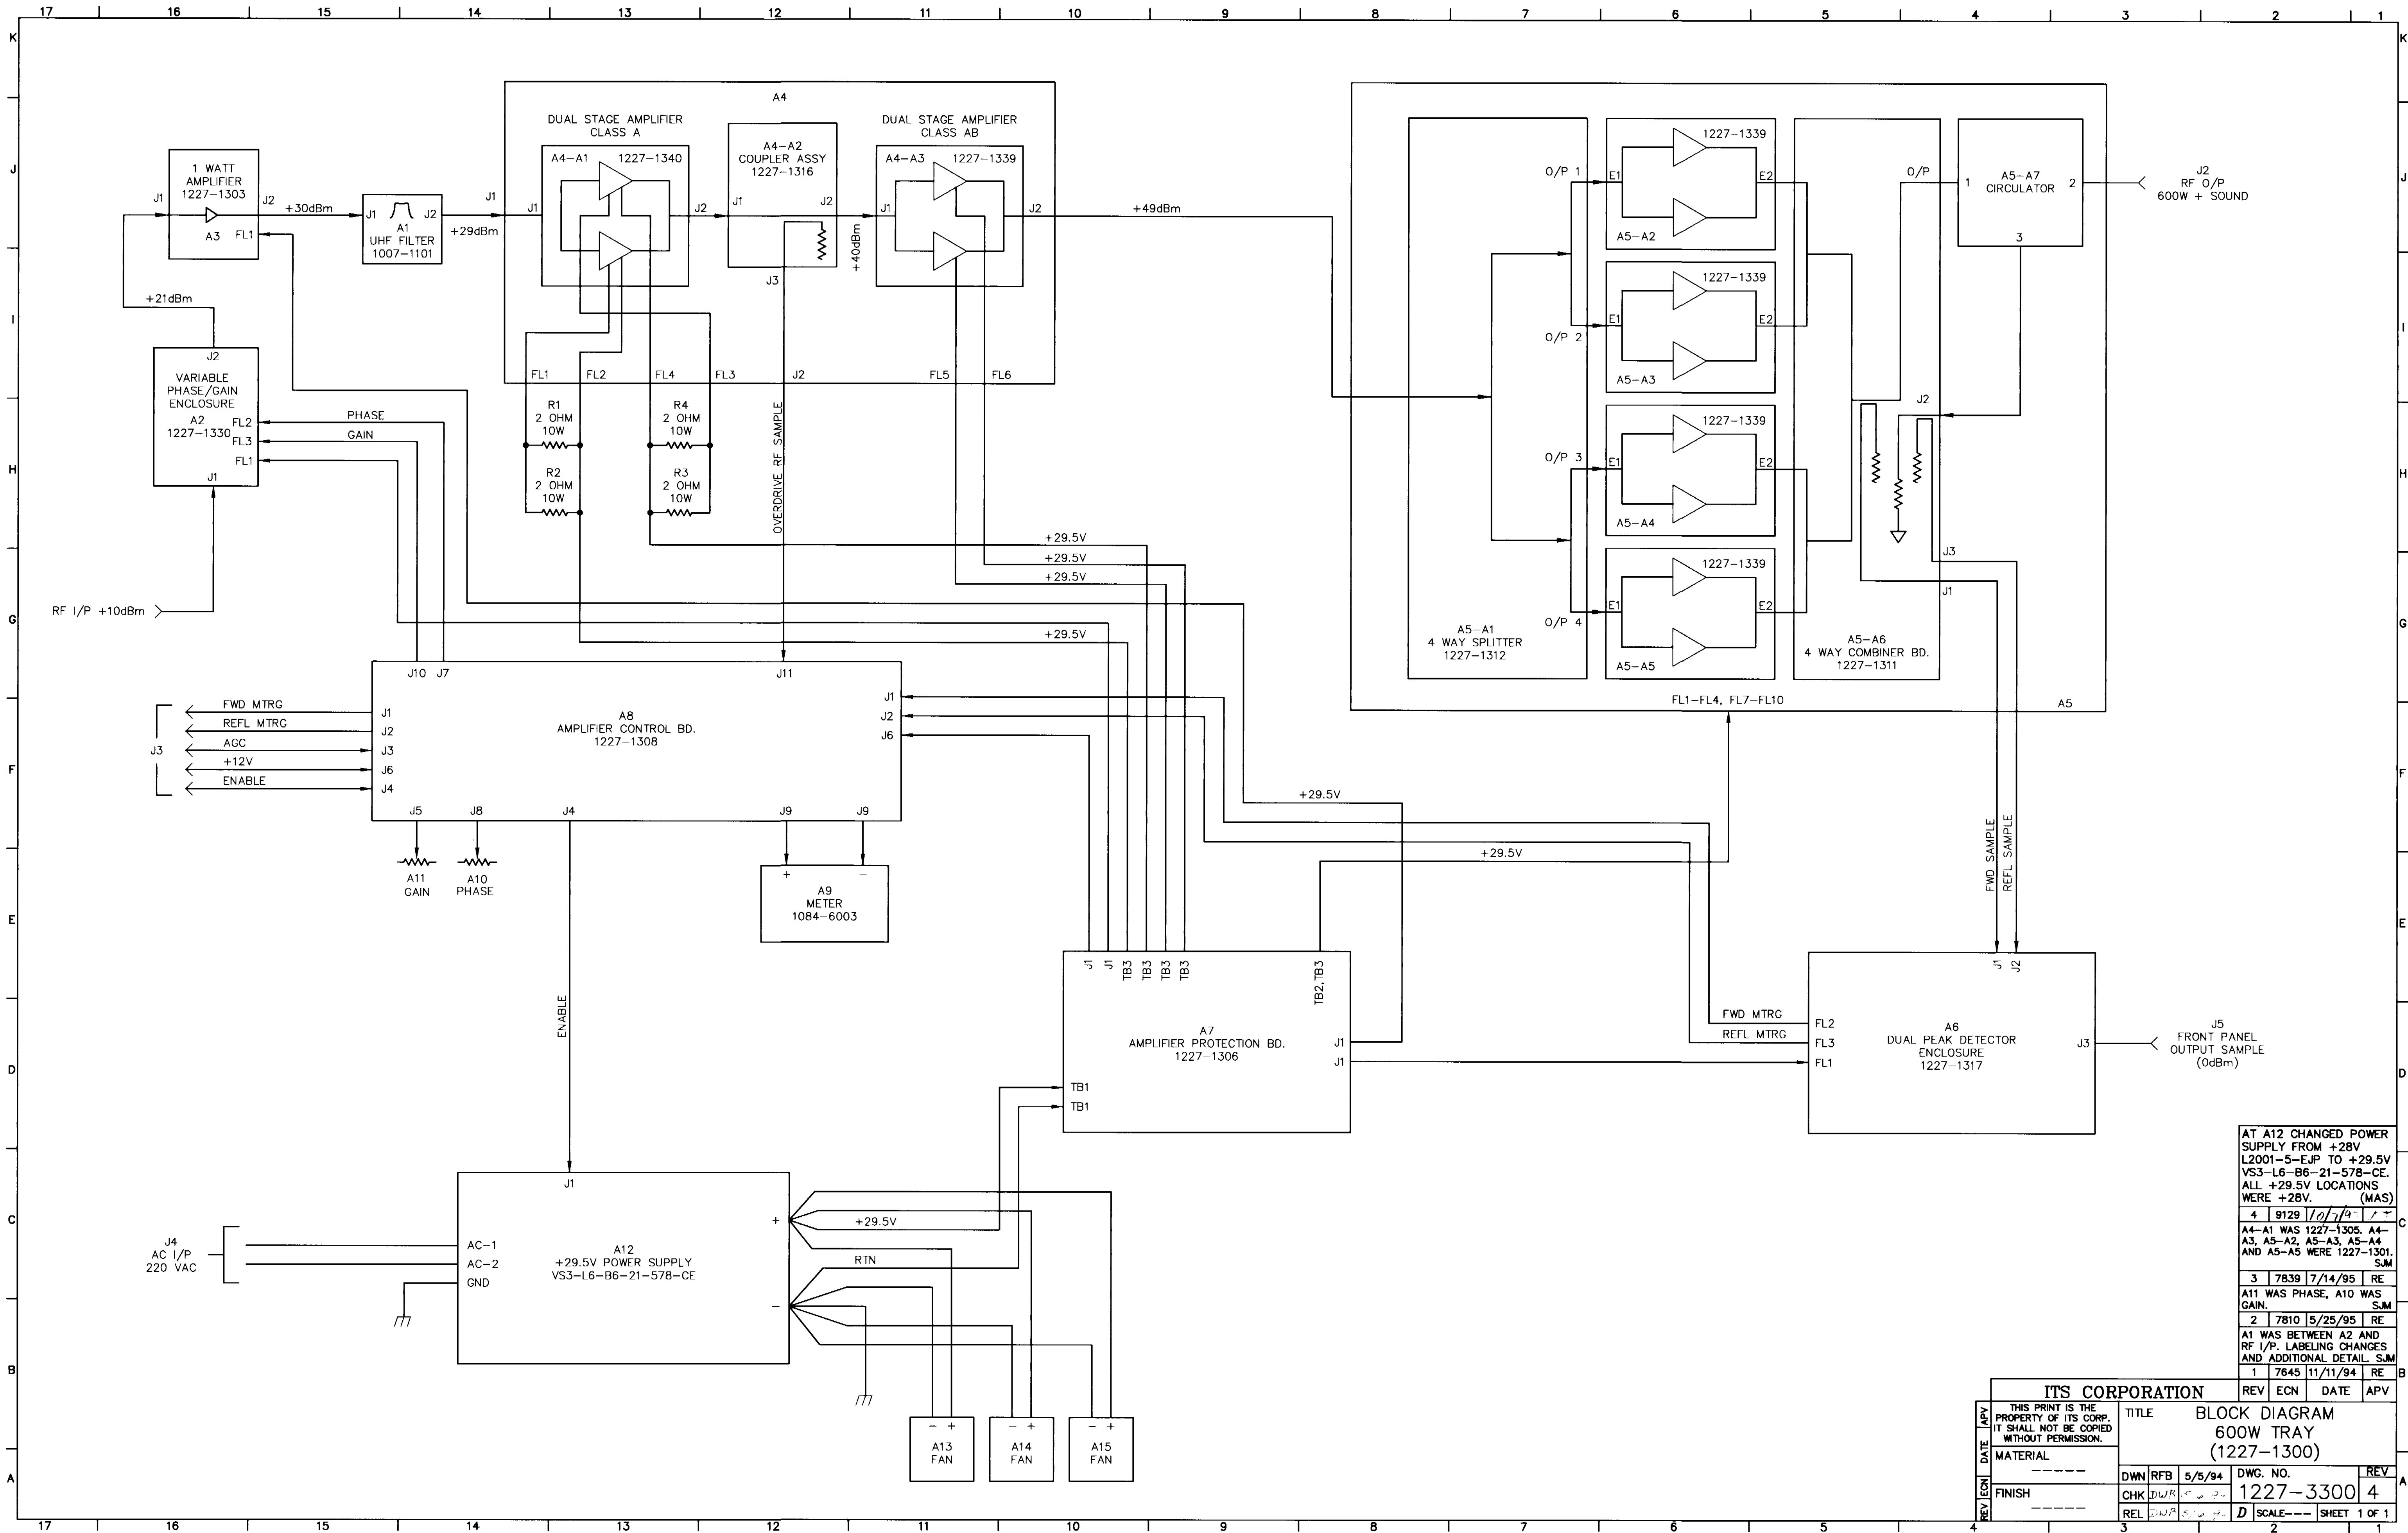

AT A12 CHANGED POWER SUPPLY FROM +28V L2001-5-EJP TO +29.5V VS3-L6-B6-21-578-CE. ALL +29.5V LOCATIONS WERE +28V. (MAS)

REV	ECN	DATE	APV
4	9129	1/27/94	1
3	7839	7/14/95	RE
2	7810	5/25/95	RE
1	7645	11/11/94	RE

THIS PRINT IS THE PROPERTY OF ITS CORP. IT SHALL NOT BE COPIED WITHOUT PERMISSION.				TITLE			
MATERIAL				BLOCK DIAGRAM 600W TRAY (1227-1300)			
FINISH				DWN	RFB	5/5/94	DWG. NO.
				CHK	DWR	5/5/94	1227-3300
				REL	DWR	5/5/94	4
				SCALE--- SHEET 1 OF 1			