


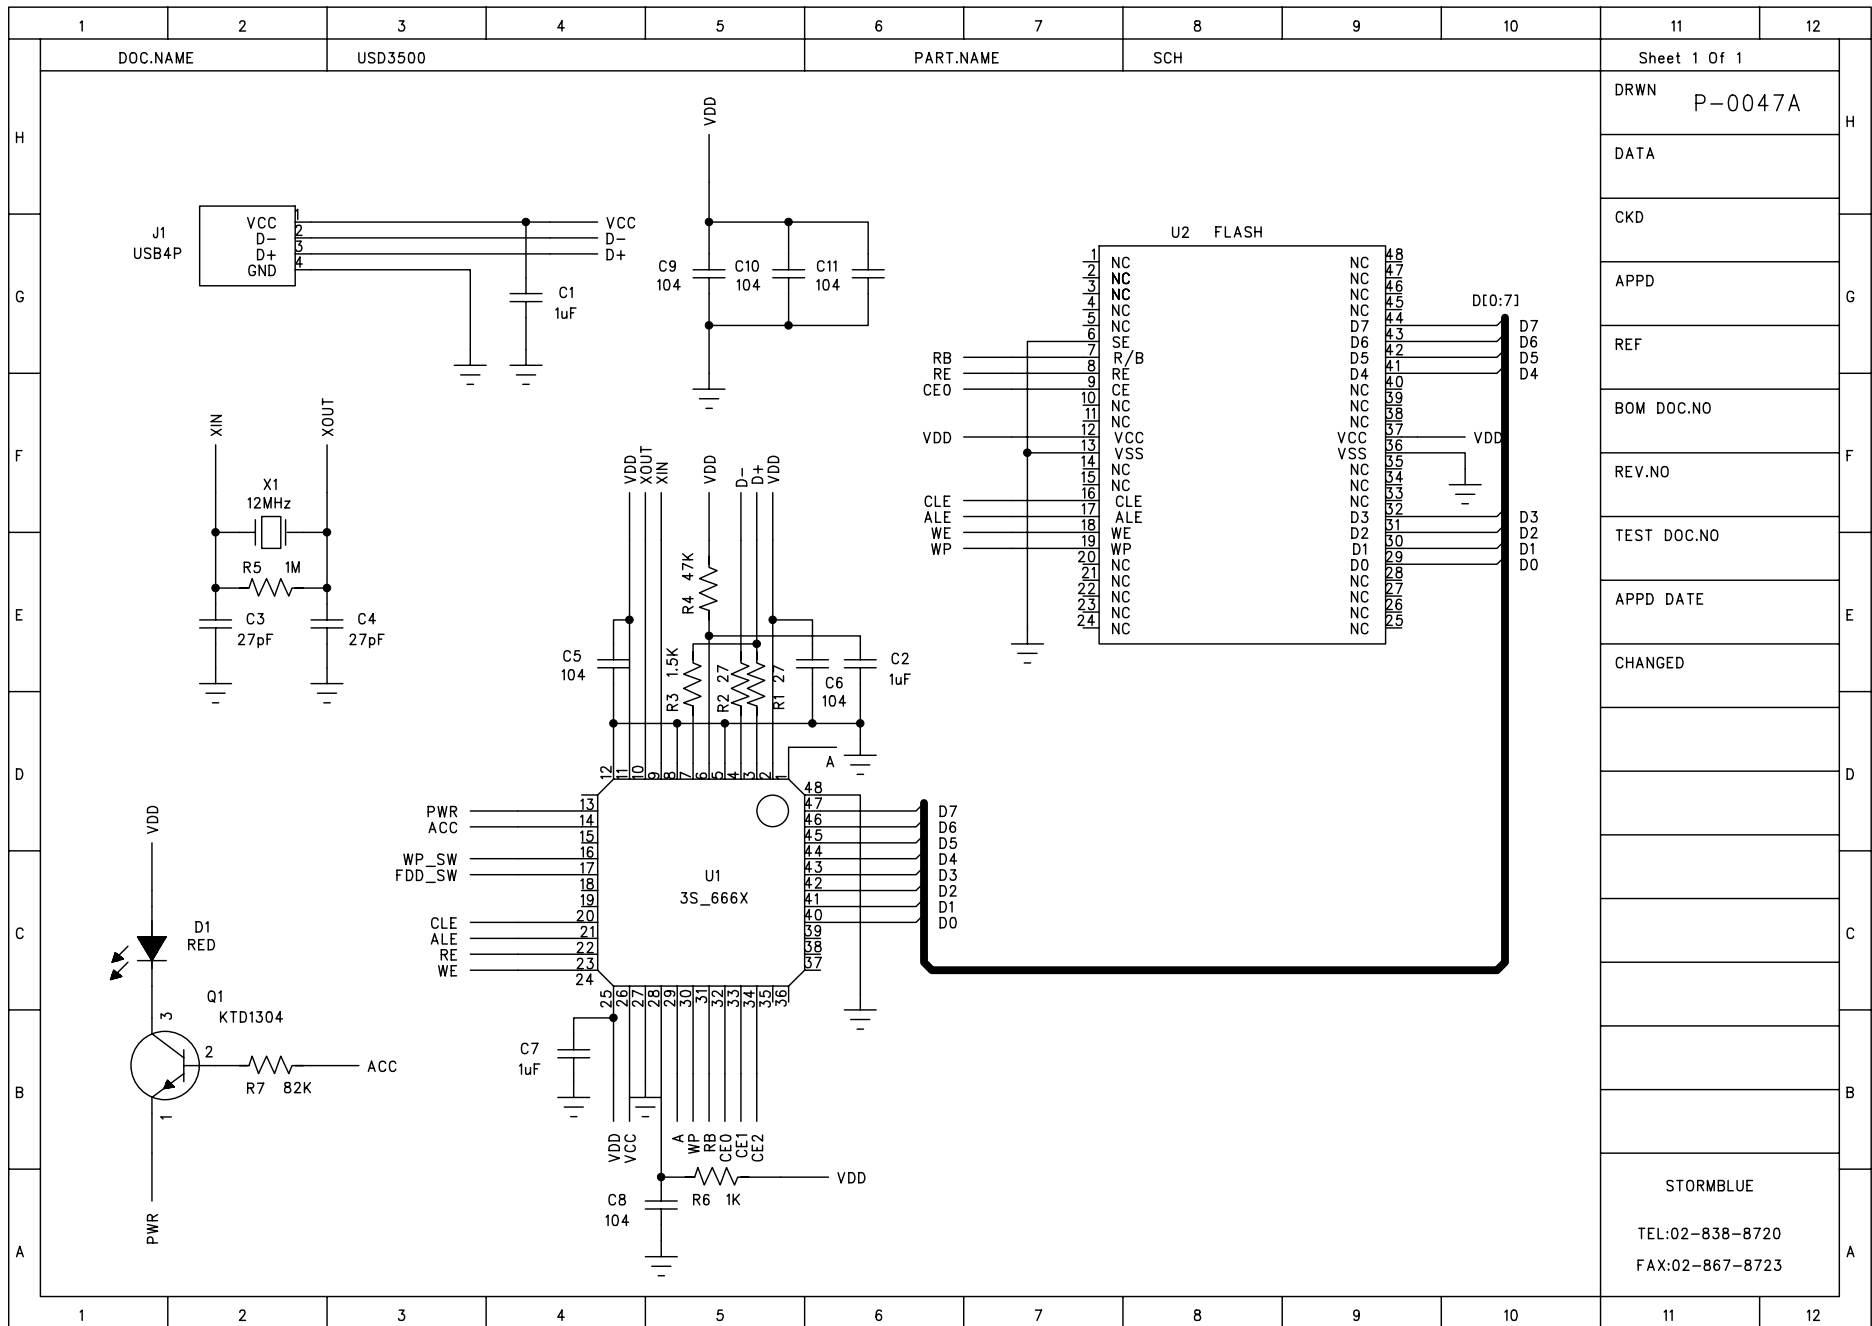

DRWN P-0047A

DATA

CKD

APPD

REF

BOM DOC.NO

REV.NO

TEST DOC.NO

APPD DATE

CHANGED

STORMBLUE

TEL:02-838-8720

FAX:02-867-8723