


		High	5570	Peak	5460.000	-45.96	≤-30.55	3.54	0	52.78	≤68.2	PASS
				AV	5725.000	-53.99	≤-46.79	3.54	2.04	46.79	≤54	PASS
				AV	5725.080	-53.99	≤-46.79	3.54	2.04	46.79	≤54	PASS
				AV	5735.000	-55.73	≤-46.79	3.54	2.04	45.05	≤54	PASS
				Peak	5725.000	-46.04	≤-30.55	3.54	0	52.70	≤68.2	PASS
				Peak	5726.520	-44.73	≤-30.55	3.54	0	54.01	≤68.2	PASS
11AX20SISO	Ant3	Low	5500	AV	5350.000	-55.87	≤-45.23	3.54	0.48	43.35	≤54	PASS
				AV	5459.810	-52.77	≤-45.23	3.54	0.48	46.45	≤54	PASS
				AV	5460.000	-51.95	≤-45.23	3.54	0.48	47.27	≤54	PASS
				Peak	5350.000	-49.28	≤-30.55	3.54	0	49.46	≤68.2	PASS
				Peak	5449.310	-43.74	≤-30.55	3.54	0	55.00	≤68.2	PASS
				Peak	5460.000	-44.71	≤-30.55	3.54	0	54.03	≤68.2	PASS
		High	5700	AV	5725.000	-54.4	≤-45.23	3.54	0.48	44.82	≤54	PASS
				AV	5725.530	-53.8	≤-45.23	3.54	0.48	45.42	≤54	PASS
				AV	5735.000	-55.09	≤-45.23	3.54	0.48	44.13	≤54	PASS
				Peak	5725.000	-45.22	≤-30.55	3.54	0	53.52	≤68.2	PASS
				Peak	5726.290	-43.49	≤-30.55	3.54	0	55.25	≤68.2	PASS
				Peak	5735.000	-47.72	≤-30.55	3.54	0	51.02	≤68.2	PASS
11AX40SISO	Ant3	Low	5510	AV	5350.000	-54.95	≤-45.33	3.54	0.58	44.37	≤54	PASS
				AV	5390.200	-52.63	≤-45.33	3.54	0.58	46.69	≤54	PASS
				AV	5460.000	-54.01	≤-45.33	3.54	0.58	45.31	≤54	PASS
				Peak	5350.000	-47.52	≤-30.55	3.54	0	51.22	≤68.2	PASS
				Peak	5420.120	-42.75	≤-30.55	3.54	0	55.99	≤68.2	PASS
				Peak	5460.000	-45.82	≤-30.55	3.54	0	52.92	≤68.2	PASS
		High	5670	AV	5725.000	-54.66	≤-45.33	3.54	0.58	44.66	≤54	PASS
				AV	5726.360	-54.21	≤-45.33	3.54	0.58	45.11	≤54	PASS
				AV	5735.000	-54.96	≤-45.33	3.54	0.58	44.36	≤54	PASS
				Peak	5725.000	-45.92	≤-30.55	3.54	0	52.82	≤68.2	PASS
				Peak	5726.820	-44.28	≤-30.55	3.54	0	54.46	≤68.2	PASS
				Peak	5735.000	-47.02	≤-30.55	3.54	0	51.72	≤68.2	PASS
11AX80SISO	Ant3	Low	5530	AV	5350.000	-55.82	≤-45.25	3.54	0.5	43.42	≤54	PASS
				AV	5458.480	-49.17	≤-45.25	3.54	0.5	50.07	≤54	PASS
				AV	5460.000	-51.1	≤-45.25	3.54	0.5	48.14	≤54	PASS
				Peak	5350.000	-47.41	≤-30.55	3.54	0	51.33	≤68.2	PASS
				Peak	5458.480	-39.33	≤-30.55	3.54	0	59.41	≤68.2	PASS
				Peak	5460.000	-42.57	≤-30.55	3.54	0	56.17	≤68.2	PASS
		High	5610	AV	5725.000	-55.4	≤-45.34	3.54	0.59	43.93	≤54	PASS
				AV	5730.180	-53.96	≤-45.34	3.54	0.59	45.37	≤54	PASS
				AV	5735.000	-56.12	≤-45.34	3.54	0.59	43.21	≤54	PASS
				Peak	5725.000	-47.92	≤-30.55	3.54	0	50.82	≤68.2	PASS


				Peak	5730.510	-45.92	≤-30.55	3.54	0	52.82	≤68.2	PASS
				Peak	5735.000	-47.59	≤-30.55	3.54	0	51.15	≤68.2	PASS
11AX160SISO	Ant3	Low	5570	AV	5350.000	-55.62	≤-45.34	3.54	0.59	43.71	≤54	PASS
				AV	5450.125	-49.88	≤-45.34	3.54	0.59	49.45	≤54	PASS
				AV	5460.000	-52.57	≤-45.34	3.54	0.59	46.76	≤54	PASS
				Peak	5350.000	-47.02	≤-30.55	3.54	0	51.72	≤68.2	PASS
				Peak	5436.625	-40.34	≤-30.55	3.54	0	58.40	≤68.2	PASS
				Peak	5460.000	-44.65	≤-30.55	3.54	0	54.09	≤68.2	PASS
		High	5570	AV	5725.000	-54.3	≤-45.34	3.54	0.59	45.03	≤54	PASS
				AV	5731.920	-54.06	≤-45.34	3.54	0.59	45.27	≤54	PASS
				AV	5735.000	-54.86	≤-45.34	3.54	0.59	44.47	≤54	PASS
				Peak	5725.000	-46.05	≤-30.55	3.54	0	52.69	≤68.2	PASS
				Peak	5726.520	-44.3	≤-30.55	3.54	0	54.44	≤68.2	PASS
				Peak	5735.000	-45.5	≤-30.55	3.54	0	53.24	≤68.2	PASS


Note:


1. The Antenna Gain is compensated in the graph.


Test Graphs

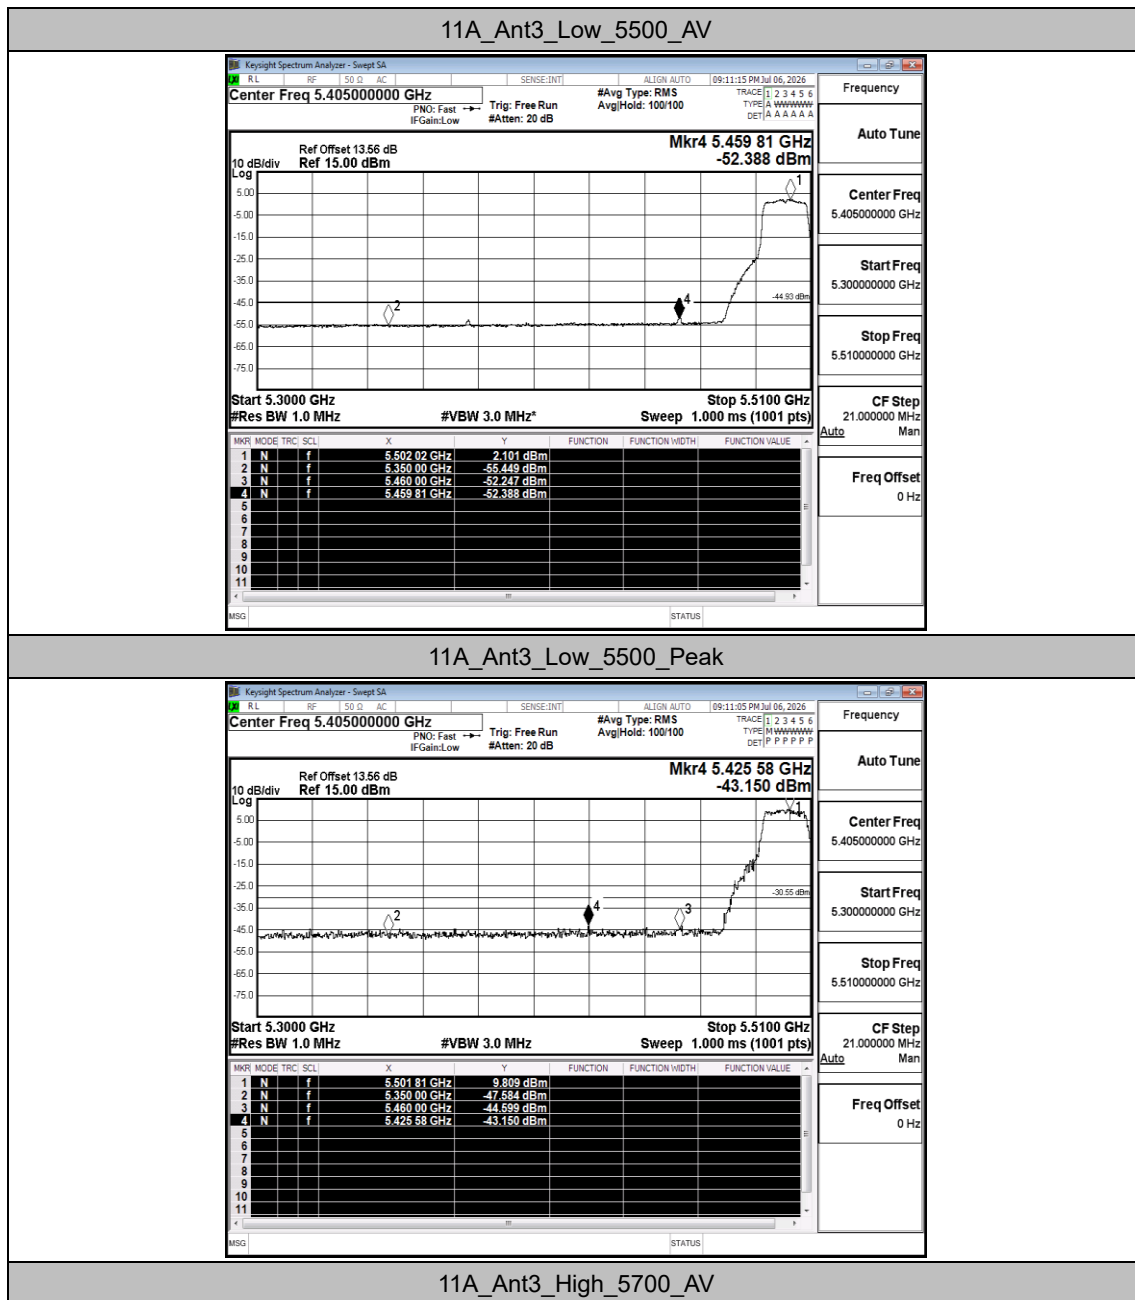


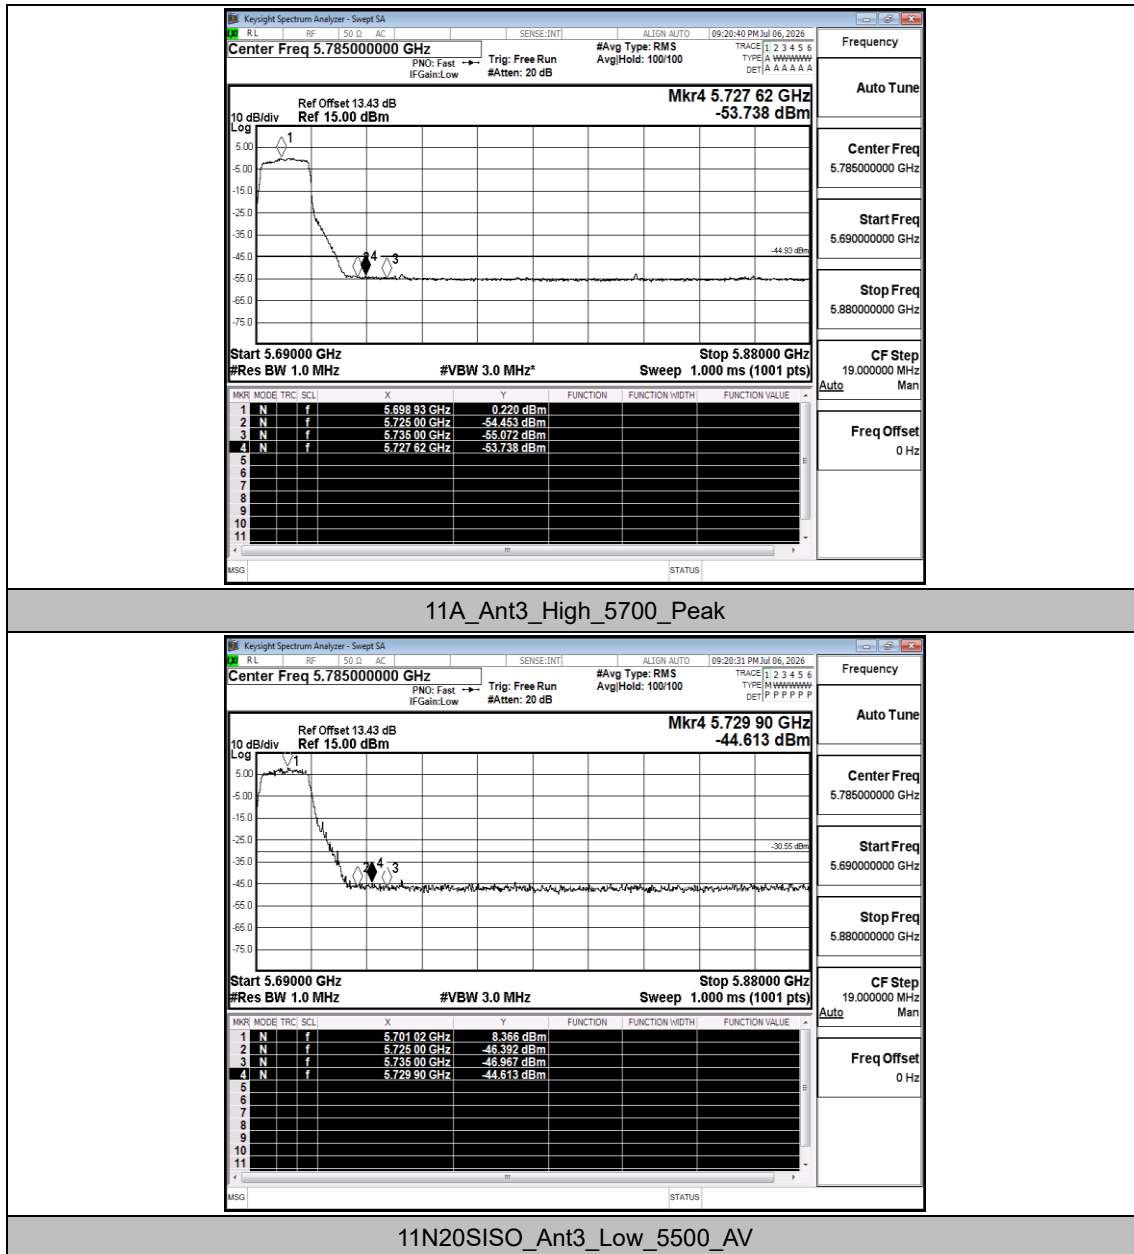


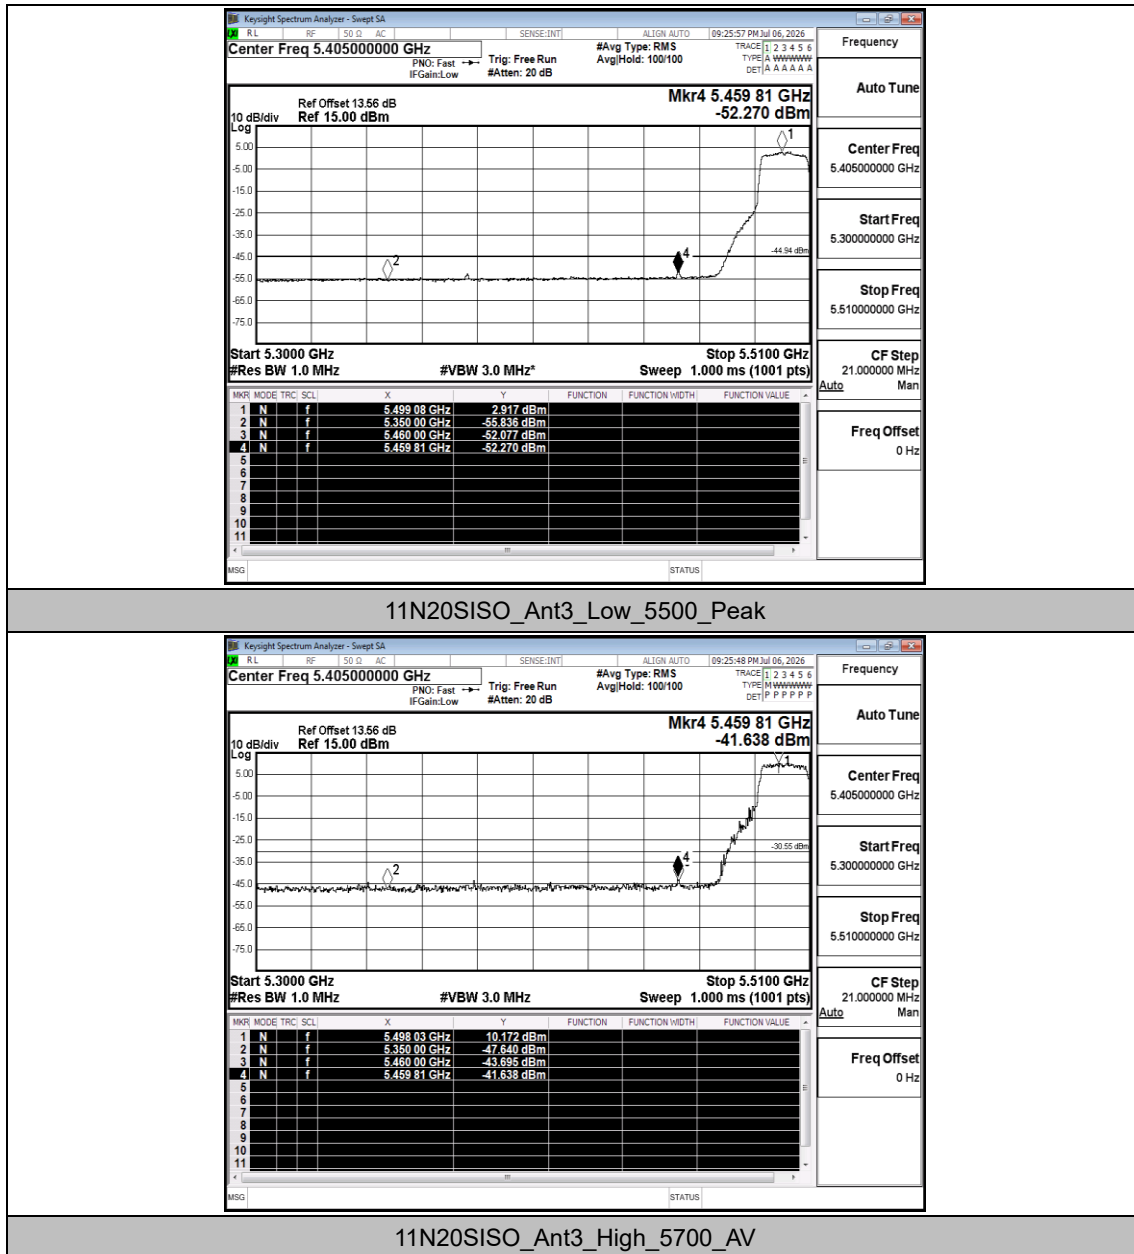


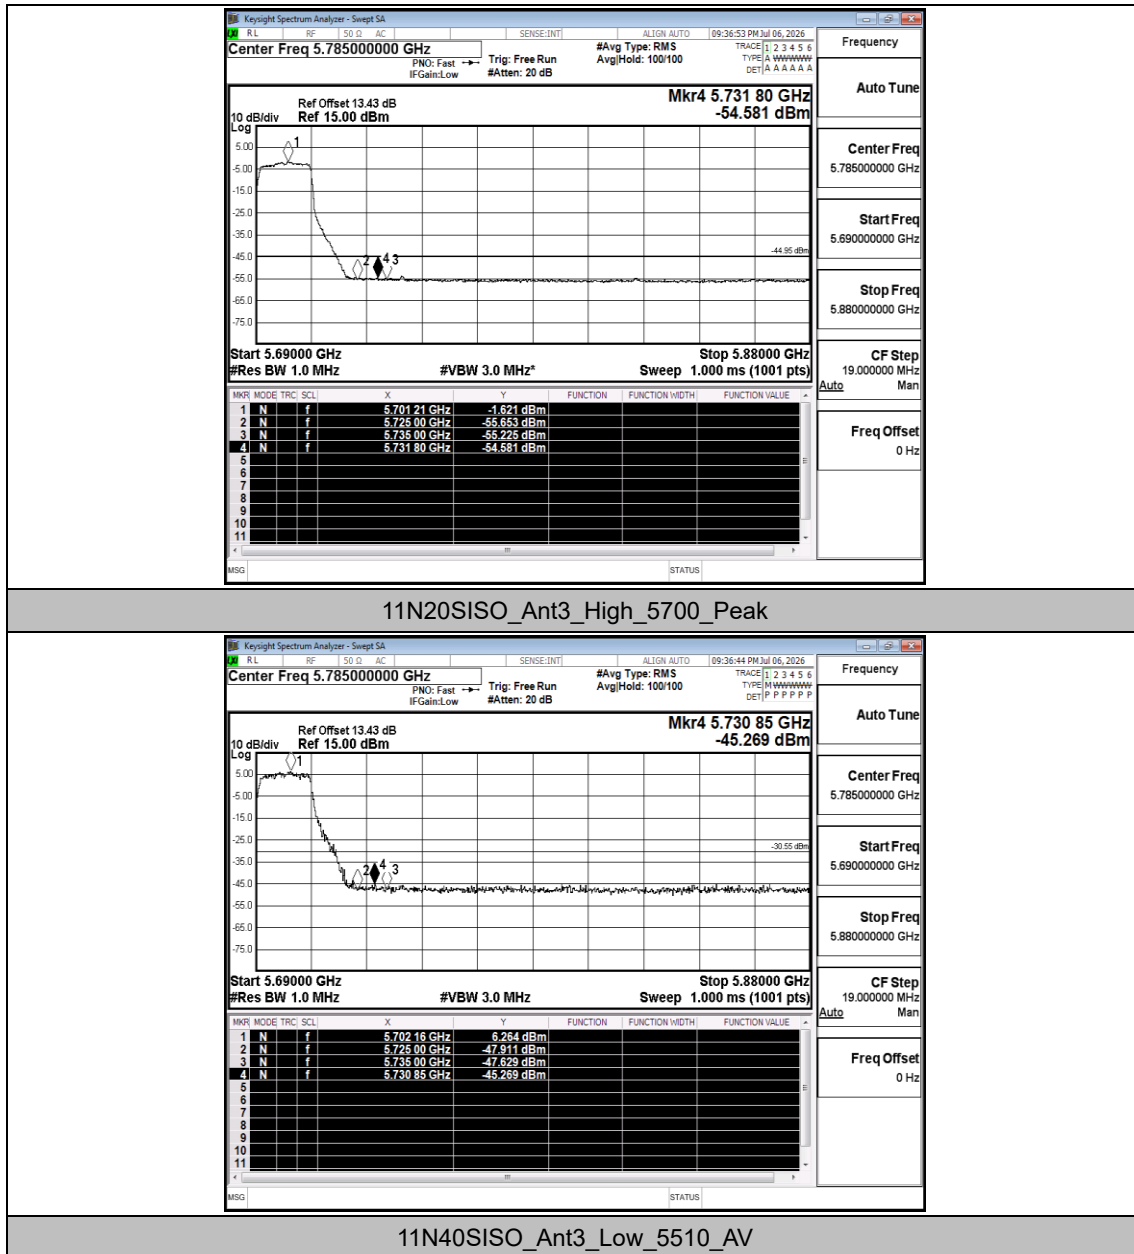

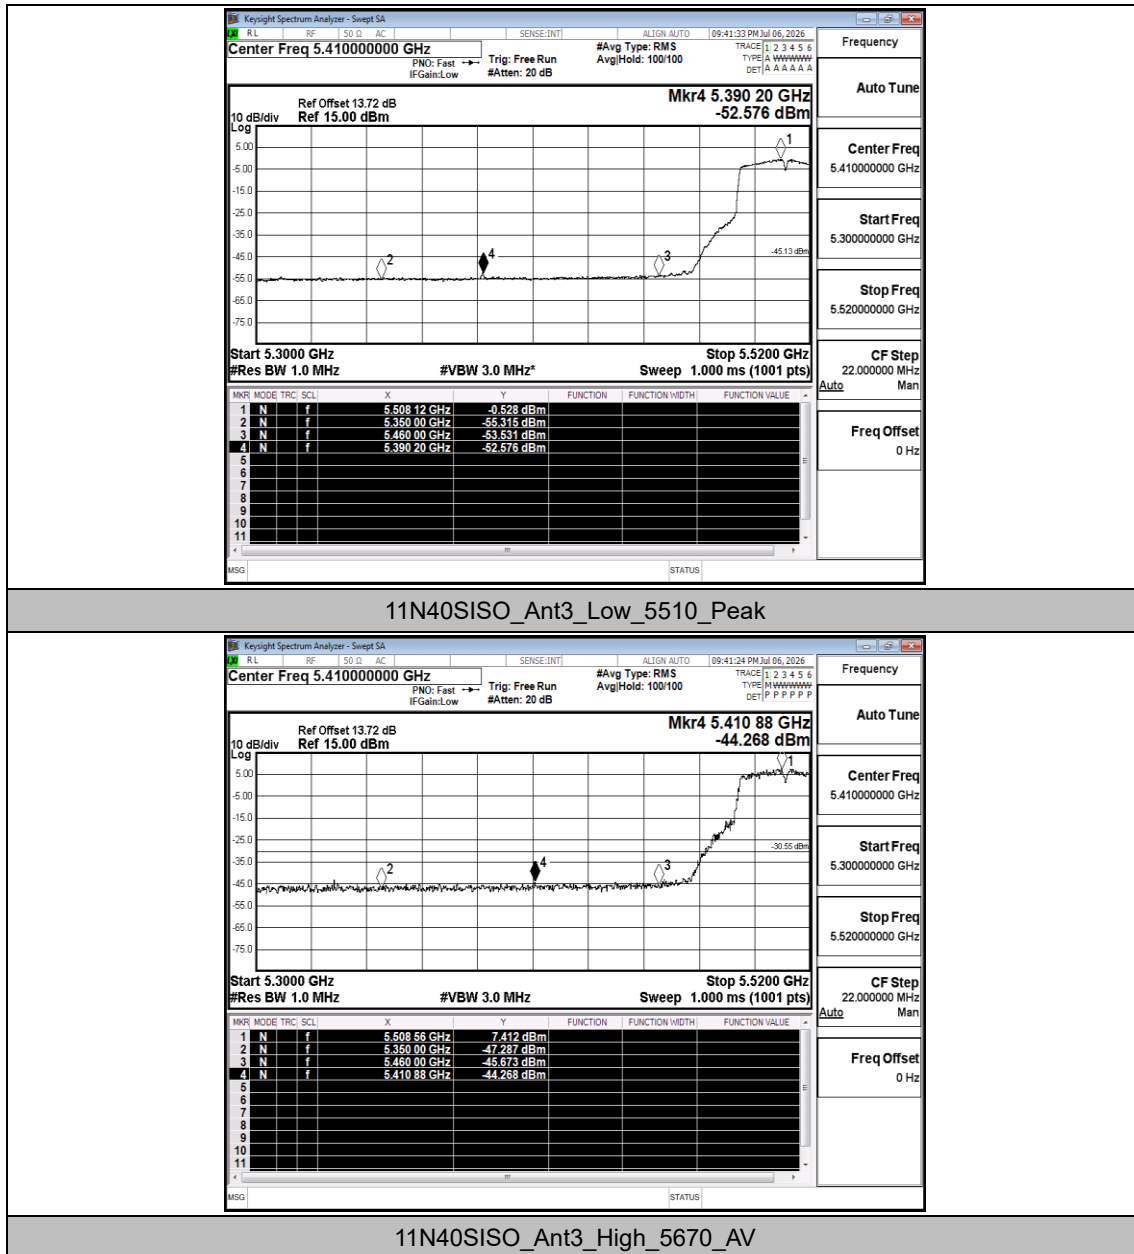


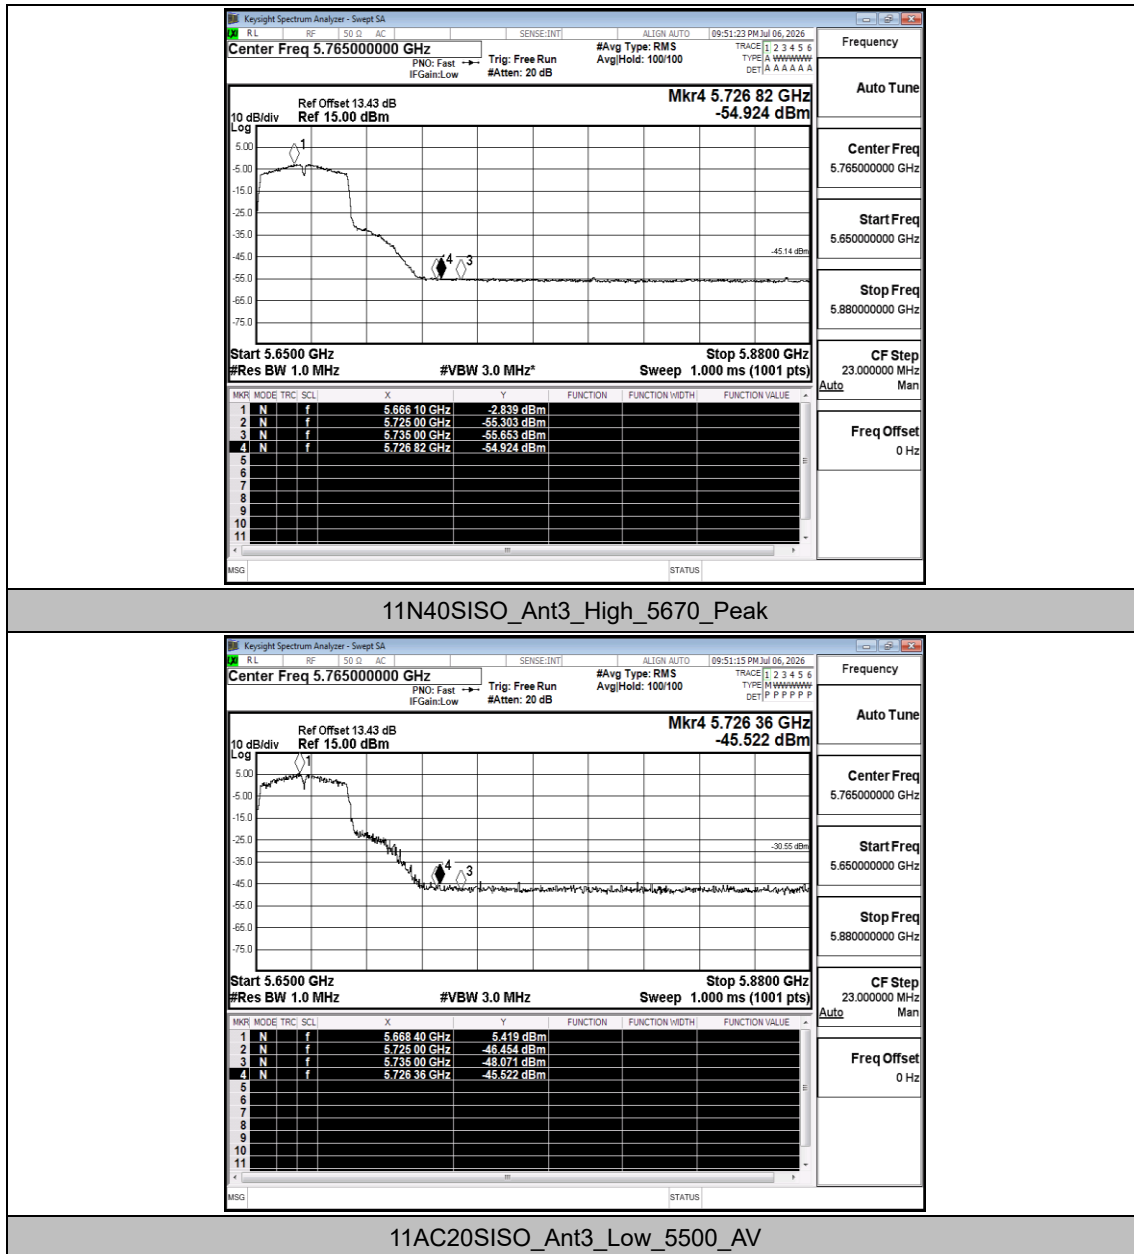

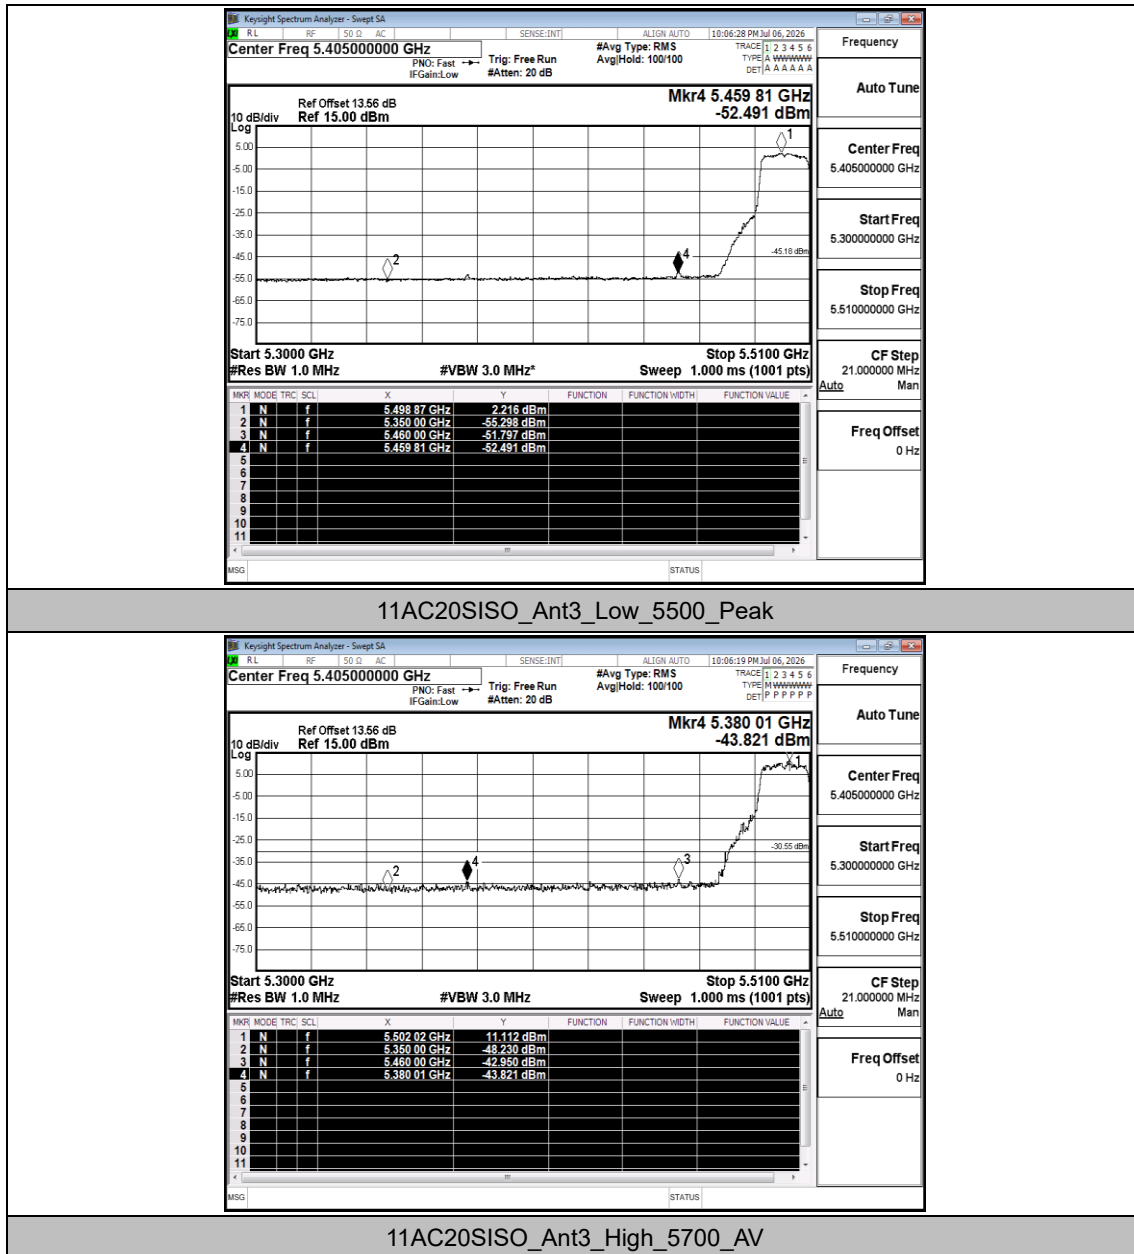


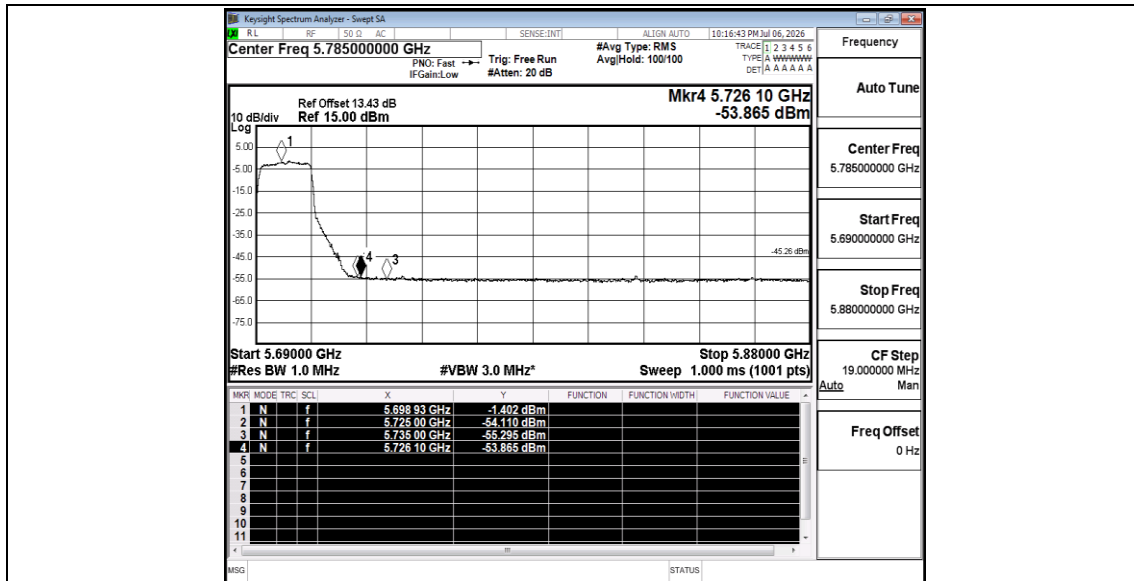



11AC20ISO_Ant3_High_5700_Peak

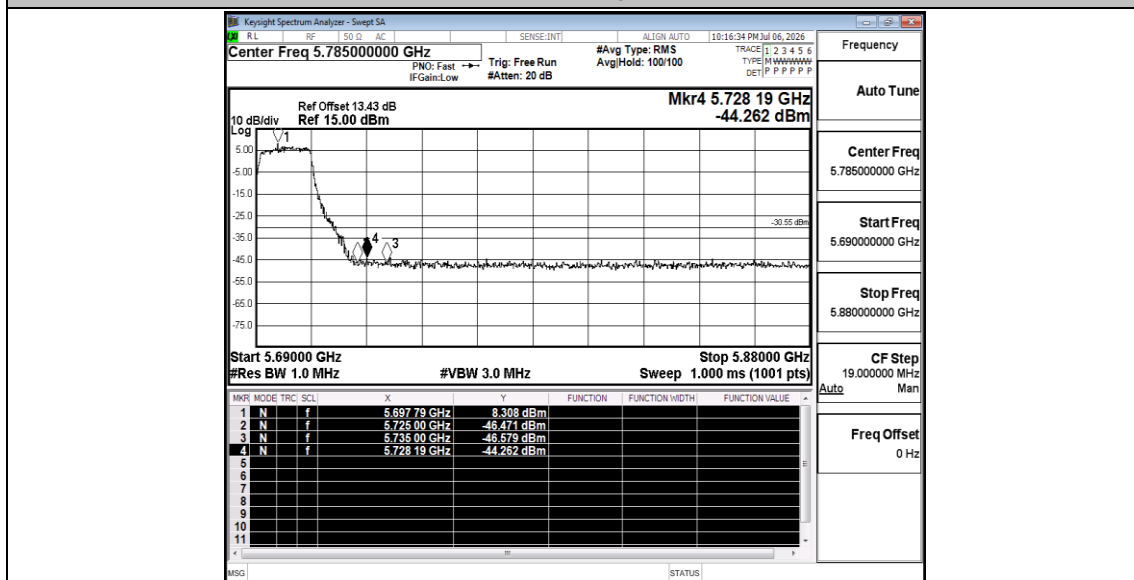



11AC40ISO_Ant3_Low_5510_AV

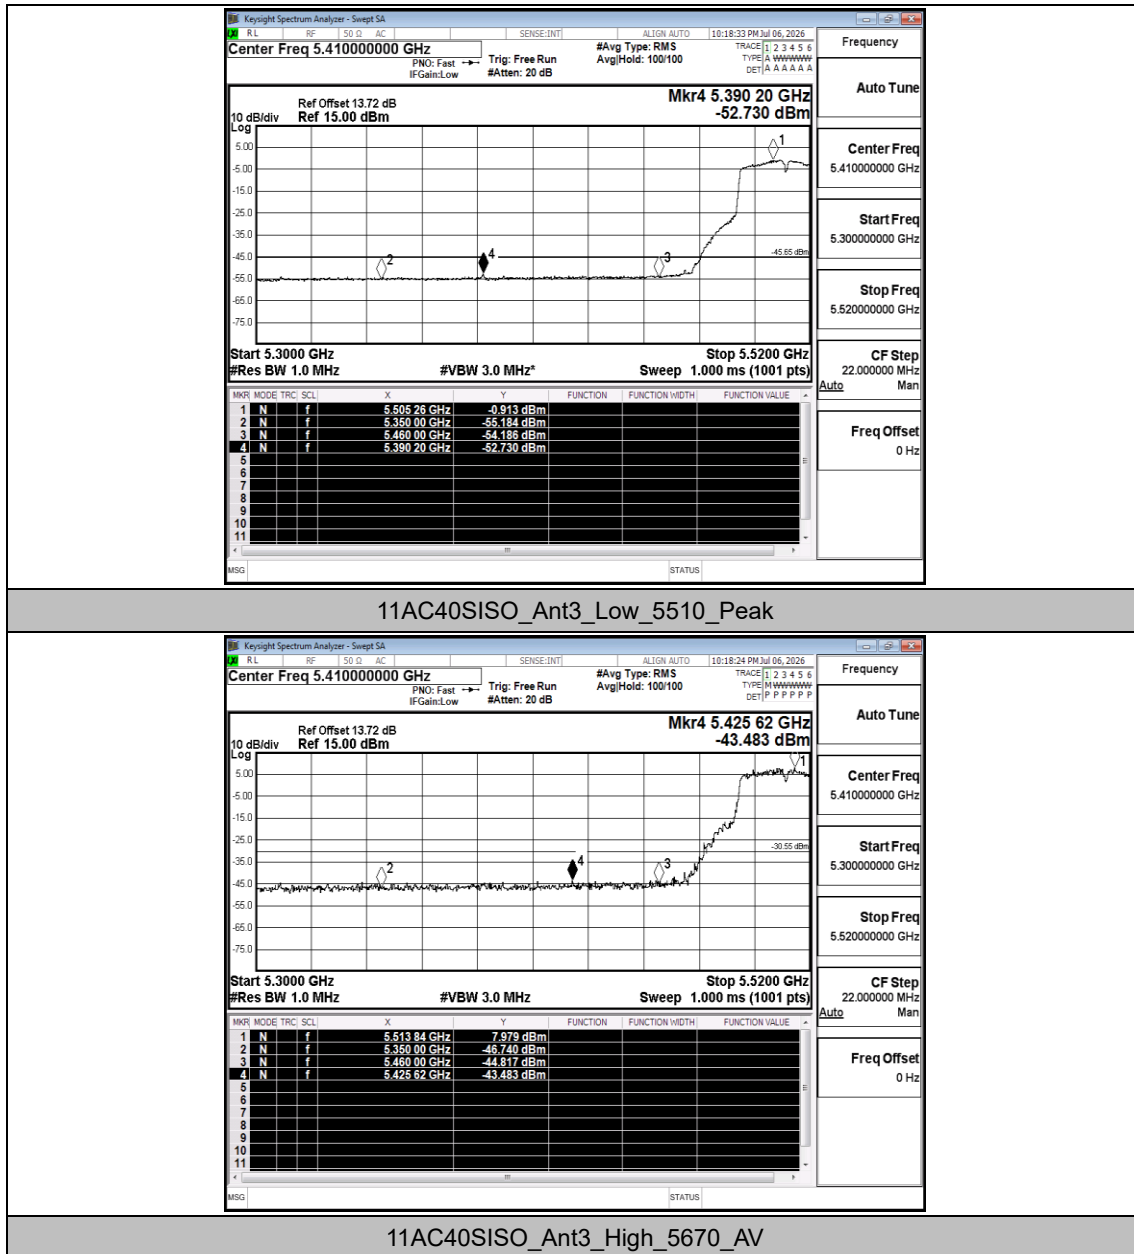


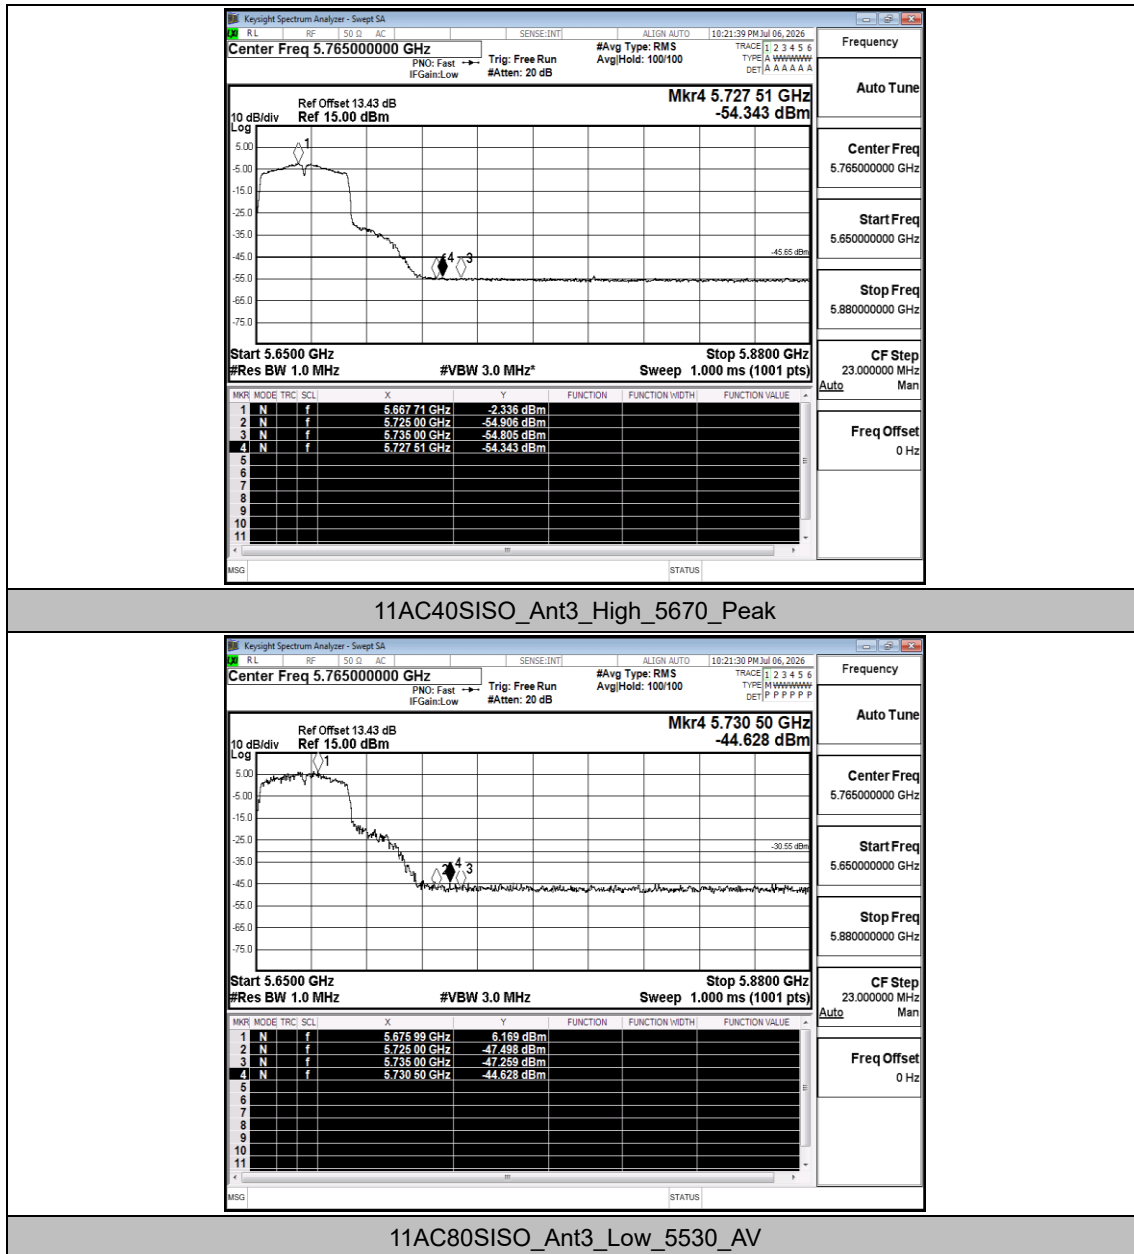

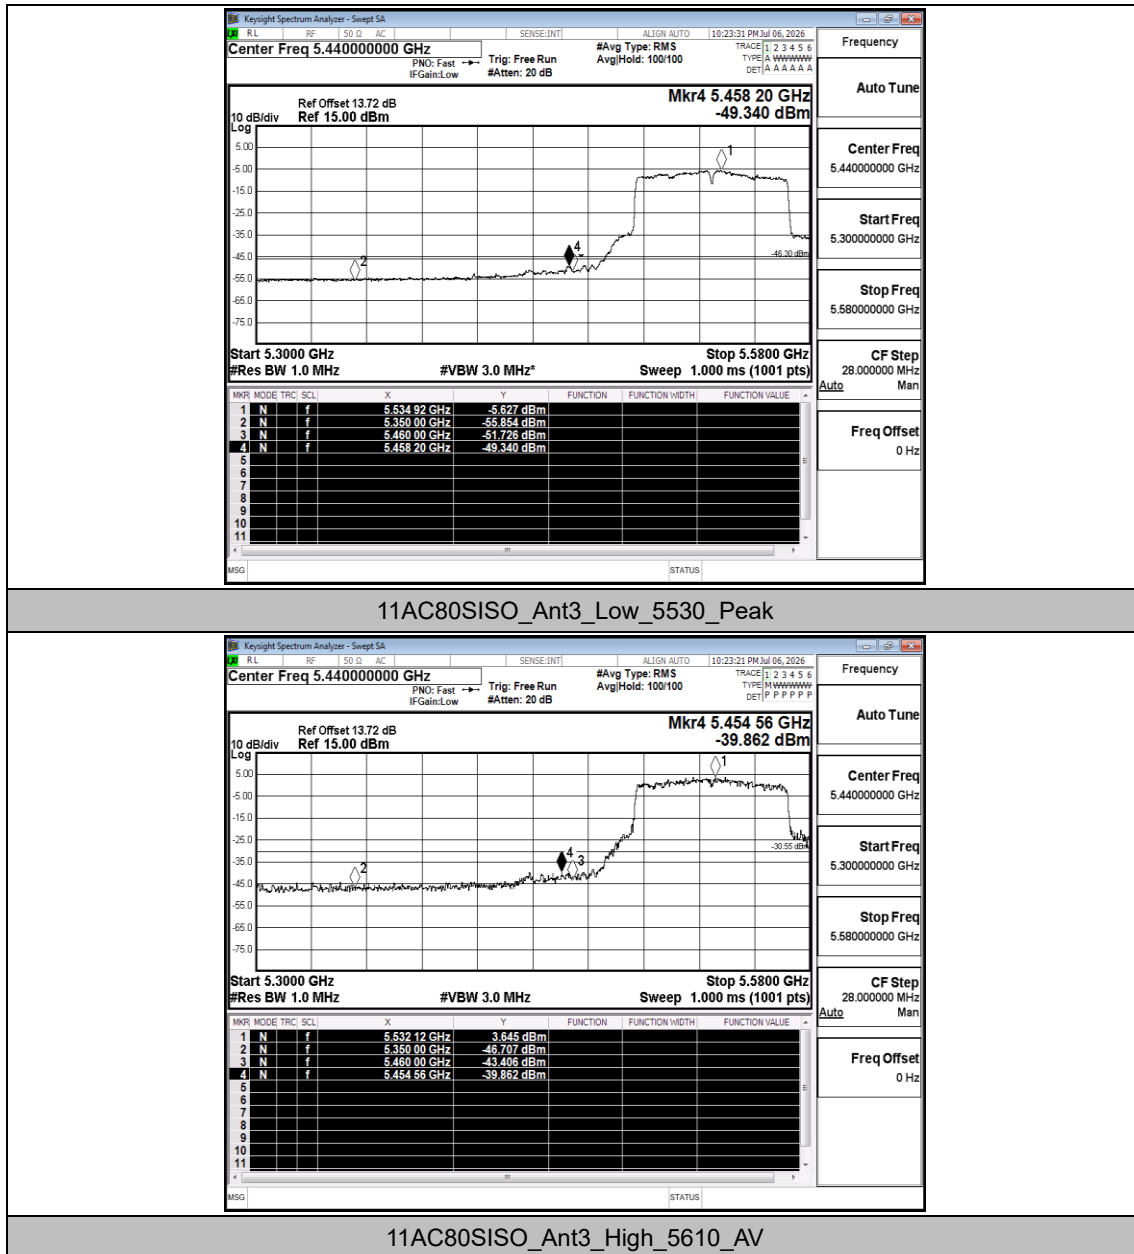


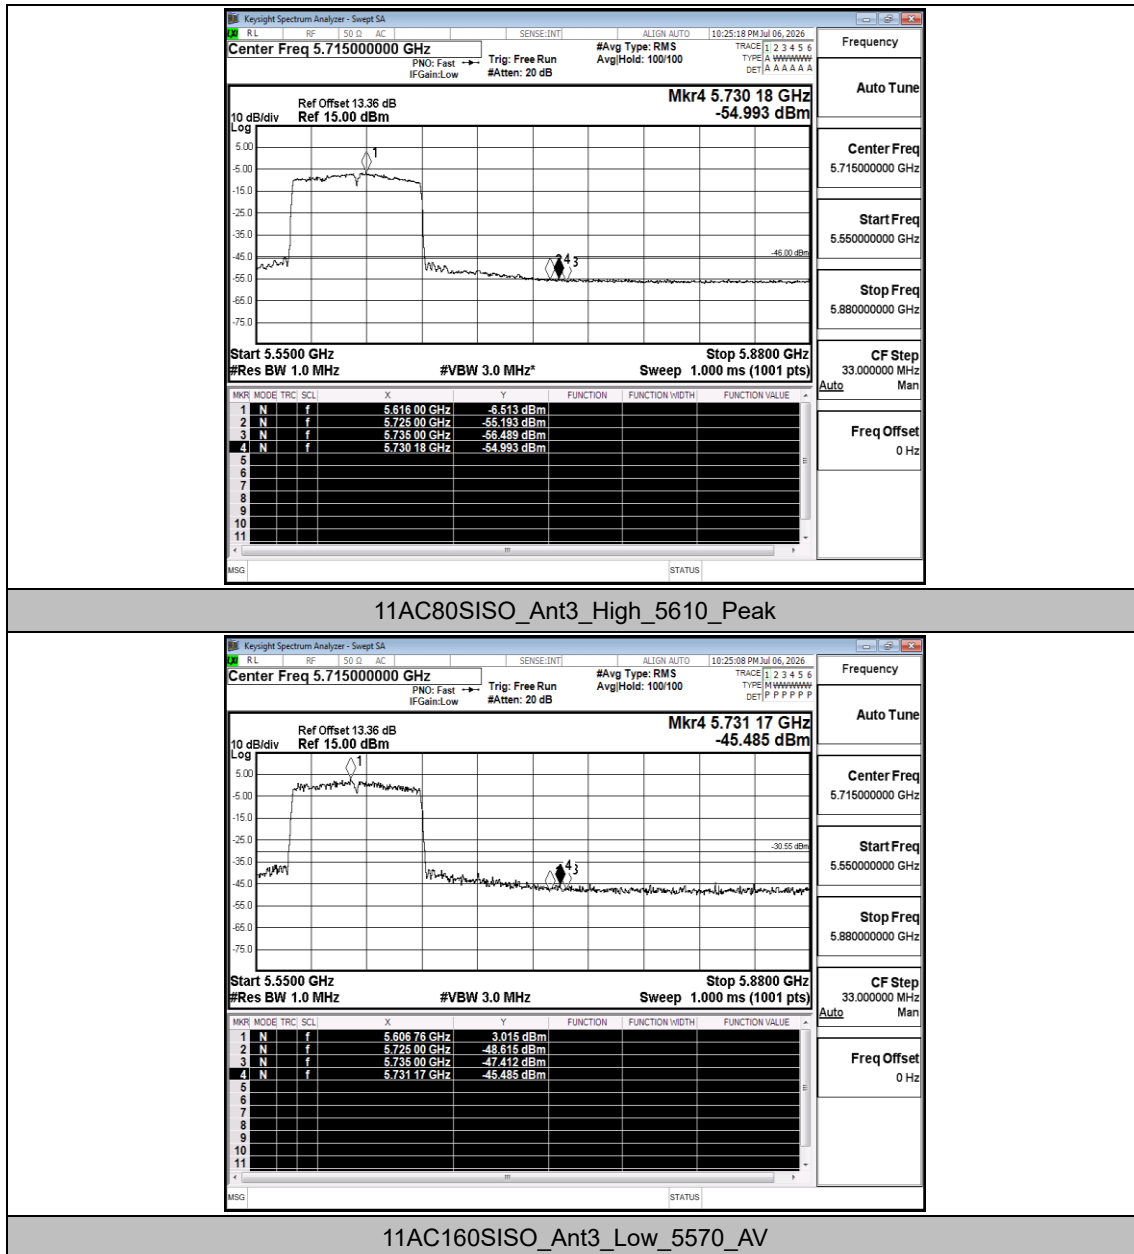

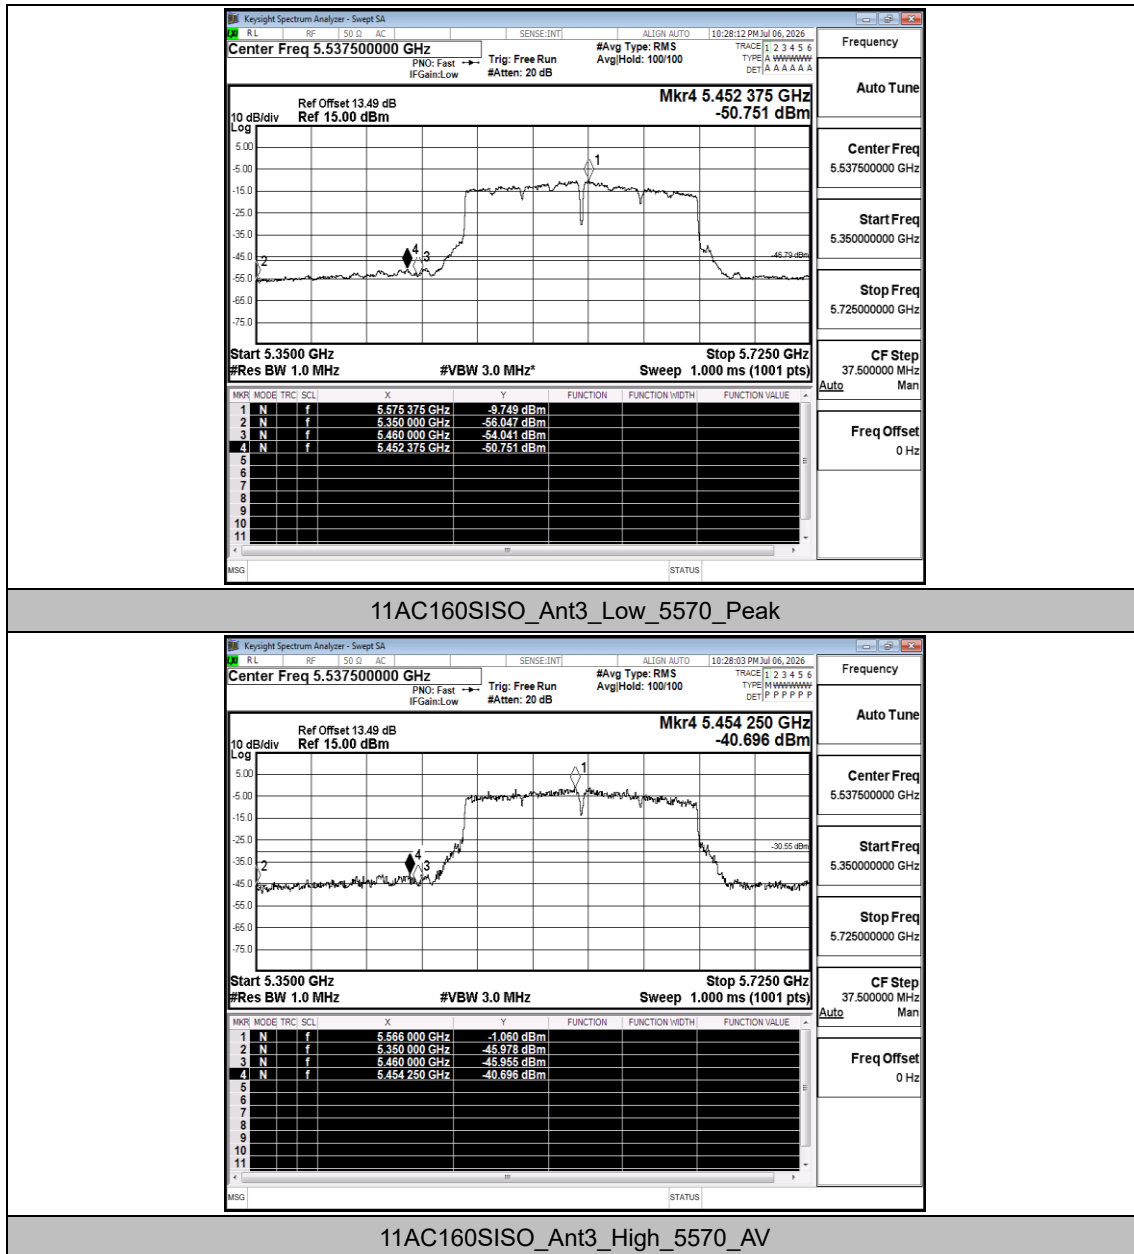


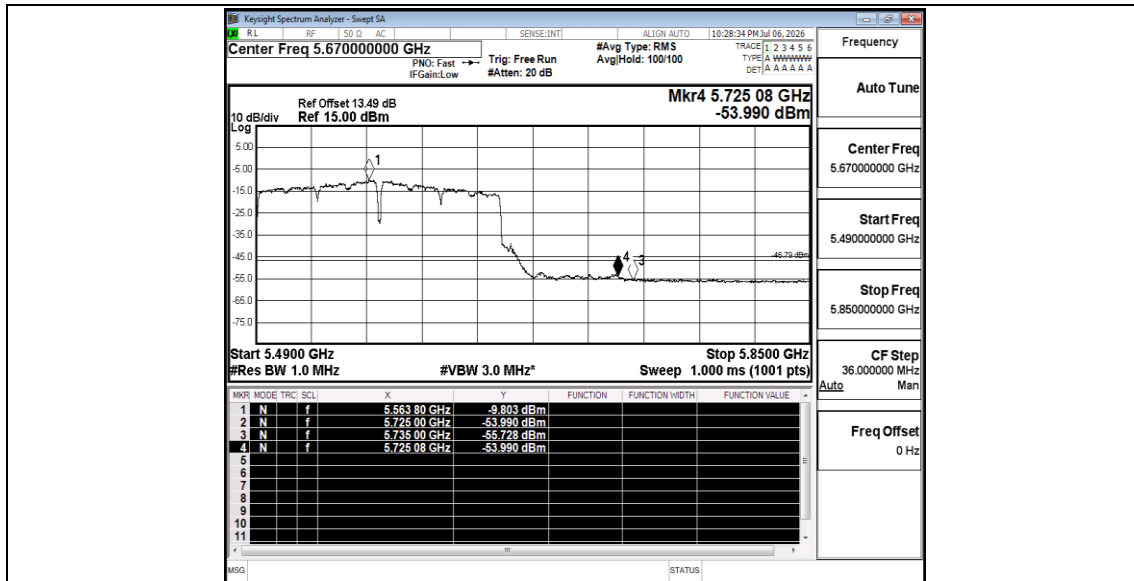


11AC160SISO_Ant3_High_5570_Peak

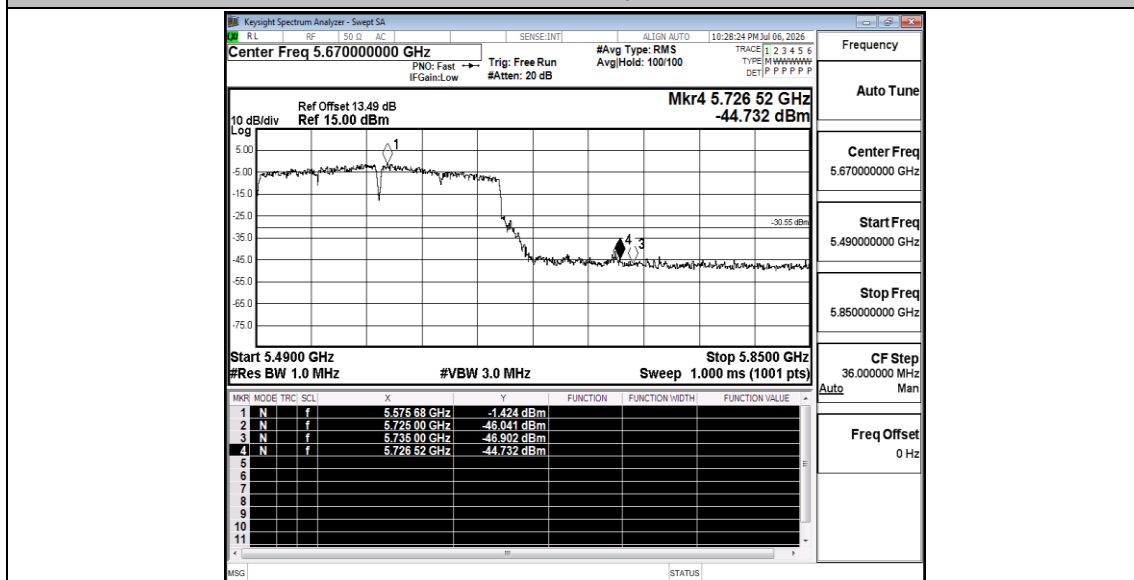


11AX20SISO_Ant3_Low_5500_AV

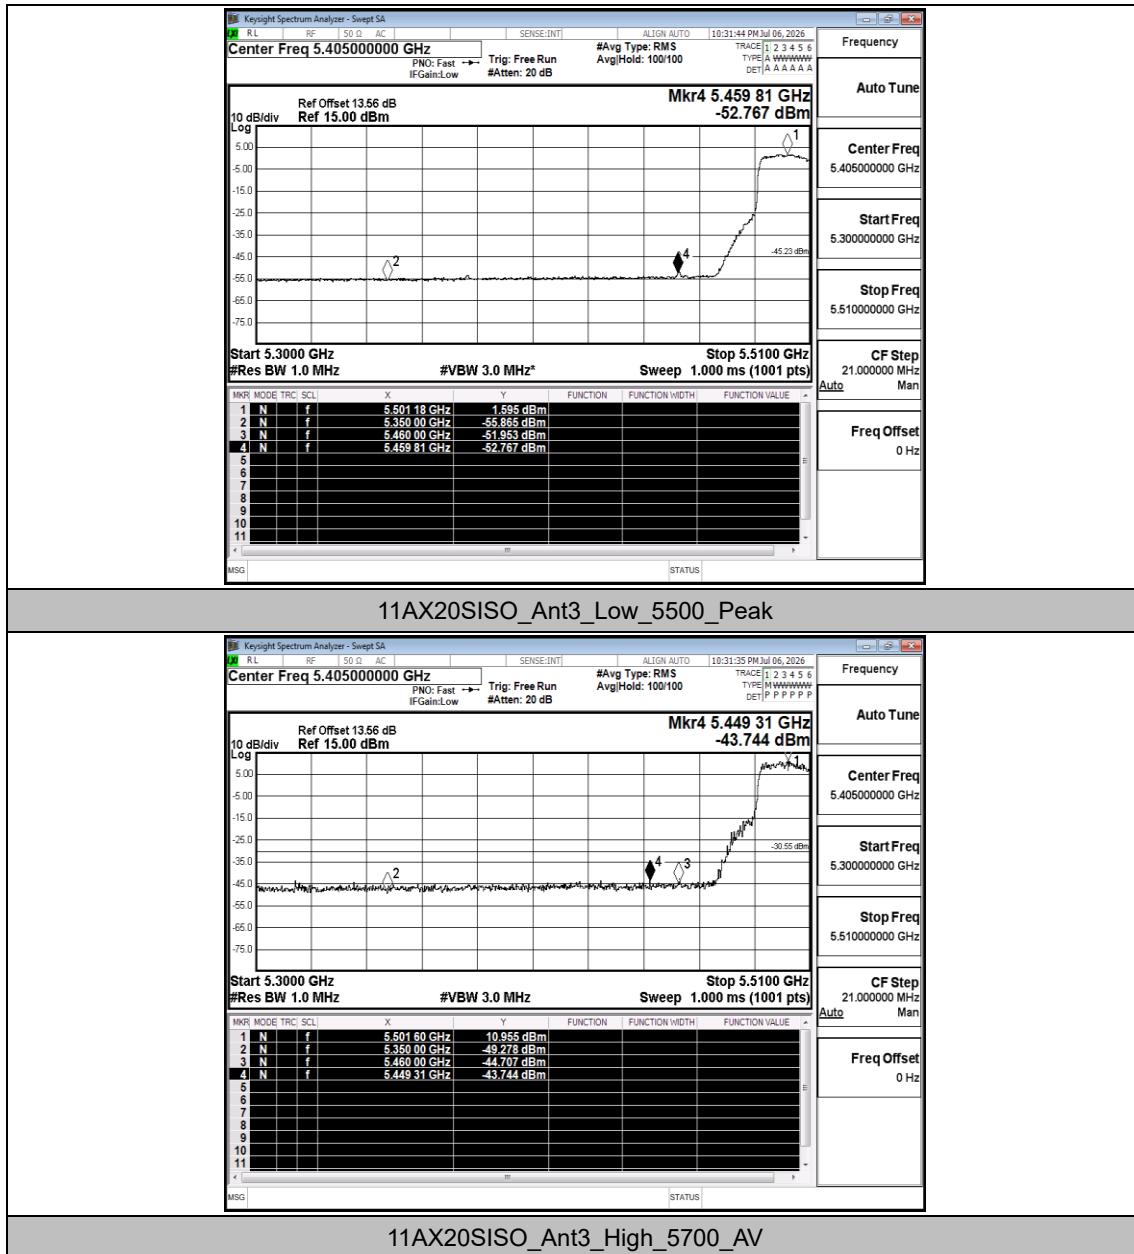


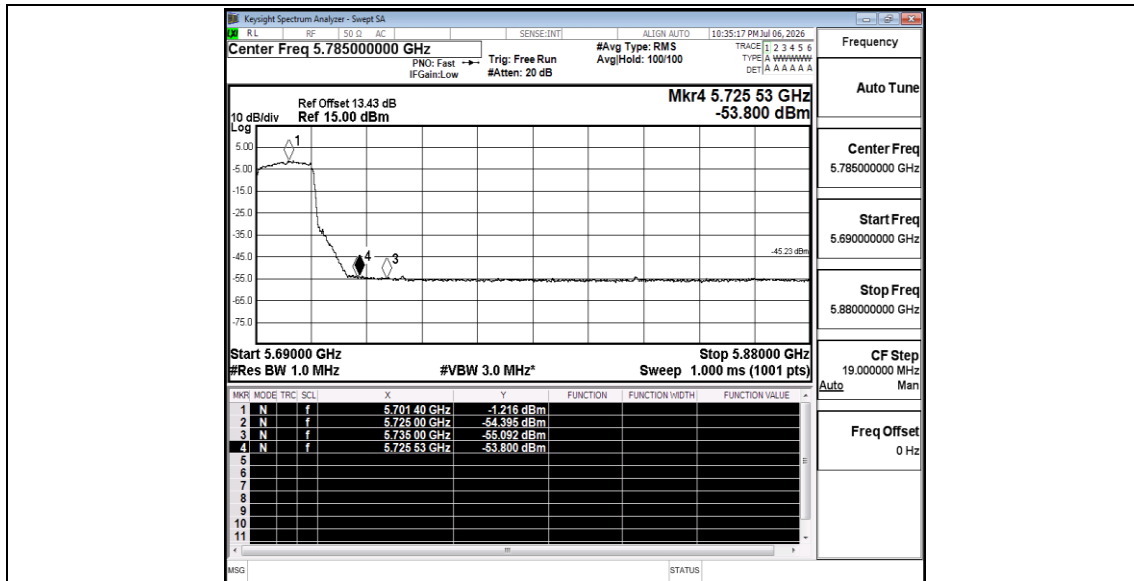



11AX20ISO_Ant3_High_5700_Peak

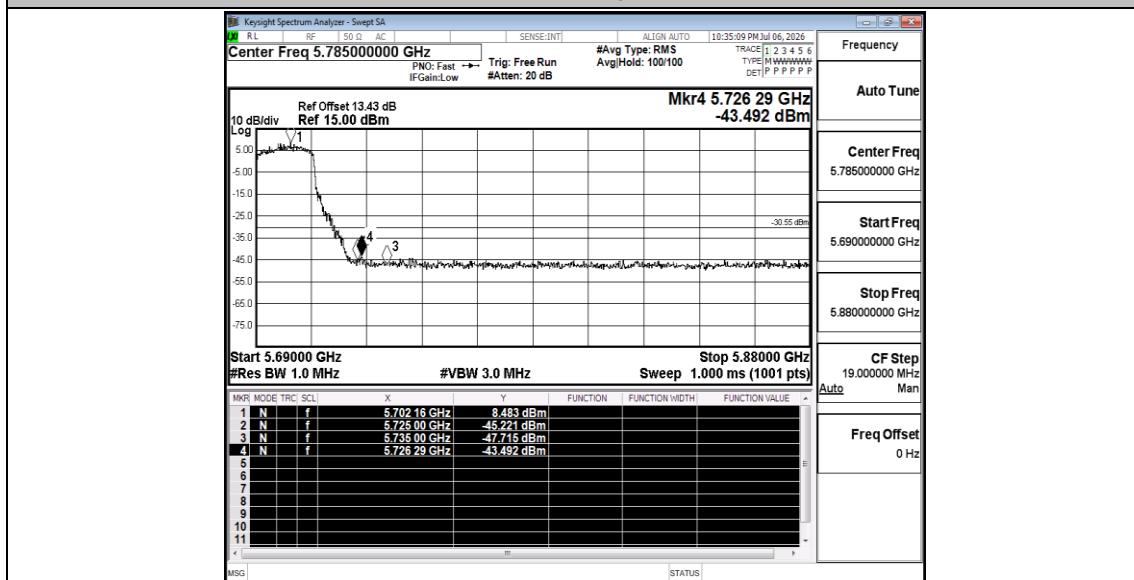



11AX40ISO_Ant3_Low_5510_AV

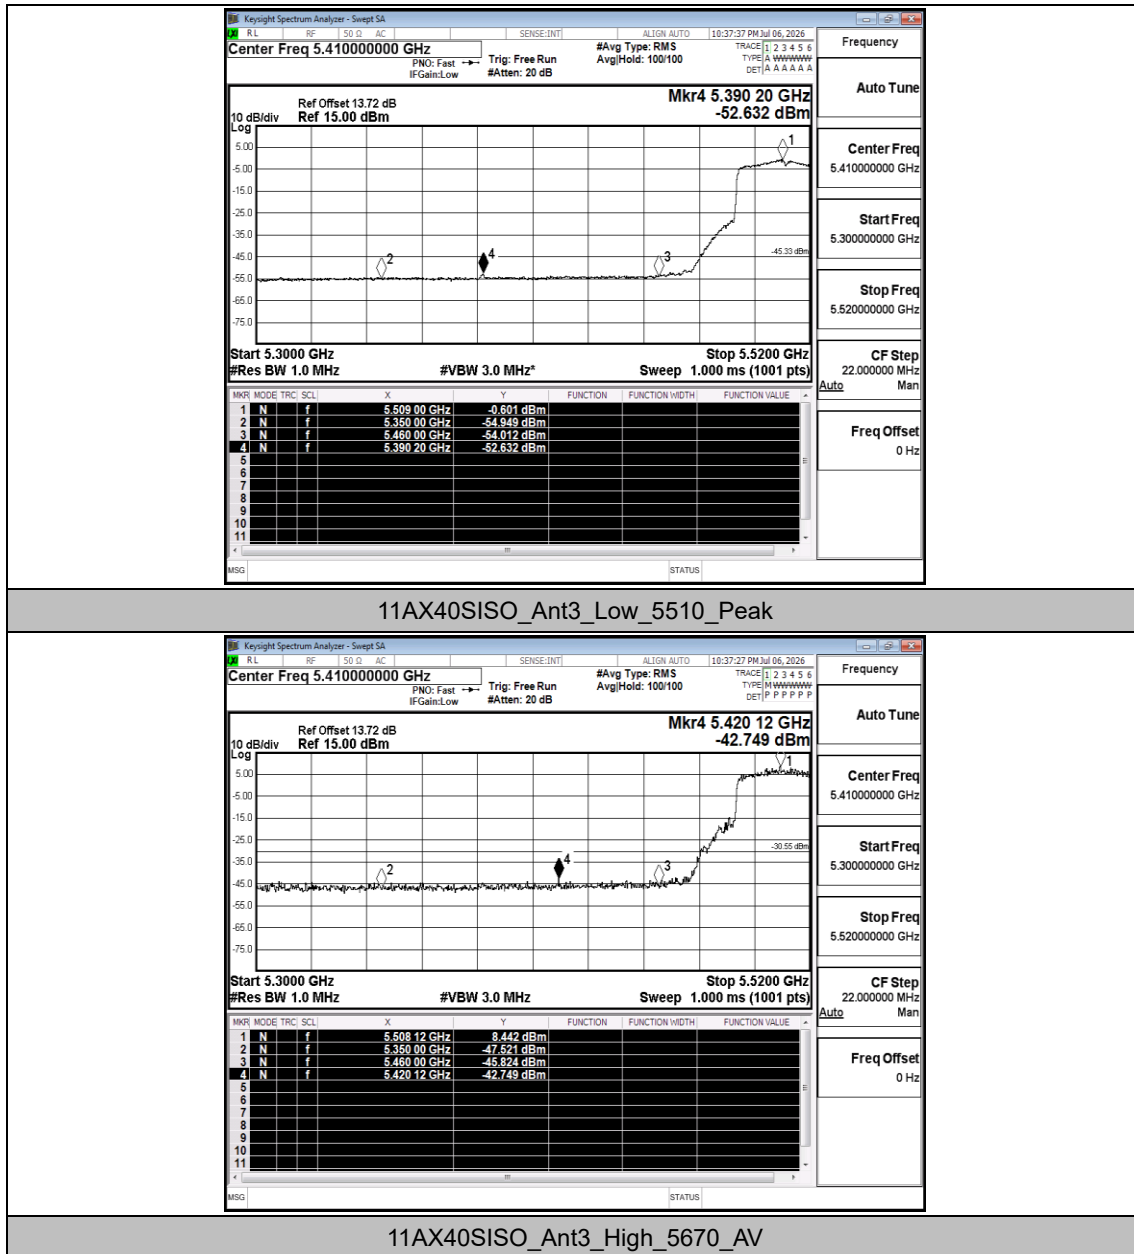

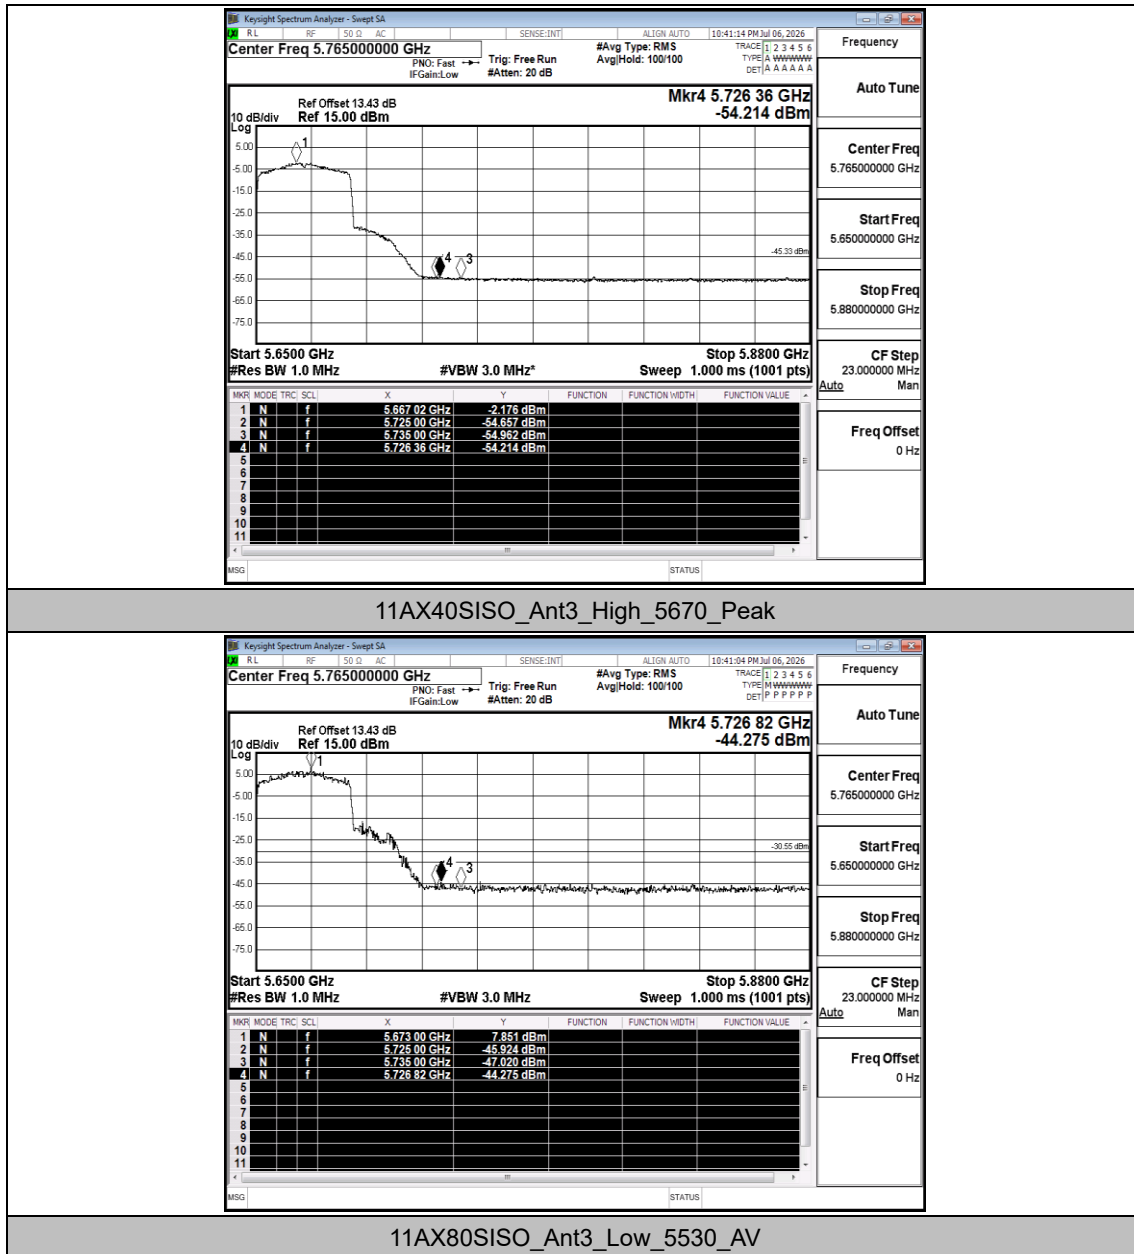


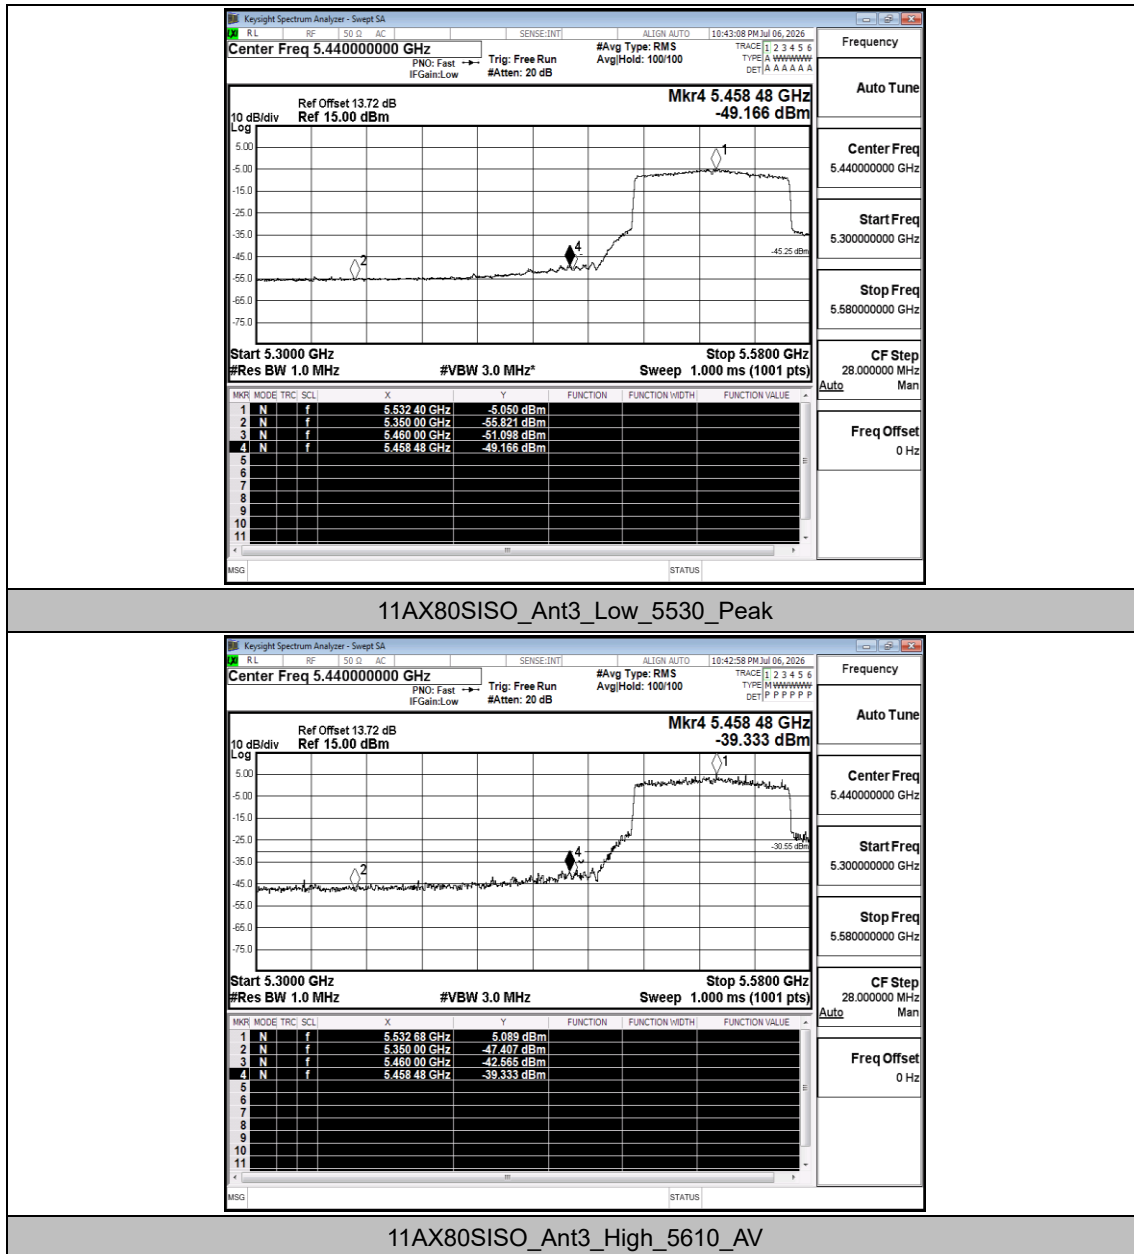

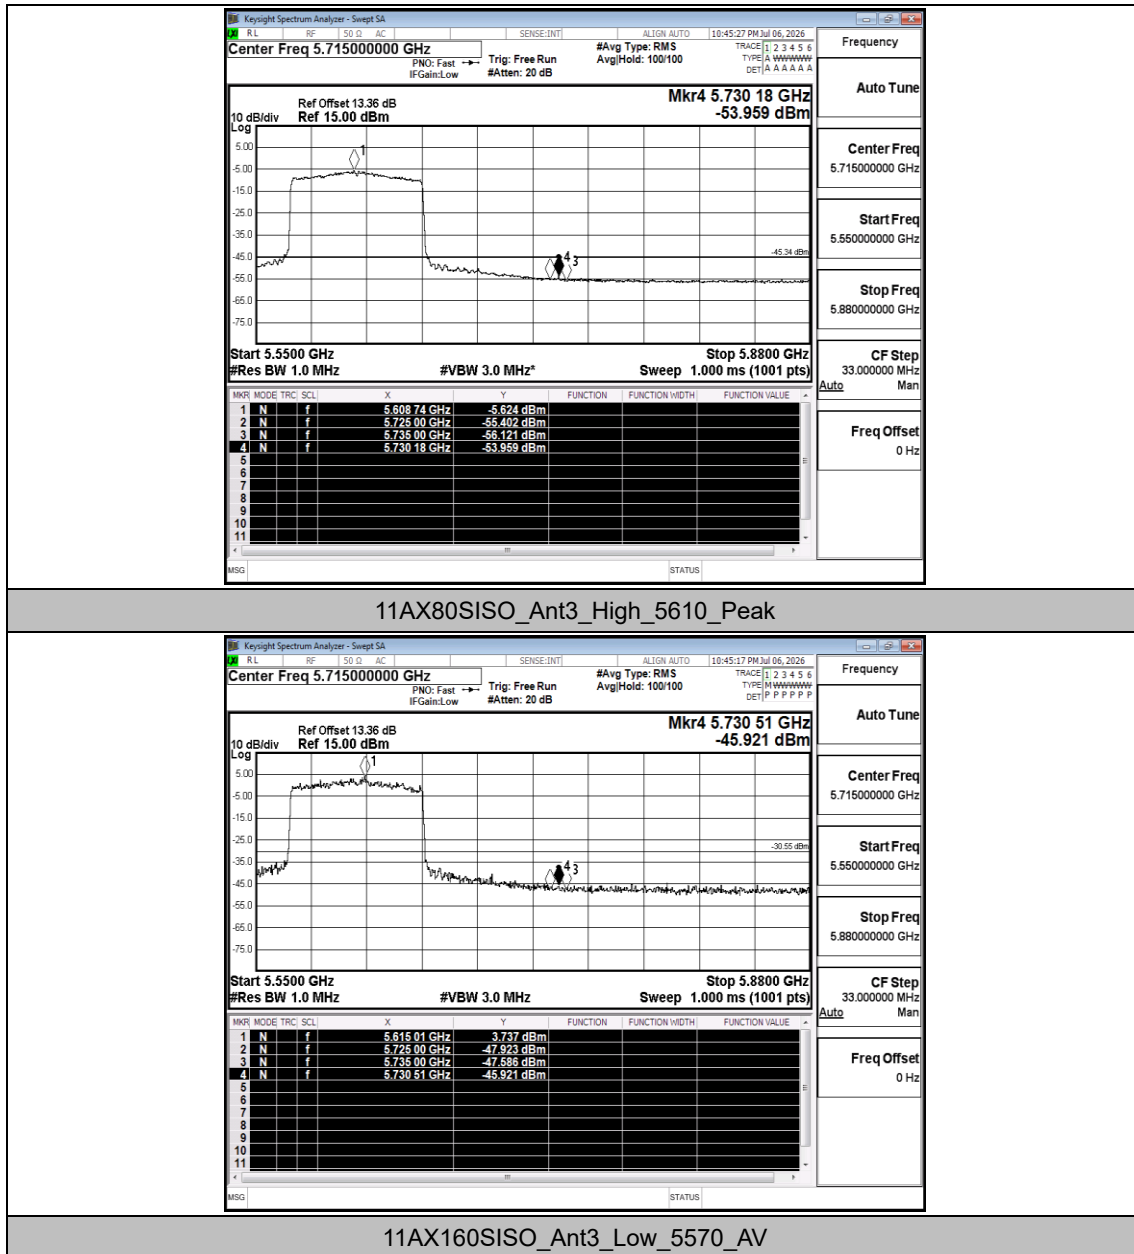


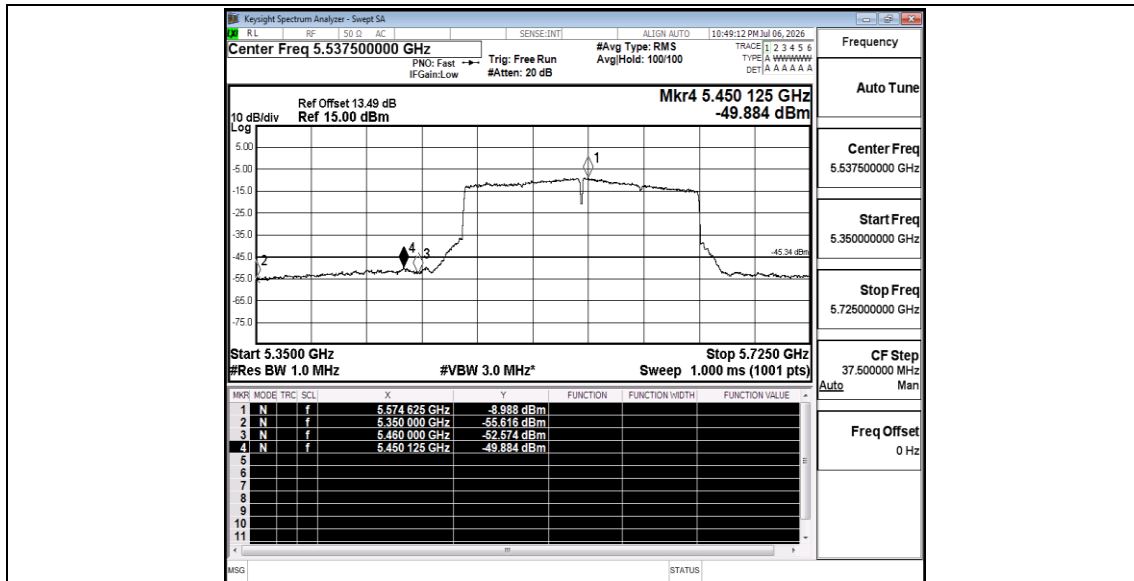

11AX160SISO_Ant3_Low_5570_Peak

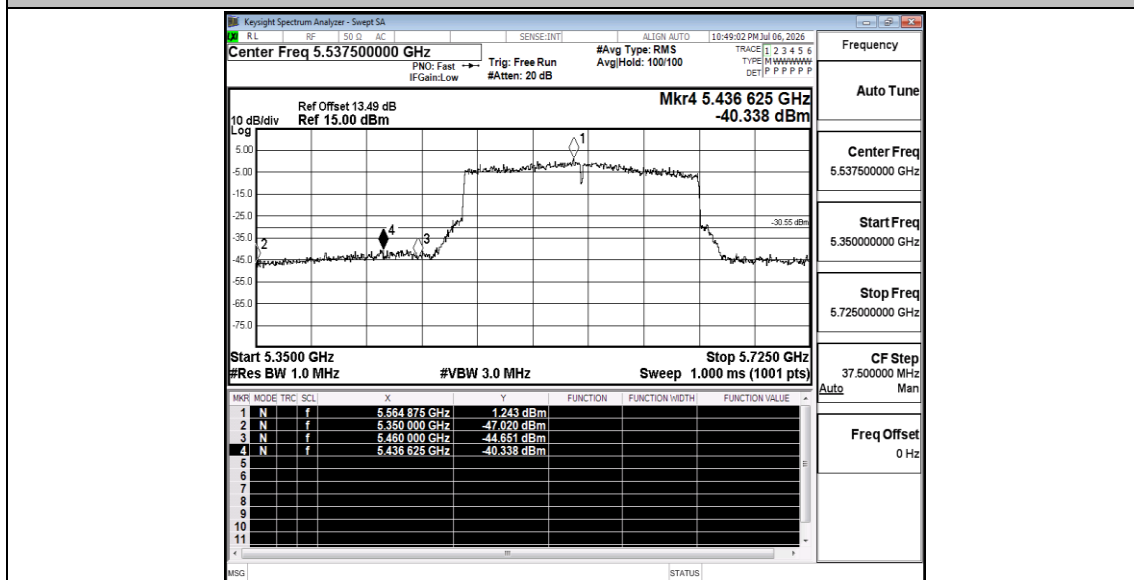

11AX160SISO_Ant3_High_5570_AV

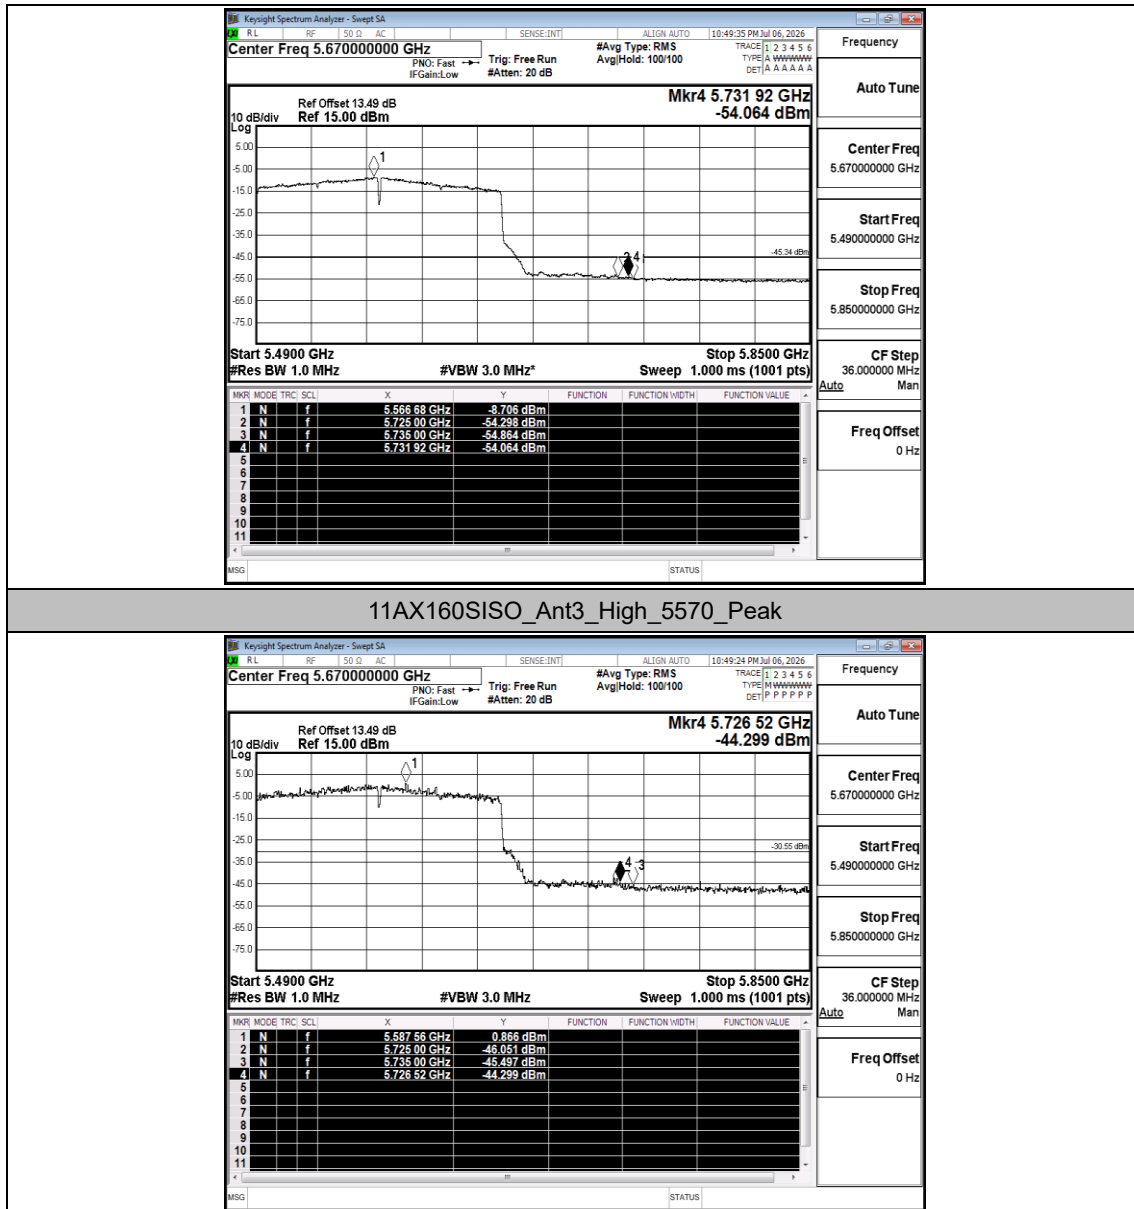

D.5 Frequency Stability

Test Result

Voltage								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant1	5500	NV	NT	40000.00	7.272727	20	PASS
			LV	NT	20000.00	3.636364	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	40000.00	7.168459	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	40000.00	7.168459	20	PASS
		5700	NV	NT	60000.00	10.526316	20	PASS
			LV	NT	60000.00	10.526316	20	PASS
			HV	NT	40000.00	7.017544	20	PASS
11N20SISO	Ant1	5500	NV	NT	20000.00	3.636364	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	20000.00	3.584229	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	40000.00	7.168459	20	PASS
		5700	NV	NT	40000.00	7.017544	20	PASS
			LV	NT	60000.00	10.526316	20	PASS
			HV	NT	40000.00	7.017544	20	PASS
11N40SISO	Ant1	5510	NV	NT	0.00	0.000000	20	PASS
			LV	NT	80000.00	14.519056	20	PASS
			HV	NT	80000.00	14.519056	20	PASS
		5550	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	40000.00	7.207207	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	40000.00	7.054674	20	PASS
11AC20SISO	Ant1	5500	NV	NT	40000.00	7.272727	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	40000.00	7.168459	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	20000.00	3.584229	20	PASS
		5700	NV	NT	40000.00	7.017544	20	PASS

			LV	NT	40000.00	7.017544	20	PASS
			HV	NT	20000.00	3.508772	20	PASS
11AC40SISO	Ant1	5510	NV	NT	40000.00	7.259528	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	40000.00	7.259528	20	PASS
		5550	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	-40000.00	-7.207207	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	80000.00	14.109347	20	PASS
11AC80SISO	Ant1	5530	NV	NT	80000.00	14.466546	20	PASS
			LV	NT	80000.00	14.466546	20	PASS
			HV	NT	80000.00	14.466546	20	PASS
		5610	NV	NT	0.00	0.000000	20	PASS
			LV	NT	80000.00	14.260250	20	PASS
			HV	NT	80000.00	14.260250	20	PASS
11AC160SISO	Ant1	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS
11AX20SISO	Ant1	5500	NV	NT	40000.00	7.272727	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	40000.00	7.168459	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	40000.00	7.168459	20	PASS
		5700	NV	NT	40000.00	7.017544	20	PASS
			LV	NT	40000.00	7.017544	20	PASS
			HV	NT	40000.00	7.017544	20	PASS
11AX40SISO	Ant1	5510	NV	NT	40000.00	7.259528	20	PASS
			LV	NT	40000.00	7.259528	20	PASS
			HV	NT	40000.00	7.259528	20	PASS
		5550	NV	NT	40000.00	7.207207	20	PASS
			LV	NT	40000.00	7.207207	20	PASS
			HV	NT	40000.00	7.207207	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	40000.00	7.054674	20	PASS
11AX80SISO	Ant1	5530	NV	NT	0.00	0.000000	20	PASS
			LV	NT	80000.00	14.466546	20	PASS
			HV	NT	80000.00	14.466546	20	PASS

		5610	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS
11AX160SISO	Ant1	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS

Temperature								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant1	5500	NV	-30	40000.00	7.272727	20	PASS
			NV	-20	20000.00	3.636364	20	PASS
			NV	-10	20000.00	3.636364	20	PASS
			NV	0	20000.00	3.636364	20	PASS
			NV	10	20000.00	3.636364	20	PASS
			NV	20	20000.00	3.636364	20	PASS
			NV	30	20000.00	3.636364	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	20000.00	3.636364	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	20000.00	3.584229	20	PASS
			NV	-10	40000.00	7.168459	20	PASS
			NV	0	20000.00	3.584229	20	PASS
			NV	10	60000.00	10.752688	20	PASS
			NV	20	20000.00	3.584229	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	40000.00	7.017544	20	PASS
			NV	-20	60000.00	10.526316	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	60000.00	10.526316	20	PASS
			NV	10	60000.00	10.526316	20	PASS
			NV	20	60000.00	10.526316	20	PASS
			NV	30	40000.00	7.017544	20	PASS
			NV	40	40000.00	7.017544	20	PASS
			NV	50	60000.00	10.526316	20	PASS
11N20SiSO	Ant1	5500	NV	-30	20000.00	3.636364	20	PASS
			NV	-20	40000.00	7.272727	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	40000.00	7.272727	20	PASS
			NV	20	40000.00	7.272727	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	20000.00	3.636364	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	40000.00	7.168459	20	PASS

			NV	-10	40000.00	7.168459	20	PASS
			NV	0	40000.00	7.168459	20	PASS
			NV	10	40000.00	7.168459	20	PASS
			NV	20	40000.00	7.168459	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	40000.00	7.017544	20	PASS
			NV	-20	40000.00	7.017544	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	40000.00	7.017544	20	PASS
			NV	10	40000.00	7.017544	20	PASS
			NV	20	40000.00	7.017544	20	PASS
			NV	30	20000.00	3.508772	20	PASS
			NV	40	40000.00	7.017544	20	PASS
			NV	50	40000.00	7.017544	20	PASS
11N40SISO	Ant1	5510	NV	-30	40000.00	7.259528	20	PASS
			NV	-20	40000.00	7.259528	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	40000.00	7.259528	20	PASS
			NV	10	40000.00	7.259528	20	PASS
			NV	20	80000.00	14.519056	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	40000.00	7.207207	20	PASS
			NV	-20	40000.00	7.207207	20	PASS
			NV	-10	40000.00	7.207207	20	PASS
			NV	0	40000.00	7.207207	20	PASS
			NV	10	40000.00	7.207207	20	PASS
			NV	20	40000.00	7.207207	20	PASS
			NV	30	40000.00	7.207207	20	PASS
			NV	40	40000.00	7.207207	20	PASS
			NV	50	40000.00	7.207207	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	40000.00	7.054674	20	PASS
			NV	10	80000.00	14.109347	20	PASS
			NV	20	40000.00	7.054674	20	PASS
			NV	30	40000.00	7.054674	20	PASS

			NV	40	0.00	0.000000	20	PASS
			NV	50	40000.00	7.054674	20	PASS
11AC20SISO	Ant1	5500	NV	-30	40000.00	7.272727	20	PASS
			NV	-20	20000.00	3.636364	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	40000.00	7.272727	20	PASS
			NV	20	40000.00	7.272727	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	20000.00	3.636364	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	20000.00	3.584229	20	PASS
			NV	-10	20000.00	3.584229	20	PASS
			NV	0	40000.00	7.168459	20	PASS
			NV	10	40000.00	7.168459	20	PASS
			NV	20	60000.00	10.752688	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	40000.00	7.017544	20	PASS
			NV	-20	40000.00	7.017544	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	40000.00	7.017544	20	PASS
			NV	10	40000.00	7.017544	20	PASS
			NV	20	40000.00	7.017544	20	PASS
			NV	30	60000.00	10.526316	20	PASS
			NV	40	60000.00	10.526316	20	PASS
			NV	50	40000.00	7.017544	20	PASS
11AC40SISO	Ant1	5510	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	40000.00	7.259528	20	PASS
			NV	0	-40000.00	-7.259528	20	PASS
			NV	10	40000.00	7.259528	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5550	NV	-30	0.00	0.000000	20	PASS
			NV	-20	40000.00	7.207207	20	PASS
			NV	-10	40000.00	7.207207	20	PASS

			NV	0	40000.00	7.207207	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	40000.00	7.207207	20	PASS
			NV	30	40000.00	7.207207	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	40000.00	7.207207	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	80000.00	14.109347	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	40000.00	7.054674	20	PASS
			NV	10	80000.00	14.109347	20	PASS
			NV	20	40000.00	7.054674	20	PASS
			NV	30	40000.00	7.054674	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	80000.00	14.109347	20	PASS
11AC80SISO	Ant1	5530	NV	-30	80000.00	14.466546	20	PASS
			NV	-20	80000.00	14.466546	20	PASS
			NV	-10	80000.00	14.466546	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	80000.00	14.466546	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	80000.00	14.466546	20	PASS
		5610	NV	-30	80000.00	14.260250	20	PASS
			NV	-20	80000.00	14.260250	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	80000.00	14.260250	20	PASS
			NV	20	80000.00	14.260250	20	PASS
			NV	30	80000.00	14.260250	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
11AC160SISO	Ant1	5570	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS

			NV	50	0.00	0.000000	20	PASS
11AX20SISO	Ant1	5500	NV	-30	40000.00	7.272727	20	PASS
			NV	-20	40000.00	7.272727	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	40000.00	7.272727	20	PASS
			NV	20	40000.00	7.272727	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	40000.00	7.272727	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	40000.00	7.168459	20	PASS
			NV	-10	40000.00	7.168459	20	PASS
			NV	0	40000.00	7.168459	20	PASS
			NV	10	40000.00	7.168459	20	PASS
			NV	20	40000.00	7.168459	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	40000.00	7.017544	20	PASS
			NV	-20	40000.00	7.017544	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	40000.00	7.017544	20	PASS
			NV	10	40000.00	7.017544	20	PASS
			NV	20	40000.00	7.017544	20	PASS
			NV	30	40000.00	7.017544	20	PASS
			NV	40	40000.00	7.017544	20	PASS
			NV	50	40000.00	7.017544	20	PASS
11AX40SISO	Ant1	5510	NV	-30	40000.00	7.259528	20	PASS
			NV	-20	40000.00	7.259528	20	PASS
			NV	-10	40000.00	7.259528	20	PASS
			NV	0	40000.00	7.259528	20	PASS
			NV	10	40000.00	7.259528	20	PASS
			NV	20	40000.00	7.259528	20	PASS
			NV	30	40000.00	7.259528	20	PASS
			NV	40	40000.00	7.259528	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	40000.00	7.207207	20	PASS
			NV	-20	40000.00	7.207207	20	PASS
			NV	-10	40000.00	7.207207	20	PASS
			NV	0	40000.00	7.207207	20	PASS

			NV	10	40000.00	7.207207	20	PASS
			NV	20	40000.00	7.207207	20	PASS
			NV	30	40000.00	7.207207	20	PASS
			NV	40	40000.00	7.207207	20	PASS
			NV	50	40000.00	7.207207	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	40000.00	7.054674	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	40000.00	7.054674	20	PASS
			NV	10	40000.00	7.054674	20	PASS
			NV	20	40000.00	7.054674	20	PASS
			NV	30	40000.00	7.054674	20	PASS
			NV	40	40000.00	7.054674	20	PASS
			NV	50	40000.00	7.054674	20	PASS
11AX80SISO	Ant1	5530	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	80000.00	14.466546	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
		5610	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	80000.00	14.260250	20	PASS
			NV	0	80000.00	14.260250	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	80000.00	14.260250	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	80000.00	14.260250	20	PASS
			NV	50	80000.00	14.260250	20	PASS
11AX160SISO	Ant1	5570	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS

Voltage								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant2	5500	NV	NT	20000.00	3.636364	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	60000.00	10.752688	20	PASS
			LV	NT	60000.00	10.752688	20	PASS
			HV	NT	60000.00	10.752688	20	PASS
		5700	NV	NT	60000.00	10.526316	20	PASS
			LV	NT	60000.00	10.526316	20	PASS
			HV	NT	60000.00	10.526316	20	PASS
11N20SISO	Ant2	5500	NV	NT	40000.00	7.272727	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	40000.00	7.168459	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	60000.00	10.752688	20	PASS
		5700	NV	NT	80000.00	14.035088	20	PASS
			LV	NT	60000.00	10.526316	20	PASS
			HV	NT	60000.00	10.526316	20	PASS
11N40SISO	Ant2	5510	NV	NT	40000.00	7.259528	20	PASS
			LV	NT	80000.00	14.519056	20	PASS
			HV	NT	0.00	0.000000	20	PASS
		5550	NV	NT	0.00	0.000000	20	PASS
			LV	NT	80000.00	14.414414	20	PASS
			HV	NT	80000.00	14.414414	20	PASS
		5670	NV	NT	80000.00	14.109347	20	PASS
			LV	NT	80000.00	14.109347	20	PASS
			HV	NT	40000.00	7.054674	20	PASS
11AC20SISO	Ant2	5500	NV	NT	60000.00	10.909091	20	PASS
			LV	NT	80000.00	14.545455	20	PASS
			HV	NT	60000.00	10.909091	20	PASS
		5580	NV	NT	80000.00	14.336918	20	PASS
			LV	NT	80000.00	14.336918	20	PASS
			HV	NT	80000.00	14.336918	20	PASS
		5700	NV	NT	100000.00	17.543860	20	PASS
			LV	NT	100000.00	17.543860	20	PASS
			HV	NT	100000.00	17.543860	20	PASS
11AC40SISO	Ant2	5510	NV	NT	80000.00	14.519056	20	PASS

			LV	NT	40000.00	7.259528	20	PASS
			HV	NT	80000.00	14.519056	20	PASS
		5550	NV	NT	80000.00	14.414414	20	PASS
			LV	NT	80000.00	14.414414	20	PASS
			HV	NT	80000.00	14.414414	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	80000.00	14.109347	20	PASS
			HV	NT	80000.00	14.109347	20	PASS
11AC80SISO	Ant2	5530	NV	NT	80000.00	14.466546	20	PASS
			LV	NT	80000.00	14.466546	20	PASS
			HV	NT	80000.00	14.466546	20	PASS
		5610	NV	NT	80000.00	14.260250	20	PASS
			LV	NT	80000.00	14.260250	20	PASS
			HV	NT	0.00	0.000000	20	PASS
11AC160SISO	Ant2	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS
11AX20SISO	Ant2	5500	NV	NT	80000.00	14.545455	20	PASS
			LV	NT	80000.00	14.545455	20	PASS
			HV	NT	80000.00	14.545455	20	PASS
		5580	NV	NT	80000.00	14.336918	20	PASS
			LV	NT	80000.00	14.336918	20	PASS
			HV	NT	80000.00	14.336918	20	PASS
		5700	NV	NT	80000.00	14.035088	20	PASS
			LV	NT	80000.00	14.035088	20	PASS
			HV	NT	80000.00	14.035088	20	PASS
11AX40SISO	Ant2	5510	NV	NT	80000.00	14.519056	20	PASS
			LV	NT	80000.00	14.519056	20	PASS
			HV	NT	80000.00	14.519056	20	PASS
		5550	NV	NT	80000.00	14.414414	20	PASS
			LV	NT	80000.00	14.414414	20	PASS
			HV	NT	80000.00	14.414414	20	PASS
		5670	NV	NT	0.00	0.000000	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	40000.00	7.054674	20	PASS
11AX80SISO	Ant2	5530	NV	NT	80000.00	14.466546	20	PASS
			LV	NT	80000.00	14.466546	20	PASS
			HV	NT	80000.00	14.466546	20	PASS
		5610	NV	NT	0.00	0.000000	20	PASS
			LV	NT	80000.00	14.260250	20	PASS
			HV	NT	80000.00	14.260250	20	PASS

11AX160SISO	Ant2	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS

Temperature								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant2	5500	NV	-30	60000.00	10.909091	20	PASS
			NV	-20	40000.00	7.272727	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	40000.00	7.272727	20	PASS
			NV	20	60000.00	10.909091	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	60000.00	10.909091	20	PASS
			NV	50	40000.00	7.272727	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	60000.00	10.752688	20	PASS
			NV	-10	60000.00	10.752688	20	PASS
			NV	0	40000.00	7.168459	20	PASS
			NV	10	60000.00	10.752688	20	PASS
			NV	20	40000.00	7.168459	20	PASS
			NV	30	60000.00	10.752688	20	PASS
			NV	40	60000.00	10.752688	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	60000.00	10.526316	20	PASS
			NV	-20	60000.00	10.526316	20	PASS
			NV	-10	80000.00	14.035088	20	PASS
			NV	0	80000.00	14.035088	20	PASS
			NV	10	60000.00	10.526316	20	PASS
			NV	20	60000.00	10.526316	20	PASS
			NV	30	60000.00	10.526316	20	PASS
			NV	40	60000.00	10.526316	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11N20SiSO	Ant2	5500	NV	-30	40000.00	7.272727	20	PASS
			NV	-20	20000.00	3.636364	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	40000.00	7.272727	20	PASS
			NV	20	40000.00	7.272727	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	40000.00	7.272727	20	PASS
		5580	NV	-30	60000.00	10.752688	20	PASS
			NV	-20	60000.00	10.752688	20	PASS

			NV	-10	80000.00	14.336918	20	PASS
			NV	0	60000.00	10.752688	20	PASS
			NV	10	40000.00	7.168459	20	PASS
			NV	20	40000.00	7.168459	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	60000.00	10.752688	20	PASS
		5700	NV	-30	60000.00	10.526316	20	PASS
			NV	-20	60000.00	10.526316	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	60000.00	10.526316	20	PASS
			NV	10	80000.00	14.035088	20	PASS
			NV	20	80000.00	14.035088	20	PASS
			NV	30	80000.00	14.035088	20	PASS
			NV	40	80000.00	14.035088	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11N40SISO	Ant2	5510	NV	-30	40000.00	7.259528	20	PASS
			NV	-20	40000.00	7.259528	20	PASS
			NV	-10	40000.00	7.259528	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	80000.00	14.519056	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	40000.00	7.259528	20	PASS
			NV	40	80000.00	14.519056	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	80000.00	14.414414	20	PASS
			NV	-20	80000.00	14.414414	20	PASS
			NV	-10	40000.00	7.207207	20	PASS
			NV	0	40000.00	7.207207	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	40000.00	7.207207	20	PASS
			NV	30	40000.00	7.207207	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	40000.00	7.207207	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	40000.00	7.054674	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	80000.00	14.109347	20	PASS
			NV	10	40000.00	7.054674	20	PASS
			NV	20	80000.00	14.109347	20	PASS
			NV	30	40000.00	7.054674	20	PASS

			NV	40	80000.00	14.109347	20	PASS
			NV	50	80000.00	14.109347	20	PASS
11AC20SISO	Ant2	5500	NV	-30	60000.00	10.909091	20	PASS
			NV	-20	60000.00	10.909091	20	PASS
			NV	-10	80000.00	14.545455	20	PASS
			NV	0	80000.00	14.545455	20	PASS
			NV	10	80000.00	14.545455	20	PASS
			NV	20	80000.00	14.545455	20	PASS
			NV	30	80000.00	14.545455	20	PASS
			NV	40	80000.00	14.545455	20	PASS
			NV	50	80000.00	14.545455	20	PASS
		5580	NV	-30	80000.00	14.336918	20	PASS
			NV	-20	80000.00	14.336918	20	PASS
			NV	-10	80000.00	14.336918	20	PASS
			NV	0	80000.00	14.336918	20	PASS
			NV	10	80000.00	14.336918	20	PASS
			NV	20	100000.00	17.921147	20	PASS
			NV	30	100000.00	17.921147	20	PASS
			NV	40	80000.00	14.336918	20	PASS
			NV	50	80000.00	14.336918	20	PASS
		5700	NV	-30	100000.00	17.543860	20	PASS
			NV	-20	80000.00	14.035088	20	PASS
			NV	-10	100000.00	17.543860	20	PASS
			NV	0	100000.00	17.543860	20	PASS
			NV	10	100000.00	17.543860	20	PASS
			NV	20	100000.00	17.543860	20	PASS
			NV	30	100000.00	17.543860	20	PASS
			NV	40	100000.00	17.543860	20	PASS
			NV	50	100000.00	17.543860	20	PASS
11AC40SISO	Ant2	5510	NV	-30	80000.00	14.519056	20	PASS
			NV	-20	80000.00	14.519056	20	PASS
			NV	-10	80000.00	14.519056	20	PASS
			NV	0	40000.00	7.259528	20	PASS
			NV	10	80000.00	14.519056	20	PASS
			NV	20	80000.00	14.519056	20	PASS
			NV	30	40000.00	7.259528	20	PASS
			NV	40	40000.00	7.259528	20	PASS
			NV	50	80000.00	14.519056	20	PASS
		5550	NV	-30	80000.00	14.414414	20	PASS
			NV	-20	80000.00	14.414414	20	PASS
			NV	-10	80000.00	14.414414	20	PASS

			NV	0	80000.00	14.414414	20	PASS
			NV	10	80000.00	14.414414	20	PASS
			NV	20	80000.00	14.414414	20	PASS
			NV	30	40000.00	7.207207	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	80000.00	14.414414	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	40000.00	7.054674	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	80000.00	14.109347	20	PASS
			NV	10	80000.00	14.109347	20	PASS
			NV	20	80000.00	14.109347	20	PASS
			NV	30	80000.00	14.109347	20	PASS
			NV	40	80000.00	14.109347	20	PASS
			NV	50	80000.00	14.109347	20	PASS
11AC80SISO	Ant2	5530	NV	-30	80000.00	14.466546	20	PASS
			NV	-20	80000.00	14.466546	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	80000.00	14.466546	20	PASS
			NV	10	80000.00	14.466546	20	PASS
			NV	20	80000.00	14.466546	20	PASS
			NV	30	80000.00	14.466546	20	PASS
			NV	40	80000.00	14.466546	20	PASS
			NV	50	80000.00	14.466546	20	PASS
		5610	NV	-30	80000.00	14.260250	20	PASS
			NV	-20	80000.00	14.260250	20	PASS
			NV	-10	80000.00	14.260250	20	PASS
			NV	0	80000.00	14.260250	20	PASS
			NV	10	80000.00	14.260250	20	PASS
			NV	20	80000.00	14.260250	20	PASS
			NV	30	80000.00	14.260250	20	PASS
			NV	40	80000.00	14.260250	20	PASS
			NV	50	80000.00	14.260250	20	PASS
11AC160SISO	Ant2	5570	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS

			NV	50	0.00	0.000000	20	PASS
11AX20SISO	Ant2	5500	NV	-30	80000.00	14.545455	20	PASS
			NV	-20	80000.00	14.545455	20	PASS
			NV	-10	80000.00	14.545455	20	PASS
			NV	0	80000.00	14.545455	20	PASS
			NV	10	80000.00	14.545455	20	PASS
			NV	20	80000.00	14.545455	20	PASS
			NV	30	80000.00	14.545455	20	PASS
			NV	40	80000.00	14.545455	20	PASS
			NV	50	80000.00	14.545455	20	PASS
		5580	NV	-30	80000.00	14.336918	20	PASS
			NV	-20	80000.00	14.336918	20	PASS
			NV	-10	80000.00	14.336918	20	PASS
			NV	0	80000.00	14.336918	20	PASS
			NV	10	80000.00	14.336918	20	PASS
			NV	20	80000.00	14.336918	20	PASS
			NV	30	80000.00	14.336918	20	PASS
			NV	40	80000.00	14.336918	20	PASS
			NV	50	80000.00	14.336918	20	PASS
		5700	NV	-30	80000.00	14.035088	20	PASS
			NV	-20	80000.00	14.035088	20	PASS
			NV	-10	80000.00	14.035088	20	PASS
			NV	0	80000.00	14.035088	20	PASS
			NV	10	80000.00	14.035088	20	PASS
			NV	20	80000.00	14.035088	20	PASS
			NV	30	80000.00	14.035088	20	PASS
			NV	40	100000.00	17.543860	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11AX40SISO	Ant2	5510	NV	-30	40000.00	7.259528	20	PASS
			NV	-20	80000.00	14.519056	20	PASS
			NV	-10	80000.00	14.519056	20	PASS
			NV	0	80000.00	14.519056	20	PASS
			NV	10	80000.00	14.519056	20	PASS
			NV	20	40000.00	7.259528	20	PASS
			NV	30	80000.00	14.519056	20	PASS
			NV	40	80000.00	14.519056	20	PASS
			NV	50	80000.00	14.519056	20	PASS
		5550	NV	-30	80000.00	14.414414	20	PASS
			NV	-20	80000.00	14.414414	20	PASS
			NV	-10	80000.00	14.414414	20	PASS
			NV	0	80000.00	14.414414	20	PASS
			NV	0	80000.00	14.414414	20	PASS

			NV	10	80000.00	14.414414	20	PASS
			NV	20	80000.00	14.414414	20	PASS
			NV	30	80000.00	14.414414	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	80000.00	14.414414	20	PASS
		5670	NV	-30	40000.00	7.054674	20	PASS
			NV	-20	40000.00	7.054674	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	40000.00	7.054674	20	PASS
			NV	10	40000.00	7.054674	20	PASS
			NV	20	40000.00	7.054674	20	PASS
			NV	30	40000.00	7.054674	20	PASS
			NV	40	80000.00	14.109347	20	PASS
			NV	50	80000.00	14.109347	20	PASS
11AX80SISO	Ant2	5530	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	80000.00	14.466546	20	PASS
			NV	10	80000.00	14.466546	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	80000.00	14.466546	20	PASS
			NV	50	80000.00	14.466546	20	PASS
		5610	NV	-30	80000.00	14.260250	20	PASS
			NV	-20	80000.00	14.260250	20	PASS
			NV	-10	80000.00	14.260250	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	80000.00	14.260250	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS
11AX160SISO	Ant2	5570	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS
			NV	50	0.00	0.000000	20	PASS

Voltage								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant3	5500	NV	NT	60000.00	10.909091	20	PASS
			LV	NT	60000.00	10.909091	20	PASS
			HV	NT	60000.00	10.909091	20	PASS
		5580	NV	NT	80000.00	14.336918	20	PASS
			LV	NT	60000.00	10.752688	20	PASS
			HV	NT	60000.00	10.752688	20	PASS
		5700	NV	NT	80000.00	14.035088	20	PASS
			LV	NT	80000.00	14.035088	20	PASS
			HV	NT	80000.00	14.035088	20	PASS
11N20SISO	Ant3	5500	NV	NT	80000.00	14.545455	20	PASS
			LV	NT	80000.00	14.545455	20	PASS
			HV	NT	80000.00	14.545455	20	PASS
		5580	NV	NT	80000.00	14.336918	20	PASS
			LV	NT	80000.00	14.336918	20	PASS
			HV	NT	80000.00	14.336918	20	PASS
		5700	NV	NT	80000.00	14.035088	20	PASS
			LV	NT	80000.00	14.035088	20	PASS
			HV	NT	60000.00	10.526316	20	PASS
11N40SISO	Ant3	5510	NV	NT	80000.00	14.519056	20	PASS
			LV	NT	80000.00	14.519056	20	PASS
			HV	NT	80000.00	14.519056	20	PASS
		5550	NV	NT	40000.00	7.207207	20	PASS
			LV	NT	80000.00	14.414414	20	PASS
			HV	NT	80000.00	14.414414	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	80000.00	14.109347	20	PASS
			HV	NT	80000.00	14.109347	20	PASS
11AC20SISO	Ant3	5500	NV	NT	40000.00	7.272727	20	PASS
			LV	NT	40000.00	7.272727	20	PASS
			HV	NT	60000.00	10.909091	20	PASS
		5580	NV	NT	80000.00	14.336918	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	60000.00	10.752688	20	PASS
		5700	NV	NT	80000.00	14.035088	20	PASS
			LV	NT	80000.00	14.035088	20	PASS
			HV	NT	80000.00	14.035088	20	PASS
11AC40SISO	Ant3	5510	NV	NT	40000.00	7.259528	20	PASS

			LV	NT	80000.00	14.519056	20	PASS
			HV	NT	80000.00	14.519056	20	PASS
		5550	NV	NT	80000.00	14.414414	20	PASS
			LV	NT	80000.00	14.414414	20	PASS
			HV	NT	80000.00	14.414414	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	80000.00	14.109347	20	PASS
11AC80SISO	Ant3	5530	NV	NT	80000.00	14.466546	20	PASS
			LV	NT	80000.00	14.466546	20	PASS
			HV	NT	80000.00	14.466546	20	PASS
		5610	NV	NT	80000.00	14.260250	20	PASS
			LV	NT	80000.00	14.260250	20	PASS
			HV	NT	80000.00	14.260250	20	PASS
11AC160SISO	Ant3	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS
11AX20SISO	Ant3	5500	NV	NT	20000.00	3.636364	20	PASS
			LV	NT	20000.00	3.636364	20	PASS
			HV	NT	40000.00	7.272727	20	PASS
		5580	NV	NT	40000.00	7.168459	20	PASS
			LV	NT	40000.00	7.168459	20	PASS
			HV	NT	40000.00	7.168459	20	PASS
		5700	NV	NT	40000.00	7.017544	20	PASS
			LV	NT	40000.00	7.017544	20	PASS
			HV	NT	40000.00	7.017544	20	PASS
11AX40SISO	Ant3	5510	NV	NT	40000.00	7.259528	20	PASS
			LV	NT	40000.00	7.259528	20	PASS
			HV	NT	40000.00	7.259528	20	PASS
		5550	NV	NT	40000.00	7.207207	20	PASS
			LV	NT	40000.00	7.207207	20	PASS
			HV	NT	40000.00	7.207207	20	PASS
		5670	NV	NT	40000.00	7.054674	20	PASS
			LV	NT	40000.00	7.054674	20	PASS
			HV	NT	40000.00	7.054674	20	PASS
11AX80SISO	Ant3	5530	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS
		5610	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS

11AX160SISO	Ant3	5570	NV	NT	0.00	0.000000	20	PASS
			LV	NT	0.00	0.000000	20	PASS
			HV	NT	0.00	0.000000	20	PASS

Temperature								
TestMode	Antenna	Freq (MHz)	Voltage [Vdc]	Temperature (°C)	Deviation (Hz)	Deviation (ppm)	Limit (ppm)	Verdict
11A	Ant3	5500	NV	-30	60000.00	10.909091	20	PASS
			NV	-20	60000.00	10.909091	20	PASS
			NV	-10	80000.00	14.545455	20	PASS
			NV	0	60000.00	10.909091	20	PASS
			NV	10	60000.00	10.909091	20	PASS
			NV	20	80000.00	14.545455	20	PASS
			NV	30	60000.00	10.909091	20	PASS
			NV	40	60000.00	10.909091	20	PASS
			NV	50	80000.00	14.545455	20	PASS
		5580	NV	-30	60000.00	10.752688	20	PASS
			NV	-20	80000.00	14.336918	20	PASS
			NV	-10	60000.00	10.752688	20	PASS
			NV	0	80000.00	14.336918	20	PASS
			NV	10	80000.00	14.336918	20	PASS
			NV	20	80000.00	14.336918	20	PASS
			NV	30	60000.00	10.752688	20	PASS
			NV	40	80000.00	14.336918	20	PASS
			NV	50	60000.00	10.752688	20	PASS
		5700	NV	-30	80000.00	14.035088	20	PASS
			NV	-20	60000.00	10.526316	20	PASS
			NV	-10	60000.00	10.526316	20	PASS
			NV	0	60000.00	10.526316	20	PASS
			NV	10	100000.00	17.543860	20	PASS
			NV	20	80000.00	14.035088	20	PASS
			NV	30	80000.00	14.035088	20	PASS
			NV	40	80000.00	14.035088	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11N20SiSO	Ant3	5500	NV	-30	60000.00	10.909091	20	PASS
			NV	-20	80000.00	14.545455	20	PASS
			NV	-10	80000.00	14.545455	20	PASS
			NV	0	80000.00	14.545455	20	PASS
			NV	10	80000.00	14.545455	20	PASS
			NV	20	80000.00	14.545455	20	PASS
			NV	30	100000.00	18.181818	20	PASS
			NV	40	80000.00	14.545455	20	PASS
			NV	50	80000.00	14.545455	20	PASS
		5580	NV	-30	80000.00	14.336918	20	PASS
			NV	-20	80000.00	14.336918	20	PASS

			NV	-10	80000.00	14.336918	20	PASS
			NV	0	80000.00	14.336918	20	PASS
			NV	10	80000.00	14.336918	20	PASS
			NV	20	80000.00	14.336918	20	PASS
			NV	30	60000.00	10.752688	20	PASS
			NV	40	60000.00	10.752688	20	PASS
			NV	50	80000.00	14.336918	20	PASS
		5700	NV	-30	80000.00	14.035088	20	PASS
			NV	-20	80000.00	14.035088	20	PASS
			NV	-10	80000.00	14.035088	20	PASS
			NV	0	80000.00	14.035088	20	PASS
			NV	10	60000.00	10.526316	20	PASS
			NV	20	80000.00	14.035088	20	PASS
			NV	30	60000.00	10.526316	20	PASS
			NV	40	80000.00	14.035088	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11N40SISO	Ant3	5510	NV	-30	80000.00	14.519056	20	PASS
			NV	-20	40000.00	7.259528	20	PASS
			NV	-10	80000.00	14.519056	20	PASS
			NV	0	40000.00	7.259528	20	PASS
			NV	10	80000.00	14.519056	20	PASS
			NV	20	80000.00	14.519056	20	PASS
			NV	30	80000.00	14.519056	20	PASS
			NV	40	80000.00	14.519056	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	80000.00	14.414414	20	PASS
			NV	-20	80000.00	14.414414	20	PASS
			NV	-10	80000.00	14.414414	20	PASS
			NV	0	80000.00	14.414414	20	PASS
			NV	10	80000.00	14.414414	20	PASS
			NV	20	80000.00	14.414414	20	PASS
			NV	30	80000.00	14.414414	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	80000.00	14.414414	20	PASS
		5670	NV	-30	80000.00	14.109347	20	PASS
			NV	-20	80000.00	14.109347	20	PASS
			NV	-10	80000.00	14.109347	20	PASS
			NV	0	80000.00	14.109347	20	PASS
			NV	10	80000.00	14.109347	20	PASS
			NV	20	40000.00	7.054674	20	PASS
			NV	30	40000.00	7.054674	20	PASS

			NV	40	40000.00	7.054674	20	PASS
			NV	50	40000.00	7.054674	20	PASS
11AC20SISO	Ant3	5500	NV	-30	60000.00	10.909091	20	PASS
			NV	-20	60000.00	10.909091	20	PASS
			NV	-10	40000.00	7.272727	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	60000.00	10.909091	20	PASS
			NV	20	60000.00	10.909091	20	PASS
			NV	30	60000.00	10.909091	20	PASS
			NV	40	60000.00	10.909091	20	PASS
			NV	50	40000.00	7.272727	20	PASS
		5580	NV	-30	80000.00	14.336918	20	PASS
			NV	-20	80000.00	14.336918	20	PASS
			NV	-10	60000.00	10.752688	20	PASS
			NV	0	60000.00	10.752688	20	PASS
			NV	10	80000.00	14.336918	20	PASS
			NV	20	80000.00	14.336918	20	PASS
			NV	30	80000.00	14.336918	20	PASS
			NV	40	80000.00	14.336918	20	PASS
			NV	50	60000.00	10.752688	20	PASS
		5700	NV	-30	80000.00	14.035088	20	PASS
			NV	-20	60000.00	10.526316	20	PASS
			NV	-10	80000.00	14.035088	20	PASS
			NV	0	80000.00	14.035088	20	PASS
			NV	10	60000.00	10.526316	20	PASS
			NV	20	80000.00	14.035088	20	PASS
			NV	30	80000.00	14.035088	20	PASS
			NV	40	80000.00	14.035088	20	PASS
			NV	50	80000.00	14.035088	20	PASS
11AC40SISO	Ant3	5510	NV	-30	80000.00	14.519056	20	PASS
			NV	-20	80000.00	14.519056	20	PASS
			NV	-10	80000.00	14.519056	20	PASS
			NV	0	80000.00	14.519056	20	PASS
			NV	10	40000.00	7.259528	20	PASS
			NV	20	40000.00	7.259528	20	PASS
			NV	30	80000.00	14.519056	20	PASS
			NV	40	80000.00	14.519056	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	80000.00	14.414414	20	PASS
			NV	-20	80000.00	14.414414	20	PASS
			NV	-10	80000.00	14.414414	20	PASS

			NV	0	80000.00	14.414414	20	PASS
			NV	10	40000.00	7.207207	20	PASS
			NV	20	80000.00	14.414414	20	PASS
			NV	30	80000.00	14.414414	20	PASS
			NV	40	80000.00	14.414414	20	PASS
			NV	50	80000.00	14.414414	20	PASS
		5670	NV	-30	80000.00	14.109347	20	PASS
			NV	-20	80000.00	14.109347	20	PASS
			NV	-10	40000.00	7.054674	20	PASS
			NV	0	80000.00	14.109347	20	PASS
			NV	10	80000.00	14.109347	20	PASS
			NV	20	80000.00	14.109347	20	PASS
			NV	30	80000.00	14.109347	20	PASS
			NV	40	40000.00	7.054674	20	PASS
			NV	50	80000.00	14.109347	20	PASS
11AC80SISO	Ant3	5530	NV	-30	80000.00	14.466546	20	PASS
			NV	-20	80000.00	14.466546	20	PASS
			NV	-10	80000.00	14.466546	20	PASS
			NV	0	80000.00	14.466546	20	PASS
			NV	10	80000.00	14.466546	20	PASS
			NV	20	80000.00	14.466546	20	PASS
			NV	30	80000.00	14.466546	20	PASS
			NV	40	80000.00	14.466546	20	PASS
			NV	50	80000.00	14.466546	20	PASS
		5610	NV	-30	80000.00	14.260250	20	PASS
			NV	-20	80000.00	14.260250	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	80000.00	14.260250	20	PASS
			NV	10	80000.00	14.260250	20	PASS
			NV	20	80000.00	14.260250	20	PASS
			NV	30	80000.00	14.260250	20	PASS
			NV	40	80000.00	14.260250	20	PASS
			NV	50	80000.00	14.260250	20	PASS
11AC160SISO	Ant3	5570	NV	-30	0.00	0.000000	20	PASS
			NV	-20	0.00	0.000000	20	PASS
			NV	-10	0.00	0.000000	20	PASS
			NV	0	0.00	0.000000	20	PASS
			NV	10	0.00	0.000000	20	PASS
			NV	20	0.00	0.000000	20	PASS
			NV	30	0.00	0.000000	20	PASS
			NV	40	0.00	0.000000	20	PASS

			NV	50	0.00	0.000000	20	PASS
11AX20SISO	Ant3	5500	NV	-30	20000.00	3.636364	20	PASS
			NV	-20	40000.00	7.272727	20	PASS
			NV	-10	20000.00	3.636364	20	PASS
			NV	0	40000.00	7.272727	20	PASS
			NV	10	20000.00	3.636364	20	PASS
			NV	20	40000.00	7.272727	20	PASS
			NV	30	40000.00	7.272727	20	PASS
			NV	40	40000.00	7.272727	20	PASS
			NV	50	40000.00	7.272727	20	PASS
		5580	NV	-30	40000.00	7.168459	20	PASS
			NV	-20	40000.00	7.168459	20	PASS
			NV	-10	40000.00	7.168459	20	PASS
			NV	0	40000.00	7.168459	20	PASS
			NV	10	40000.00	7.168459	20	PASS
			NV	20	40000.00	7.168459	20	PASS
			NV	30	40000.00	7.168459	20	PASS
			NV	40	40000.00	7.168459	20	PASS
			NV	50	40000.00	7.168459	20	PASS
		5700	NV	-30	40000.00	7.017544	20	PASS
			NV	-20	40000.00	7.017544	20	PASS
			NV	-10	40000.00	7.017544	20	PASS
			NV	0	40000.00	7.017544	20	PASS
			NV	10	40000.00	7.017544	20	PASS
			NV	20	40000.00	7.017544	20	PASS
			NV	30	40000.00	7.017544	20	PASS
			NV	40	40000.00	7.017544	20	PASS
			NV	50	40000.00	7.017544	20	PASS
11AX40SISO	Ant3	5510	NV	-30	40000.00	7.259528	20	PASS
			NV	-20	40000.00	7.259528	20	PASS
			NV	-10	40000.00	7.259528	20	PASS
			NV	0	40000.00	7.259528	20	PASS
			NV	10	40000.00	7.259528	20	PASS
			NV	20	40000.00	7.259528	20	PASS
			NV	30	40000.00	7.259528	20	PASS
			NV	40	40000.00	7.259528	20	PASS
			NV	50	40000.00	7.259528	20	PASS
		5550	NV	-30	40000.00	7.207207	20	PASS
			NV	-20	40000.00	7.207207	20	PASS
			NV	-10	40000.00	7.207207	20	PASS
			NV	0	40000.00	7.207207	20	PASS